

## PROHLÁŠENÍ O VLASTNOSTECH

### DoP-FS-1014

pro fischer FPC Panel Coating (Protipožární a požárně těsnící výrobky: Uzavírání a utěsňování prostupů)

CS

1. Jedinečný identifikační kód typu výrobku: **DoP-FS-1014**
2. Zamýšlené/zamýšlená použití: **Zachování požární odolnosti požárně dělicích konstrukcí v místech průchodů servisních a energetických vedení, viz. dodatek, obzvláště Přílohy, 1-2.**
3. Výrobce: **fischerwerke GmbH & Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Německo**
4. Zplnomocněný zástupce: **-**
5. Systém/systémy POSV: **1**
6. Evropský dokument pro posuzování: **EAD 350454-00-1104**  
Evropské technické posouzení: **ETA-20/1062; 2021-06-11**  
Subjekt pro technické posuzování: **ETA-Danmark A/S**  
Oznámený subjekt/oznámené subjekty: **2531 - DBI Certification A/S**
7. Deklarovaná vlastnost/Deklarované vlastnosti:  
**Bezpečnost v případě požáru (BWR 2)**  
Reakce na oheň: Třída F  
Odolnost proti požáru: Přílohy 3, 8-9  
**Hygiena, zdraví a životní prostředí (BWR 3)**  
Průvzdušnost (vlastnost materiálu): NPD  
Propustnost vody (vlastnost materiálu): NPD  
Obsah, emise a / nebo uvolňování nebezpečných látek: Příloze 4  
**Bezpečnost při používání (BWR 4)**  
Mechanická odolnost a stabilita: NPD  
Odolnost proti nárazu/pohybu: NPD  
Přilnavost: NPD  
Životnost: Příloze 4  
**Ochrana proti hluku (BWR 5)**  
Vzduchová neprůzvučnost: NPD  
**Úspora energie a retence tepla (BWR 6)**  
Tepelné technické vlastnosti: NPD  
Propustnost vodních par: NPD
8. Příslušná technická dokumentace a/nebo specifická technická dokumentace: **-**

Vlastnosti výše uvedeného výrobku jsou ve shodě se souborem deklarovaných vlastností. Toto prohlášení o vlastnostech se v souladu s nařízením (EU) č. 305/2011 vydává na výhradní odpovědnost výrobce uvedeného výše.

Podepsáno za výrobce a jeho jménem:



Dr.-Ing. Oliver Geibig, Výkonný ředitel pro obchodní jednotky a inženýrství  
Tumlingen, 2021-06-18



Jürgen Grün, Výkonný ředitel pro chemii a kvalitu

Toto PoV bylo připraveno v různých jazykových mutacích. V případě rozporu vždy rozhoduje interpretace verze v anglickém jazyce.

Příloha obsahuje nepovinné a doplňkové informace v anglickém jazyce nad rámec zákonných požadavků.

## 1 Technical Description of the Product

- 1) fischer FPC Panel Coating is an ablative coating applied to mineral wool board used to reinstate the fire resistance performance of wall constructions where they have been provided with apertures for the penetration of single or multiple services.
- 2) The mineral wool board is then cut and friction fit into the aperture, prior to being inserted into the aperture in the wall. The fischer FPC Panel Coating is then applied over the surface of the board material to provide a dry film thickness of 0,7mm.
- 3) fischer FPC Panel Coating is supplied in 2,5, 5, 10, 20, 25 and 205 liter pails
- 4) Mineral fibre boards are 50mm thick and supplied in overall dimensions 1200mm x 600mm with a density of 140kg.m<sup>3</sup>.
- 5) fischer FiAM Intumescent Acoustic Mastic is required to seal all joints and junctions during the sealing process. Pyrocoustic Sealant is subject to a separate ETA referenced 13-1069 & 13-1070.
- 6) fischer FiGM PFS+ Intumescent Graphite Sealant is required to seal around specific services (See Annex C). fischer FiGM PFS+ Intumescent Graphite Sealant is subject to a separate ETA referenced 14/0381.

## 2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The intended use of fischer FPC Panel Coating is to reinstate the fire resistance performance of rigid and flexible wall constructions where they are penetrated by various cables and metallic pipes

- 1) The specific elements of construction that the fischer FPC Panel Coating may be used to provide a penetration seal in, are as follows:

Rigid walls: The wall must have a minimum thickness of 100 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m<sup>3</sup>.

Flexible walls: The wall must have a minimum thickness of 100 mm and comprise timber or steel studs lined on both faces with minimum 2 layers of 12.5 mm thick, 'Type F' Gypsum boards according to EN 520. In timber stud walls, no part of the penetration shall be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1, is provided within the cavity between the penetration seal and the stud.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The fischer FPC Panel Coating may be used to provide a penetration seal with pipes and cables (for details see Annex C).
- 3) The total amount of cross sections of services (including insulation) should not exceed 60% of the penetration area.

- 4) The fischer FPC Panel Coating may be used to seal apertures in the separating element up to 730mm wide by 1200mm high. The minimum permitted separation between adjacent seals/apertures is 200mm.
- 5) Pipes must be installed singular, cables require no minimum separation.
- 6) Services in walls shall be supported at maximum 250mm from the face of the separating element.
- 7) The provisions made in this European Technical Assessment are based on an assumed working life of the fischer FPC Panel Coating of 10 years, provided that the conditions laid down in the product data sheet for the packaging/transport/ storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### **Use Category**

Type Z<sub>1</sub>: Intended for use in internal conditions with humidity equal to or higher than 85% RH excluding temperatures below 0°C, without exposure to rain or UV.

### 3 Performance of The Product And References To The Methods Used For Its Assessment

<b>BWR</b>	<b>Characteristic</b>	<b>Assessment of characteristic</b>
2	<b>Safety in case of fire</b>	
	Reaction to fire	See Clause 1.1
	Resistance to fire	See clause 1.2
3	<b>Hygiene, Health and the Environment</b>	
	Dangerous substances	See clause 2.1
4	<b>Safety in use</b>	
	Durability and serviceability	See clause 3.1
5	<b>Energy, Economy and Heat Retention</b>	

#### 3.1 Safety in case of fire

##### 3.1.1 Reaction to fire

fischer FPC Panel Coating is classified 'F' in accordance with EN 13501-1.

##### 3.1.2 Resistance to fire

fischer FPC Panel Coating has been tested in accordance with BS EN 1366-3: 2009 based upon the test results and the field of direct application specified within EN 1366-3: 2009, the fischer FPC Panel Coating has been classified in accordance with EN 13501-2, as given in Annex C:

The seals may only be penetrated by the services described in Annex C; other parts or support constructions must not penetrate the seal.

The service support construction must be fixed to the building element containing the penetration seal or a suitable adjacent building element, in such a manner that in the case of fire, no additional load is imposed on the seal. Furthermore, it is assumed that the unexposed face support is maintained for the required period of fire resistance.

Pipes must be perpendicular to the seal surface.

It is assumed that compressed air systems are switched off by other means in the case of fire.

The function of the pipe seal in case of pneumatic dispatch systems, pressurised air systems etc. is guaranteed only when the systems are shut off in case of fire.

The assessment does not cover the avoidance of destruction of the seal or of the abutting building element(s) by forces caused by temperature changes in case of fire. This has to be considered when designing the piping system.

The assessment I does not address any risks associated with leakage of dangerous liquids or gases caused by failure of the pipe(s) in case of fire.

The durability assessment does not take account of the possible effect of substances permeating through the pipe on the penetration seal.

## **3.2 Hygiene, Health, and the environment.**

### **3.2.2. Content and release of Dangerous Substances**

The applicant has presented a declaration that fischer FPC Panel Coating does not contain any substance of high concern with regards to REACH Regulations and are compliant with the requirements reference to <http://ec.europa.eu/enterprise/construction/cpd-ds/index.cfm>

Confirmation has further been declared that all dangerous chemical substances  $\geq 1.0$  % w/w as well as all toxic, carcinogenic, toxic for reproduction and mutagenic chemical substances  $\geq 0.1$  % w/w (Status: 29. adaption – 2004/73/EG – of the EU directive 67/548/EEC - classification, packaging and labelling of dangerous substances) are stated in the fischer FPC Panel Coating safety data sheets (according to 91/155/EEC including amendments) and have been considered for the classification of the products according to the directive 1999/45/EG (classification of preparations, including amendments).

All dangerous chemical substances are below the classification limits of 67/548/EEC.

In addition to the specific clauses relating to dangerous substances contained in this European technical approval, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations, and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

## **3.1 Safety and accessibility in use**

### **3.1.1 Safety and Durability**

fischer FPC Panel Coating has been tested in accordance with EOTA Technical Report - TR024 – Edition November 2006, for the type Z<sub>1</sub> use category specified in EAD 350454-00-1104 Fire Stopping and fire sealing products – Penetration Seals and the results of the tests have demonstrated suitability for penetration seals intended for use in internal conditions with humidity equal to or higher than 85% RH excluding temperatures below 0°C, without exposure to rain or UV.

#### **4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base**

According to the decision 1999/454/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to the Regulation (EU) No 305/2011) given in the following table apply:

<b>Products</b>	<b>Intended uses</b>	<b>AVCP System</b>
Fire stopping and fire sealing products	For fire compartmentation and / or fire protection or fire performance	System 1

## **Annex A**

### **Reference Documents**

EN 13501-1	Fire classification of construction products and building elements – Part 1: Classification using test data from reaction to fire tests
EN 13501-2	Fire classification of construction products and building elements – Part 2: Classification using test data from fire resistance tests
EOTA TR 024	Characterisation, Aspects of Durability and Factory Production Control for Reactive Materials, Components and Products

## **Annex B**

### **Description of Product and Product Literature fischer FPC Panel**

#### **Coating**

A detailed specification of the product is contained in document "Evaluation Report" relating to the European Technical Assessment ETA – 14/0382 issued on 7/10/14 of fischer FPC Panel Coating which is a non-public part of this ETA.



## Annex C


### Resistance to Fire Classification of System fischer FPC Panel Coating

#### C.1.1 Flexible and Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm

#### C.1.2 Penetration seal with fischer FPC Panel Coating installed centrally within the wall

**Construction details:**

- Continuous/sustained insulated metallic pipes installed at any position within the wall (min. separation 50 mm from seal edges).
- Double layer of fischer FPC Panel Coating installed centrally within the wall.
- Max. Aperture size 730 mm wide x 1200 mm high

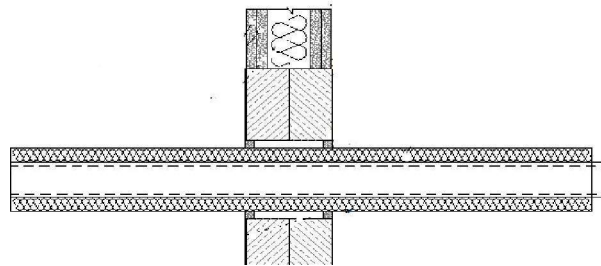


#### C.1.3

Service(s)	Insulation	Seal	Classification
<b>Mild Steel or Copper</b>			
40 mm diameter and 1.5 – 14.2 mm wall	20 mm thick foil faced glass wool insulation (min 80Kg/m <sup>3</sup> )	15 mm deep x 15 mm wide annulus fischer FIGM PFS+ Intumescent Graphite Sealant to both faces seal	<b>EI 60 U/C</b>
40-159 mm diameter and 2.3 – 14.2 mm wall	30 mm thick foil faced glass wool insulation (min 80Kg/m <sup>3</sup> )		<b>E 60 U/C EI 45 U/C</b>
Service(s)	Insulation	Seal	Classification
<b>Mild Steel</b>			
40 mm diameter and 1.7 – 14.2 mm wall	20 mm thick foil faced glass wool insulation (min 80Kg/m <sup>3</sup> )	15 mm deep x 15 mm wide annulus fischer FIGM PFS+ Intumescent Graphite Sealant to both faces of the seal	<b>EI60 U/C</b>
40-150 mm diameter and 2.3 – 14.2 mm wall	30 mm thick foil faced glass wool insulation (min 80Kg/m <sup>3</sup> )		

## C2.1 Flexible and Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm

### C.2.2 Penetration seal with System fischer FPC Panel Coating installed centrally within the wall

- Cables fitted at any position within the aperture (min. 50mm from edge seal)
- Double layer of system fischer FPC Panel Coating installed centrally within the wall.
- Max. Aperture size 730 mm wide x 1200 mm high

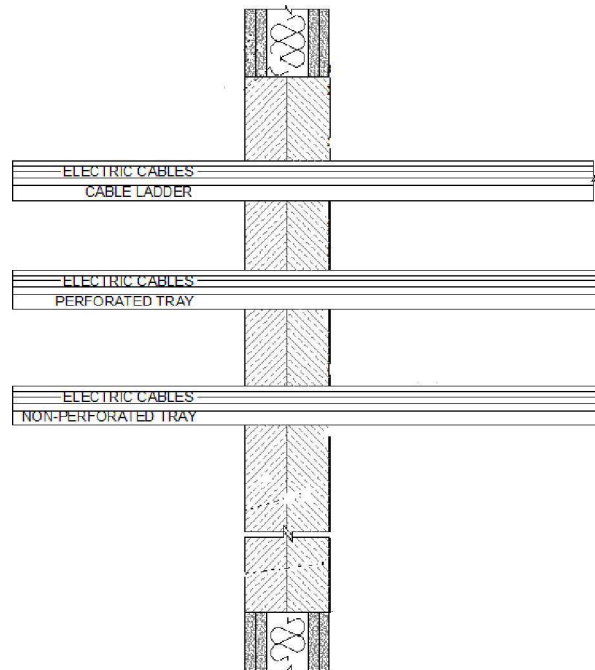

### C.2.3

Service(s)	Classification
Electrical cables up to 21 mm dia	EI 60
Electrical cables 22mm to 80mm dia	E 60, EI 30
Cable Trays and Ladders	EI 60
100 mm diameter bundle telecommunication cable type "F"	EI 60
Unsheathed electrical cables up to 17 mm dia	E 60, EI 15
Unsheathed electrical cables 18-24 mm dia	E 60, EI 30
Steel or Copper Conduits up to 16 mm	E 60, EI 15
Plastic conduits up to 16 mm	EI 60