



## **DECLARACIÓN DE PRESTACIONES**

#### **DoP 0270**

para el anclaje para hormigón celular fischer FPX-l (Anclaje de expansión metálico de uso en hormigón celular)

DoP 0270

ES

1. Código de identificación única del producto tipo:

2. <u>Usos previstos:</u> Fijación a posteriori para usar en placas armadas fisuradas o no, o en elementos de albañilería de

hormigón celular., véase el apéndice, especialmente los anexos B1 - B5.

3. Fabricante: fischerwerke GmbH & Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Alemania

Representante autorizado:

 Sistemas de evaluación y verificación de la constancia de las prestaciones (EVCP):

6. Documento de evaluación europeo: EAD 330014-00-0601
Evaluación técnica europea: ETA-12/0456; 2019-07-19

Organismo de evaluación técnica: DIBt- Deutsches Institut für Bautechnik

Organismos notificados: 2873 TU Darmstadt

7. Prestaciones declaradas:

Resistencia mecánica y estabilidad (BWR 1)

Resistencia en cualquier dirección de carga sin brazo de palanca: Anexo C1

Resistencia bajo carga a cortante con brazo de palanca: Anexo C1

Distancia entre anclajes, distancia al borde y espesor del elemento constructivo: Anexos B3, B4, C1

Desplazamientos: Anexo C2 Durabilidad: Anexo B1

Seguridad en caso de incendio (BWR 2)

Reacción al fuego: Clase A1

Resistencia al fuego en cualquier dirección de carga sin brazo de palanca: Anexo C2

Resistencia al fuego bajo carga a cortante con brazo de palanca: NPD

Distancia entre anclajes y distancia al borde para resistencia al fuego: Anexo C2

 Documentación técnica adecuada o documentación técnica específica:

Las prestaciones del producto identificado anteriormente son conformes con el conjunto de prestaciones declaradas. La presente declaración de prestaciones se emite, de conformidad con el Reglamento (UE) no 305/2011, bajo la sola responsabilidad del fabricante arriba identificado.

Firmado por y en nombre del fabricante por:

Dr.-Ing. Oliver Geibig, Director General Unidades de Negocio e Ingeniería

Tumlingen, 2021-01-15

Jürgen Grün, Director General de Química y Calidad

Esta DdR se ha preparado en distintos idiomas. En caso de que haya alguna controversia sobre la interpretación prevalecerá siempre la versión inglesa.

El Apéndice incluye información voluntaria y complementaria en idioma inglés que excede los requisitos legales (de idioma neutral).

Fischer DATA DOP\_ECs\_V39.xlsm 1/1

### **Specific Part**

### 1 Technical description of the product

The fischer aircrete anchor FPX-I is a deformation controlled expansion anchor made of galvanised steel. The anchor consists of an internal threaded socket, a cone bolt and an expansion sleeve. The anchor transfers loads into autoclaved aerated concrete via mechanical interlock

The anchor is set into a predrilled bore hole and anchored with a hexagon installation tool until the installation tool is pushed out of the internal hexagon socket. The fixture is installed with a screw-in part (threaded rods or screw).

The product description is given in Annex A.

# 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

## 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Resistance in any load direction without lever arm	See Annex C 1
Resistance in any load direction with lever arm	See Annex C 1
Spacing, edge distance, member thickness	See Annex B 3 and B 4
Displacements	See Annex C 2
Durability	Durability is ensured if the specifications of intended use according to Annex B are taken into account.

## 3.2 Safety in case of fire (BWR 2)


Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 2

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base


In accordance with European Assessment Document EAD No. 330014-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1


## **Product description**

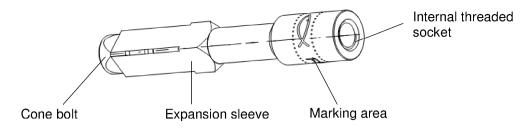

## **Product installed**

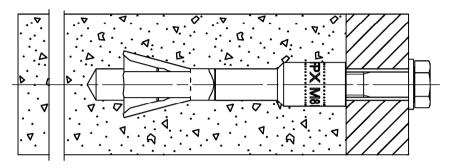


## **Product label**



## **Product dimensions**

Table A1.1: Dimension [mm]

Anchor type				F	PX-I	
Internal thread			М6	М8	M10	M12
Anchor length	L	=	75			
Diameter head internal threaded socket	ØD	=	14 16			
Diameter cone bolt	Ø d <sub>c</sub>	=	11			



## fischer aircrete anchor FPX-I

## **Product description**

Description, label and dimension

Annex A 1

Appendix 3 / 10

Specifications of intended use							
fischer aircrete anchor FPX-I	M6	M8	M10	M12			
Galvanized steel							
Static and quasi-static loads							
Cracked and uncracked Autoclaved Aerated Concrete (AAC)							
Fire exposure in reinforced slabs according to EN 12602:2016 of			(				
strength class $f_{AAC} \ge 3.3 \text{ N/mm}^2$ with dry density $\rho_m \ge 0.50 \text{ kg/dm}^3$ and strength class $f_{AAC} \ge 4.4 \text{ N/mm}^2$ with dry density $\rho_m \ge 0.55 \text{ kg/dm}^3$							

#### Base material:

- Cracked reinforced slabs (uncracked slabs are included) according to EN 12602:2016 of strength class f<sub>AAC</sub> ≥ 3,3 N/mm² with dry density ρ<sub>m</sub> ≥ 0,50 kg/dm³ and strength class f<sub>AAC</sub> ≥ 4,4 N/mm² with dry density ρ<sub>m</sub> ≥ 0,55 kg/dm³
- Uncracked reinforced slabs according to EN 12602:2016 of strength class  $f_{AAC} \ge 1,6 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,25 \text{ kg/dm}^3$  and strength class  $f_{AAC} \ge 6,0 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,65 \text{ kg/dm}^3$
- Masonry units according to EN 771-4:2011+A1:2015 of strength class  $f_{AAC} \ge 1,6$  N/mm² with dry density  $\rho_m \ge 0,25$  kg/dm³ and strength class  $f_{AAC} \ge 6,0$  N/mm² with dry density  $\rho_m \ge 0,65$  kg/dm³
- The mortar strength class of the masonry has to be M 2,5 according to EN 998-2:2017 at minimum

## Use conditions (Environmental conditions):

Structures subject to dry internal conditions (FPX-I)

## Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete and masonry work
- Verifiable calculation notes and drawings are to be prepared taking account in the loads to be anchored. The position of the anchor is to be indicated on the design drawings
- · Design of fastenings according to TR 054, Design Method B.

## Table B1.1: Material

Designation	FPX-I
Cone bolt 1)	Steel EN 10263:2018
Expansion sleeve 1)	Steel EN 10277:2018
Internal threaded bolt 1)	Steel EN 10277:2018
Screw-in-parts <sup>1, 2)</sup>	Minimum steel strength class 4.8, DIN EN ISO 898-1:2013

<sup>&</sup>lt;sup>1)</sup> Galvanized according to EN ISO 4042:2018,  $\geq$  5  $\mu$ m


fischer aircrete anchor FPX-I	
Intended use	Annex B 1
Specifications	Appendix 4 / 10

<sup>&</sup>lt;sup>2)</sup> Screw-in parts (screws and threaded rods including nuts and washer) must comply with the specification in Annex C1.

Table B2.1	: Installation	parameters
------------	----------------	------------

C:						FP	Y-I		
Size					М6	М8	M10	M12	
Nominal drill hole diameter		$d_0$	=			10			
Maximum drill bit diameter		$d_{\text{cut}}$	≤		10,45				
Depth of drill hole to deepest point	with cleaning 1)	— h <sub>1</sub> ≥		[mm]		8	30		
Depth of anii hole to deepest point	without cleaning		[mm]	95					
Diameter of clearance hole in the fixture	e	$d_{f}$	≤		7	9	12	14	
Effective embedment depth		h <sub>ef</sub>	=			70			
Maximum fastening torque 2)		T <sub>max</sub>		[Nm]	3				
Screw-in depth internal thread		$I_{s,min}$	nin [mana]		6	8	10	12	
Screw-iii deptii iiiteriiai tiiread		I <sub>s,max</sub>		[mm]		1	5		

<sup>1)</sup> For member thickness h < 120 mm the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall  $^{2)}$  If the anchor cannot retain against the fixture no installation torque may be applied ( $T_{max} = 0 \text{ Nm}$ )

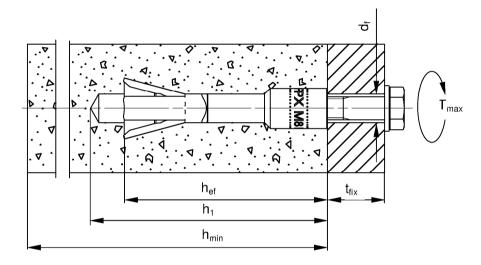

= Effective embedment depth h<sub>ef</sub>

= Thickness of fixture

= Depth of drill hole to deepest point  $h_{min}$  = Minimum thickness of AAC member

 $T_{max}$  = Maximum setting torque

= Diameter of clearance hole in the fixture

fischer	aircrete	anchor	FPX-I
11361161	ancicie	anchion	11 /

## Intended use

Installation parameters

Annex B 2

Appendix 5 / 10

Table B3.1: Minimum member thickness, minimum spacing and edge distance in AAC - slabs


Size				FP	X-I	_		
Size				М6	М8	M10	M12	
Minimum thickness of AAC - slab	with cleaning 1)	_ h		100				
Willimidili Unickliess of AAC - Slab	without cleaning	— h <sub>min</sub>		120				
Minimum spacing	finimum spacing			100				
Minimum adda diatanaa	single anchor 2)	- C <sub>1</sub>	[mm]	125 <sup>5)</sup>				
Minimum edge distance	anchor groups 3)		[]	250				
Minimum edge distance, orthogonal to c <sub>1</sub>		$c_2$		1,5 x c <sub>1</sub>				
Minimum spacing between	single anchors			600				
willimidin spacing between	anchors groups 3) 4)	– a		750				


<sup>1)</sup> For member thickness h < 120 mm the drill dust has to be cleaned out of the hole and the depth of the drill hole has to be reduced to 80 mm in order to avoid damage on the opposite side of the slab

single anchors

4) If there is no (free) edge, or the edge distance is ≥ a, the spacing between anchor groups can be reduced to the spacing between single anchors

The edge distance of reinforced slabs with a width  $\leq$  700 mm has to be  $\geq$  150 mm

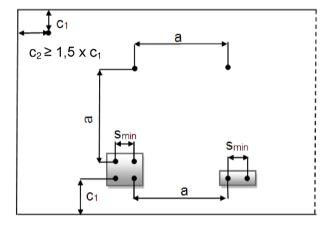



fier	hor	airc	roto	anc	hor	FPX-I
1131		a 11 C		all	III.	1 F A-1

#### Intended use

Minimum member thickness, minimum spacing and edge distance in AAC slabs

Annex B 3

Appendix 6 / 10

<sup>&</sup>lt;sup>2)</sup> Maximum 2 single anchors in the same formation as anchor groups. For 2 single anchors with spacing smaller than 600 mm  $(s_{min} \ge 100 \text{ mm})$  the same spacing in between and edge distances (a;  $c_1$ ) like for the anchor group are valid <sup>3)</sup> For exclusive tension loads the spacing and edge distances for groups can be reduced to the spacing and edge distances of

**Table B4.1:** Minimum member thickness, minimum spacing and edge distance in AAC - **masonry** 

Sino			FP	X-I				
Size		M6   M8   M10   M12						
Minimum thickness of AAC - with cleaning 1)		h			1(	00		
masonry	without cleaning	– h <sub>min</sub>		120				
Minimum spacing	g S <sub>min</sub> 10		100					
Minimum distance to non-filled join	its, single anchor	CF		0 <sup>5)</sup> / 75 <sup>6)</sup> / 125 <sup>7)</sup>				
Minimum edge distance	single anchor <sup>2)</sup>		[mm]	125				
willimum edge distance	anchor groups 3)	— c <sub>1</sub>		250				
Minimum edge distance, orthogonal to c₁		$c_2$		1,5 x c <sub>1</sub>				
Minimum spacing between	single anchors 2)			375				
I willimum spacing between	anchors groups 3) 4)	- a		750				

<sup>1)</sup> For member thickness h < 120 mm, the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall


<sup>3)</sup> For exclusive tension loads the spacing and edge distances of anchor groups can be reduced to the spacing and edge distances of single anchors

<sup>4)</sup> If there is no edge, or the edge distance is ≥ a, the spacing between anchor groups can be reduced to the spacing between single anchors

<sup>5)</sup> For joints completely filled with mortar and a joint width ≤ 12 mm and a compressive strength according to EN 998-2 ≥ f<sub>AAC</sub> AAC no distances to joints are required

6) c<sub>F</sub> for only tension and /or shear loads parallel to the joints which are not filled with mortar and a joint width ≤ 2 mm

 $^{7)}$  c<sub>F</sub> = c<sub>1</sub> for shear load or with a part of the load orthogonal to the joint which are not filled with mortar and a joint width  $\geq$  0 mm

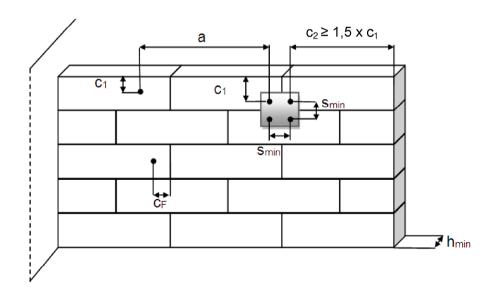

tioobor	aircrete	ODODOK	LDVI
115011111	anciele	ancinor	

#### Intended use

Minimum member thickness, minimum spacing and edge distance in AAC masonry


Annex B 4

Appendix 7 / 10


<sup>&</sup>lt;sup>2)</sup> Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than 375 mm (s<sub>min</sub> ≥ 100 mm) the same spacing in between and edge distances (a; c<sub>1</sub>) like for the anchor group are valid

## Installation instruction


- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- · Use of the anchor only as supplied by the manufacturer without exchanging the components of the anchor
- Checking before placing the anchor to ensure that the strength class of the aircrete in which the anchor is to be placed is in the range given and is not lower than that of the aircrete to which the characteristic loads apply
- Drill hole created perpendicular +/- 5° to AAC surface, positioning without damaging the reinforcement
- In case of aborted hole: New drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with non-shrinkage, high strength mortar (pressure strength ≥ 30 N/mm²) and if under shear or oblique tension load it is not the direction of the load application



1: Drill the hole. Other methods like punching, to make the hole, are allowed. When the AAC is covered with a hard layer like tiles, the tile has to be drilled with minimum diameter of the head of the internal threaded bolt ø D




2: Set the fastener until it is flush with the surface of the AAC




3: Turning the internal thread bolt with the hexagon (approximately 15 turnings are required)

Setting tool for FPX-I M6


Setting tool for FPX-I M8 - M12



4: By turning the internal thread bolt, the cone is driven into the expansion sleeve. When the optimal expansion is reached, the hexagon is thrown out of the socket. The turning of the internal thread bolt until the hexagon is thrown out of the socket is compulsory if tightening is impossible the anchor cannot be loaded



5a: Optional tightening the fastener with a torque  $T_{max} \le 3$  Nm. The anchor could be pulled against the fixture depending on the compressive strength of the AAC.



5b: If the anchor cannot support against the fixture (with cover layer) no installation torque may be applied  $(T_{max} = 0)$ 

## fischer aircrete anchor FPX-I

Intended use Installation instructions Annex B 5

Appendix 8 / 10

					FPX-I			
Size				М6	M8	M10	M12	
Single anchor in AAC - slabs 1)								
Characteristic resistance in cracked AAC -		$f_{AAC} \geq 3, 3, \; \rho_m$	≥ 0,50	1,5				
slabs	<sub>Rk</sub> [kN] —	$f_{AAC} \ge 4,4, \ \rho_m$	2,0					
Characteristic resistance in uncracked AAC -		$f_{AAC} \ge 3.3, \ \rho_m \ge 0.50$			2,0			
slabs		$f_{AAC} \ge 4,4, \ \rho_m$	3,0					
Partial safety factor for AAC - slabs		•	MAAC 2)		1,	73		
Single anchor in AAC - masonry 1)								
Observation in the manifest area in AAO (1997)		$f_{AAC} \ge 1.6,  \rho_{m} \ge 0.25$		0,9				
Characteristic resistance in AAC - masonry 3)	<sub>Rk</sub> [kN] —	$f_{AAC} \ge 2.0,  \rho_m$				,2		
Intermediate values by linear interpolation	Rk [KIN]	$f_{AAC} \ge 4.0, \ \rho_{m} \ge 0.50$		2,5				
		$f_{AAC} \ge 6.0, \ \rho_{m} \ge 0.65$		4,0				
Partial safety factor for AAC - masonry		2	/MAAC 2)		2	,0		
Single anchor in AAC - slabs and AAC - mason	ry <sup>1)</sup>							
Characteristic handing registance with		4.8	6	15	30	52		
Characteristic bending resistance with lever arm in combination with screw / ISO threaded rod complying with:	-1: 2013	M <sub>Rk,s</sub> [Nm] -	5.8	8	19	37	65	
			6.8	9	23	44	78	
			8.8	12	30	60	105	
Partial safety factor for steel failure			γMs			25		
Anchor groups in cracked and uncracked AAC	- slabs a	nd AAC - mas	sonry w	with $n = 2$	2  to n = 4	anchor	s <sup>3)</sup>	
Characteristic resistance for $n = 2$ , $n = 4^{4}$ $s_{min} \ge 100$ mm, $c_1 \ge 250$ mm $s_{min}^{5}$		$F_{Rk,r}$			2 x	$F_Rk$		
Characteristic resistance for $n \ge 3$ $c_{min} \ge 140$ mm, $c_{min, anchor group} \ge 700$ mm $^{5)}$		¹ Rk,r	[kN]		n x	$F_Rk$		
Characteristic resistance redundancy when the joints are not visible 5)		F <sub>Rk,n,Redundancy</sub>			0,5 x	$F_{Rk,n}$		
Partial safety factor for AAC - slabs		γ	MAAC 2)			73		
Partial safety factor for AAC - masonry			MAAC 2)		2	,0		

<sup>(</sup>s<sub>min</sub> ≥ 100 mm) the characteristic resistance of the anchor group is decisive

The characteristic strength class  $f_{AAC}$  [N/mm²] and the characteristic dry density  $\rho_m$  [kg/dm³] have to comply with EN 771-4:2011+A1:2015 for AAC - masonry and EN 12602:2016 for AAC - slabs

fischer aircrete anchor FPX-I	
Performances	Annex C 1
Characteristic resistance for all load directions	Appendix 9 / 10

The installation safety factor  $\gamma_2 = 1,0$  is included 3) The evaluation of  $N_{Rk,pb}$  according to TR 054, Section 4.2.1.5 is necessary. The smaller value of  $N_{Rk,pb}$  and  $F_{Rk}$  is decisive 4) Rectangular arrangement according to Graning Annex B3 and B4

<sup>&</sup>lt;sup>5)</sup> Only for multiple use according to EAD 330747-00-0601

Table C2.1: Characteristic resistance for each anchor under fire exposure for all load directions

Size			FPX-I				
Size				М6	М8	M10	M12
Characteristic resistance for cracked <b>slabs</b> of strength class $f_{AAC} \ge 3,3$ , $\rho_m \ge 0,50$		R30		0,4			
	$F_{Rk,fi}$	R60	- [kN] -	0,4			
		R90		0	,3	0	,4
		R120		0,3			
Characteristic resistance for cracked <b>slabs</b> of strength class $f_{AAC} \ge 4,4$ , $\rho_m \ge 0,55$		R30		0,5			
	$F_{Rk,fi}$	R60	[kN]	0,4		,5	
		R90		0,3		0,5	
		R120		0	,3	0,4	
Minimum spacing	Smin,fi		[mm]	100			
Minimum edge distance	Cmin,fi		[mm]	$c_{min,fi} = 140$ for fire exposure from more than one side $c_{min,fi} \ge 300$ mm			an

It must be ensured that local spalling of the autoclaved aerated concrete cover does not occur.

Table C2.2: Displacement under tension loads, shear loads and oblique loads in AAC 1)

Size	FPX-I M6   M8   M10   M12			
Displacement tension load in <b>cracked</b> AAC for all AAC strength classes	<u>δνο</u> δν∞	1,0		
Displacement tension load in <b>uncracked</b> AAC for all AAC strength classes	<u>δνο</u> δ <sub>ν∞</sub>	1,0 1,0		
Displacement shear load in <b>cracked and uncracked</b> AAC $f_{AAC} = 1,6 - \rho_m \ge 0,25^{-2}$	$\frac{\delta_{V0}}{\delta_{V\infty}}$ [mm]	2,5 3,7		
Displacement shear load in <b>cracked and uncracked</b> AAC $f_{AAC} \ge 6.0 - \rho_m \ge 0.65^{2}$	<u>δνο</u> δν∞	5,0 7,3		

fischer aircrete anchor FPX-I	
Performances Characteristic resistance of a fixing point under fire exposure for all load directions Displacements under tension, shear loads and oblique loads	

 $<sup>^{1)}</sup>$  Displacement at service load level F<sub>Rk</sub>/ ( $\gamma_{MAAC}$  x 1,4)  $^{2)}$  Intermediate values by linear interpolation, taking in account the AAC strength