

**DECLARACIÓN DE PRESTACIONES****DoP 0325**

para fischer TermoZ PN 8 (Anclajes de plástico para el uso en hormigón y mampostería)

ES

1. <u>Código de identificación única del producto tipo:</u>	<b>DoP 0325</b>
2. <u>Usos previstos:</u>	Anclaje de plástico clavado para la fijación de sistemas compuestos de aislamiento térmico exterior (ETICS) con revoque en hormigón y mampostería, Véase el apéndice, especialmente los anexos B1-B3.
3. <u>Fabricante:</u>	<b>fischerwerke GmbH &amp; Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Alemania</b>
4. <u>Representante autorizado:</u>	-
5. <u>Sistemas de evaluación y verificación de la constancia de las prestaciones (EVCP):</u>	<b>2+</b>
6. <u>Documento de evaluación europeo:</u> Evaluación técnica europea: Organismo de evaluación técnica: Organismos notificados:	<b>EAD 330196-01-0604, Edition 10/2017 ETA-09/0171; 2022-10-18 DIBt- Deutsches Institut für Bautechnik 2873 TU Darmstadt</b>
7. <u>Prestaciones declaradas:</u> <b>Seguridad en uso (BWR 4)</b> Capacidad de carga característica:	Resistencia característica bajo carga de tensión: <b>Anexo C1</b> Distancia mínima al borde: <b>Anexo B2</b> Espacio mínimo: <b>Anexo B2</b>
Desplazamientos:	Carga de tensión con factor parcial: <b>Anexo C2</b> Desplazamientos: <b>Anexo C2</b>
Rigidez de la placa:	Diámetro de la placa de anclaje: <b>Anexo C2</b> Resistencia a la carga de la placa de anclaje: <b>Anexo C2</b> Rigidez de la placa: <b>Anexo C2</b>
<b>Economía de energía y retención de calor (BWR 6)</b> Transmitancia térmica:	Transmitancia térmica puntual de un anclaje: <b>Anexo C2</b> Espesor de la capa aislante del ETICS: <b>Anexo C2</b>
8. <u>Documentación técnica adecuada o documentación técnica específica:</u>	-

Las prestaciones del producto identificado anteriormente son conformes con el conjunto de prestaciones declaradas. La presente declaración de prestaciones se emite, de conformidad con el Reglamento (UE) no 305/2011, bajo la sola responsabilidad del fabricante arriba identificado.

Firmado por y en nombre del fabricante por:

Dr.-Ing. Oliver Geibig, Director General Unidades de Negocio e Ingeniería  
Tumlingen, 2022-11-14

Jürgen Grün, Director General de Química y Calidad

Esta DdR se ha preparado en distintos idiomas. En caso de que haya alguna controversia sobre la interpretación prevalecerá siempre la versión inglesa.

El Apéndice incluye información voluntaria y complementaria en idioma inglés que excede los requisitos legales (de idioma neutral).

## **Specific part**

### **1 Technical description of the product**

The fischer nailed-in anchor TermoZ PN 8 consists of a plastic sleeve made of polypropylene, a plate and an accompanying specific nail made of glass fibre reinforced polyamide.

The anchor may in addition be combined with the anchor plates DT 90, DT 110 and DT 140.

The Product description is given in Annex A.

### **2 Specification of the intended use in accordance with the applicable European Assessment Document**

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### **3 Performance of the product and references to the methods used for its assessment**

#### **3.1 Safety and accessibility in use (BWR 4)**

<b>Essential characteristic</b>	<b>Performance</b>
Characteristic load bearing capacity <ul style="list-style-type: none"><li>- Characteristic resistance under tension load</li><li>- Minimum edge distance and spacing</li></ul>	See Annex C 1 See Annex B 2
Displacements	See Annex C 2
Plate stiffness	See Annex C 2

#### **3.2 Energy economy and heat retention (BWR 6)**


<b>Essential characteristic</b>	<b>Performance</b>
Point thermal transmittance	See Annex C 2

### **4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with EAD No. 330196-01-0604, the applicable European legal act is: [97/463/EC].

The system to be applied is: 2+

# TermoZ PN 8

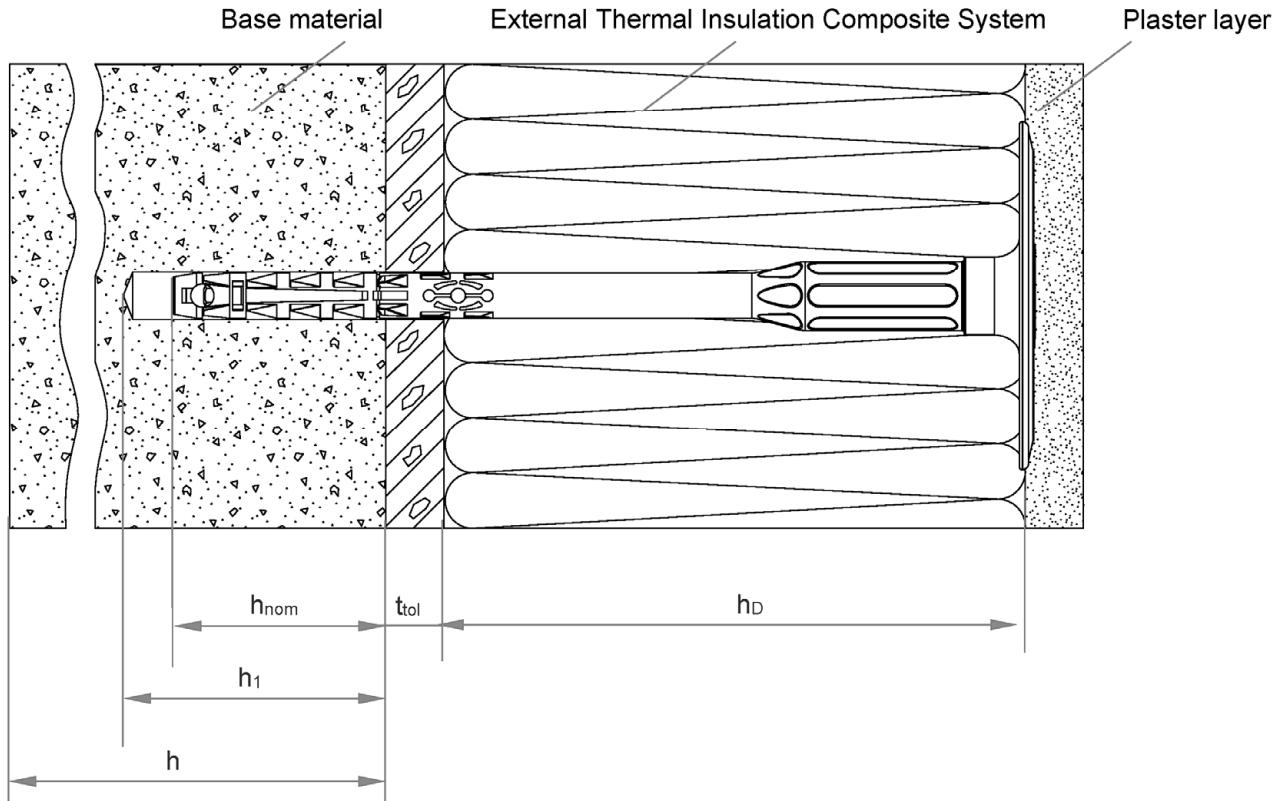

## Legend

- $h_{\text{nom}}$  = Overall plastic anchor embedment depth in the base material  
 $h_1$  = Depth of drilled hole to deepest point  
 $h$  = Thickness of member (wall)  
 $h_D$  = Thickness of insulation material  
 $t_{\text{tol}}$  = Thickness of equalising layer and / or non-load bearing coating

Figure not to scale


**fischer TermoZ PN 8**

**Product description**  
Installed anchor

**Annex A 1**

Appendix 2 / 9

# TermoZ PN 8

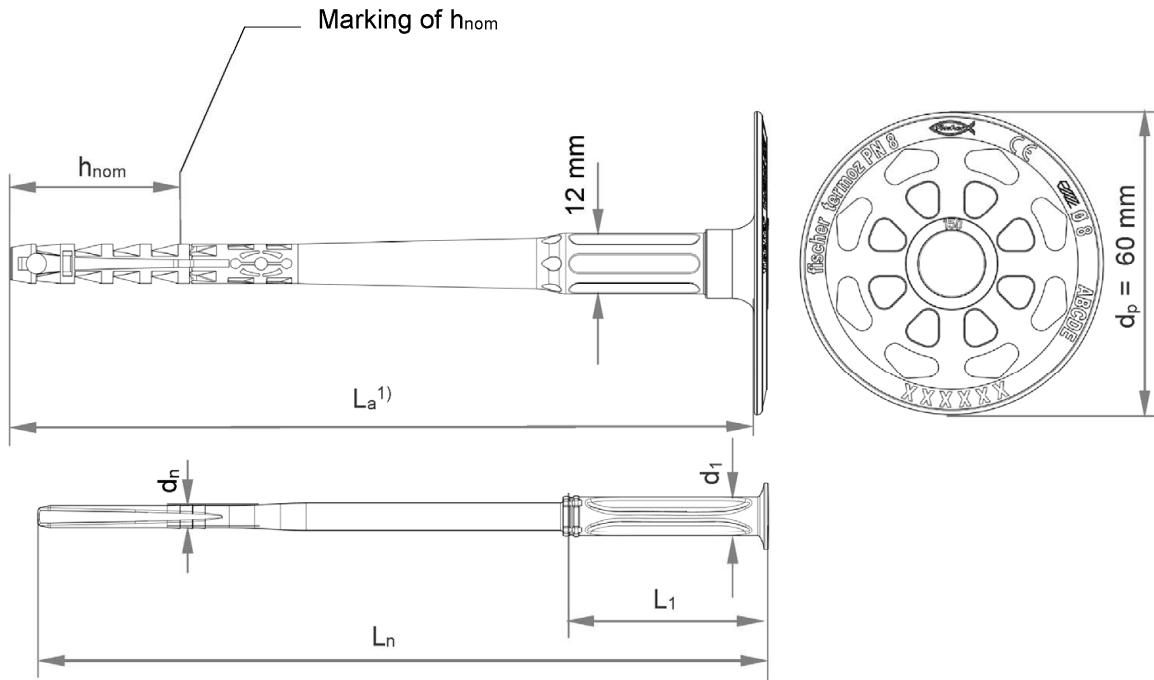

<sup>1)</sup> Various length of the anchors are possible.

TermoZ PN 8 :

$L_a \text{ min} \geq 110 \text{ mm}; L_a \text{ max} \leq 230 \text{ mm}$

$L_a = \text{length of accompanying specific nail } L_n + 5 \text{ mm}$

**Table A2.1: Dimensions**

Anchor type <sup>ep</sup>	Anchor sleeve		Accompanying specific plastic nail		
	$d_d$ [mm]	$h_{\text{nom}}$ [mm]	$d_n$ [mm]	$L_1$ [mm]	$d_1$ [mm]
TermoZ PN 8	8	35/55 <sup>2)</sup>	4,4	40	8

<sup>2)</sup> Only for base material group „D“ and „E“.

Determination of max. thickness of insulation:

$$\text{max. } h_D = L_a - h_{\text{nom}} - t_{\text{tol}}$$

e.g. for TermoZ PN 8x150:

$L_a = 148 \text{ mm}, h_{\text{nom}} = 35 \text{ mm}, t_{\text{tol}} = 10 \text{ mm}$

$$\begin{aligned} \text{max } h_D &= 148 - 35 - 10 = 103 \text{ mm} \\ \text{recommended } h_D &= 100 \text{ mm} \end{aligned}$$

Figures not to scale

**fischer TermoZ PN 8**

**Product description**



Dimensions

**Annex A 2**

Appendix 3 / 9

**Table A3.1: Material**

<b>Designation</b>	<b>Material</b>
Anchor sleeve	PP, colour: grey
Specific plastic nail	PA6 GF, colour: nature
Anchor plate / Slip-on plate	PA6, GF colour: grey, orange, red, green, yellow, blue, mocca-latte, black

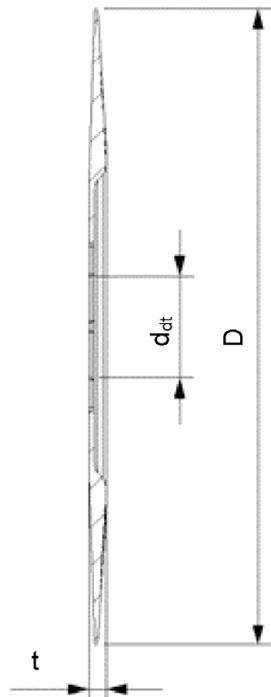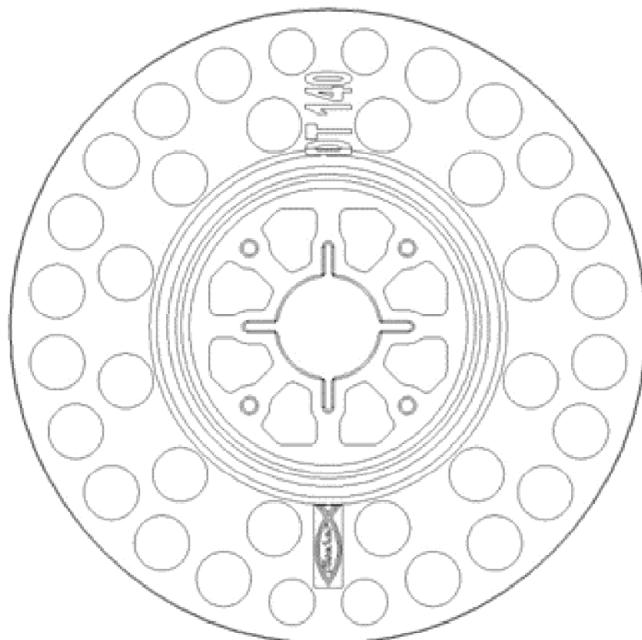**Drawing of the slip-on-plate (e.g. DT 140)****Table A3.2: Slip-on plate, dimensions and material**

<b>Slip-on plate</b>	<b>D [mm]</b>	<b>d<sub>dt</sub> [mm]</b>	<b>t [mm]</b>
DT 90 / 110 / 140	90 / 110 / 140	22,5	3,9

Figures not to scale

**fischer TermoZ PN 8****Product description**

Material

Dimensions of slip-on plate for the combination with TermoZ PN 8

**Annex A 3**

Appendix 4 / 9

## Specifications of intended use

### Anchorage subject to:

- The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the external thermal insulation composite system (ETICS).

### Base materials:

- Compacted normal weight concrete without fibres, strength classes  $\geq$  C12/15 (base material group "A"), in accordance with EN 206, see Annex C1.
- Solid brick masonry (base material group "B") as per EN 771-1, EN 771-2 or EN 771-3, see Annex C1.
- Hollow brick masonry (base material group "C"), as per EN 771-1, EN 771-2 or EN 771-3, see Annex C1.
- Prefabricated reinforced components of lightweight aggregate concrete with open structure (base material group "D") as per EN 1520, see Annex C1.
- Unreinforced autoclaved aerated concrete (base material group "E") as per EN 771-4 and reinforced autoclaved aerated concrete (base material group "E") as per EN 12602, see Annex C1.
- For other comparable base materials of the base material group "A", "B", "C", "D" and "E" the characteristic resistance of the anchor may be determined by job site tests in accordance with EOTA Technical Report TR 051.

### Temperature Range:

- 0 °C to + 40 °C (max. short term temperature + 40 °C and max. long term temperature + 24 °C) of the base material.

### Design:

- The anchorages are designed under the responsibility of an engineer experienced in anchorages and masonry work with the partial safety factors for material related resistances  $\gamma_M = 2,0$  and for action loads  $\gamma_F = 1,5$  in absence of other national regulations.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchors is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings of external thermal insulation composite system.

### Installation:

- Drilling method according to Annex C1.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on the site.
- Installation temperature from 0 °C to + 40 °C.
- Exposure to UV due to solar radiation of the anchor not protected by rendering  $\leq$  6 weeks.

fischer TermoZ PN 8

Intended use  
Specifications

Annex B 1

Appendix 5 / 9

**Table B2.1: Installation parameters for base material groups “A” concrete, “B” solid bricks, “C” hollow or perforated bricks, “D” lightweight aggregate concrete and “E” autoclaved aerated concrete**

Anchor type	TermoZ PN 8	
Nominal drill hole diameter	$d_0$	= [mm] 8
Cutting diameter of drill bit	$d_{cut}$	$\leq$ [mm] 8,45
Depth of drilled hole to deepest point	$h_1$	$\geq$ [mm] 45/65 <sup>1)</sup>
Overall plastic anchor embedment depth in the base material	$h_{nom}$	$\geq$ [mm] 35/55 <sup>1)</sup>

<sup>1)</sup> Only for base material group “D” and “E”.

**Table B2.2: Minimum thickness of member, edge distances and spacing in all regulated base material groups**

Anchor type	TermoZ PN 8	
Minimum thickness of member	$h_{min}$	= [mm] 100
Minimum spacing	$s_{min}$	= [mm] 100
Minimum edge distance	$c_{min}$	= [mm] 100

**Scheme of edge distances and spacing**  
for base material group “A”, concrete,  
group “B” solid bricks, group “C” hollow or  
perforated masonry, group “D” lightweight  
aggregate concrete, group “E” autoclaved  
aerated concrete

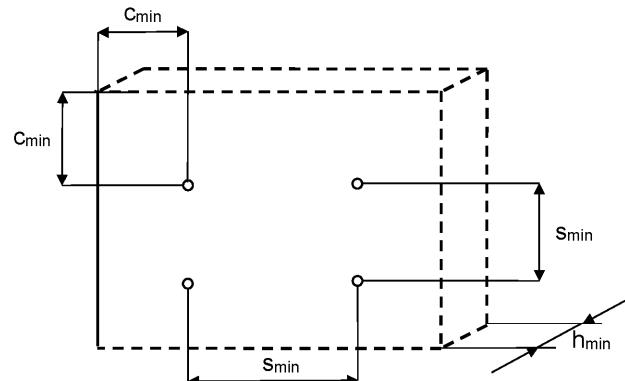


Figure not to scale

**fischer TermoZ PN 8**


**Intended use**

Installation parameters depending on the base material groups  
Minimum thickness of member, edge distances and spacings


**Annex B 2**

Appendix 6 / 9


## Installation instruction

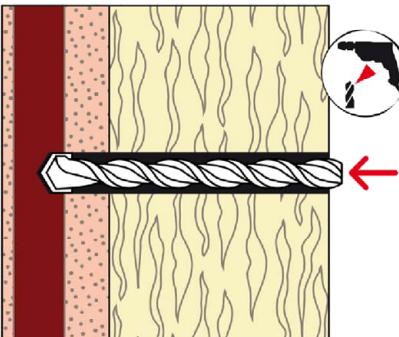


1. Drill hole by corresponding drilling method defined for each stone according to Table C1.1 and drill hole diameter  $d_0$  and depth  $h_1$  according to Table B2.1.

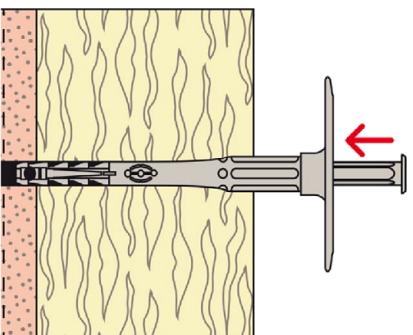

2. Insert anchor manually.

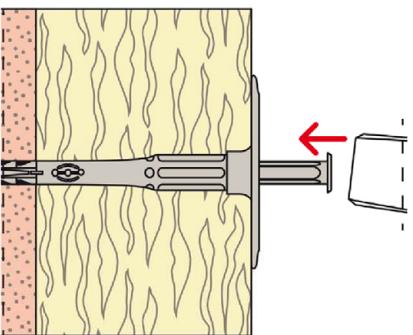

3. Set anchor by hammer blows.

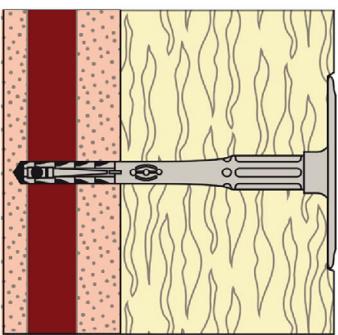

4. Correctly installed anchor.

**Table C1.1: Characteristic resistance  $N_{Rk}$  to tension loads for single anchor TermoZ PN 8**

Base material	Group	Bulk density $\rho$ [kg/dm <sup>3</sup> ]	Mean compressive strength / minimum compressive strength single brick as per EN 771 <sup>4)</sup> [N/mm <sup>2</sup> ]	Remarks	Drilling method <sup>1)</sup>	Characteristic resistance to tension loads $N_{Rk}$ [kN]
Concrete, C12/15 - C50/60 as per EN 206	A	-	-	-	H	<b>0,50</b>
Solid Clay bricks, Mz as per EN 771-1	B <sup>2)</sup>	$\geq 2,0$	15/12	-	H	<b>0,60</b>
Calcium silicate solid bricks, KS as per EN 771-2	B <sup>2)</sup>	$\geq 1,8$	15/12	-	H	<b>0,60</b>
Vertically perforated clay, HLz bricks as per EN 771-1	C <sup>3)</sup>	$\geq 1,0$	15/12	Exterior web thickness $\geq 12$ mm.	R	<b>0,40</b>
Hollow calcium silicate brick, KSL as per EN 771-2	C <sup>3)</sup>	$\geq 1,4$	15/12	Exterior web thickness $\geq 23$ mm.	H	<b>0,40</b>
Lightweight concrete hollow blocks, Hbl as per EN 771-3	C <sup>3)</sup>	$\geq 1,2$	12,5/10	Exterior web thickness $\geq 38$ mm.	H	<b>0,50</b>
Lightweight aggregate concrete, LAC as per EN 1520	D <sup>3)</sup>	$\geq 0,9$	5/4	Minimum thickness of brick $h = 100$ mm or minimum exterior web thickness $t = 50$ mm.	H	<b>0,30</b>
			7,5/6			<b>0,40</b>
Unreinforced autoclaved aerated concrete members, AAC as per EN 771-4	E	$\geq 0,5$	5/4	-	R	<b>0,30</b>
Reinforced autoclaved aerated concrete blocks, AAC as per EN 12602		$\geq 0,6$	7,5/6			<b>0,40</b>

<sup>1)</sup> H = Hammer drilling, R = Rotary drilling.

<sup>2)</sup> Vertically perforation  $\leq 15\%$ ; cross section reduced by perforation vertically to the resting area.

<sup>3)</sup> Vertically perforation  $> 15 \%$  and  $\leq 50 \%$ , cross section reduced by perforation vertically to the resting area.

<sup>4)</sup> The compressive strength of the single brick must not be less than 80% of the mean compressive strength.

**Table C2.1: Point thermal transmittance according to EOTA Technical Report TR 025**

Anchor type	Thickness of insulation material $h_D$ [mm]	Point thermal transmittance $\chi$ [W/K]
TermoZ PN 8	60 - 180	0,000

**Table C2.2: Plate stiffness according to EOTA Technical Report TR 026**

Anchor type	Maximum size of anchor plate $d_p$ [mm]	Load resistance of anchor plate [kN]	Plate stiffness $c$ [kN/mm]
TermoZ PN 8	60	1,7	0,6

**Table C2.3: Displacements TermoZ PN 8**

Base material	Mean compressive strength / minimum compressive strength single brick as per EN 771 <sup>1)</sup> [N/mm <sup>2</sup> ]	Tension load	Displacements
		N [kN]	$\Delta\delta_N$ [mm]
Concrete, C12/15 – C50/60 as per EN 206	-	0,15	0,20
Clay brick, Mz as per EN 771-1	15/12	0,20	0,20
Calcium silicate solid bricks, KS as per EN 771-2	15/12	0,20	0,30
Vertically perforated clay brick, Hz as per EN 771-1	15/12	0,15	0,40
Hollow calcium silicate brick, KSL as per EN 771-2	15/12	0,15	0,20
Hollow brick lightweight concrete, Hbl as per EN 771-3	12,5/10	0,15	0,20
Lightweight aggregate concrete, LAC as per EN 1520	5/4	0,10	0,20
	7,5/6	0,13	
Unreinforced autoclaved aerated concrete members, AAC as per EN 771-4 and reinforced autoclaved aerated concrete members, AAC as per EN 12602	5/4	0,10	0,10
	7,5/6	0,13	0,20

<sup>1)</sup> The compressive strength of the single brick must not be less than 80% of the mean compressive strength.

**fischer TermoZ PN 8**

**Performances**  
 Point thermal transmittance and plate stiffness  
 Displacements

**Annex C 2**

Appendix 9 / 9