DEKLARACJA WŁAŚCIWOŚCI UŻYTKOWYCH

DoP 0400

dla systemu wklejanego fischer FIS P Plus (Kotwa wklejana do stosowania w podłożu murowym) PL

1. Niepowtarzalny kod identyfikacyjny typu wyrobu: **DoP 0400**

2. Zamierzone zastosowanie: **Mocowanie wklejane w podłożu murowym, Zobacz załącznik, w szczególności aneksy B1 - B14.**

3. Producent: **fischerwerke GmbH & Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Niemcy**

4. Upoważniony przedstawiciel: **–**

5. System(-y) oceny i weryfikacji stałości właściwości użytkowych: **1**

6. Europejski dokument oceny: **EAD 330076-01-0604, Edition 10/2022**
   Europejska ocena techniczna: **ETA-11/0419; 2025-11-04**
   Jednostka ds. oceny technicznej: **DIBt- Deutsches Institut für Bautechnik**
   Jednostka lub jednostki notyfikowane: **2873 TU Darmstadt**

7. Deklarowane właściwości użytkowe:

Wytrzymałość mechaniczna i stabilność osadzenia (BWR 1)

Nośność charakterystyczna pod obciążeniem statycznym i quasi-statycznym:

1 Nośność charakterystyczna na zniszczenie stali pojedynczej kotwy przy obciążeniu rozciągającym: Zobacz załącznik, w szczególności aneksy C1, C3

2 Nośność charakterystyczna na zniszczenie stali pojedynczej kotwy przy obciążeniu ścinającym z ramieniem poziomującym i bez niego: Zobacz załącznik, w szczególności aneksy C2, C3

3 Nośność charakterystyczna na wyrwanie pojedynczej kotwy lub wyrwanie z cegły pod obciążeniem rozciągającym, współczynnik redukcyjny: Zobacz załącznik, w szczególności aneksy C5, C7, C9, C11, C13, C16, C18, C20, C22, C24, C27

4 Nośność charakterystyczna pojedynczej kotwy na miejscowe zniszczenie cegły lub wyrwanie cegły pod obciążeniem ścinającym: Zobacz załącznik, w szczególności aneksy C5, C7, C9, C11, C14, C16, C18, C20, C22, C24, C27

5 Nośność charakterystyczna grupy kotew na wyrwanie cegły przy obciążeniu rozciągającym: Zobacz załącznik, w szczególności aneksy B13,B14,C4,C6,C8,C10,C12,C15,C17,C19,C21,C23,C26

6 Nośność charakterystyczna grupy kotew na miejscowe zniszczenie cegły lub wyrwanie cegły pod obciążeniem ścinającym: Zobacz załącznik, w szczególności aneksy B13,B14,C4,C6,C8,C10,C12,C15,C17,C19,C21,C23,C26

7 Odległości od krawędzi, odległości osiowe, grubość powierzchni: Zobacz załącznik, w szczególności aneksy B13,B14,C4,C6,C8,C10,C12,C15,C17,C19,C21,C23,C25

8 Przemieszczenia pod obciążeniem rozciągającym i ścinającym: zobacz załącznik, w szczególności aneks C28

9 Maksymalny moment montażowy: Zobacz załącznik, w szczególności aneksy B4 - B6

Nośność charakterystyczna i przemieszczenia pod obciążeniem sejsmicznym:

10 Nośność na wyrywanie, zmiany: NPD

11 Nośność na ścinanie, zmiany: NPD

12 Współczynnik szczeliny pierścieniowej: NPD

Ochrona przeciwpożarowa (BWR 2)

13 Reakcja na ogień: Klasy (A1)

14 Odporność ogniowa pod obciążeniem rozciągającym i ścinającym z ramieniem poziomującym lub bez, minimalne odległości od krawędzi i odstępy: NPD

Higiena, zdrowie i środowisko (BWR 3)

15 Treść, emisja i / lub uwalnianie substancji niebezpiecznych: NPD

8. Odpowiednia dokumentacja techniczna lub specjalna dokumentacja techniczna: **–**

Właściwości użytkowe określonego powyżej wyrobu są zgodne z zestawem deklarowanych właściwości użytkowych. Niniejsza deklaracja właściwości użytkowych wydana zostaje zgodnie z rozporządzeniem (UE) nr 305/2011 na wyłączną odpowiedzialność producenta określonego powyżej.

W imieniu producenta podpisał(-a):

i.V.

Dr. Christian Weber, Dyrektor Zarządzający ds. Sprzedaży i Dyrektor Zarządzający ds. Badań i Rozwoju

Dieter Pfaff, Kierownik Międzynarodowej Federacji Produkcji i Zarządzania Jakością

Tumlingen, 2026-03-01

Niniejsza Deklaracja Właściwości Użytkowych została przygotowana w różnych językach. W razie wątpliwości w interpretacji, wersja angielska jest zawsze miarodajna.
Załącznik zawiera dobrowolne i uzupełniające informacje w języku angielskim (neutralne językowo), a wykraczające poza wymagania prawne.

Translation guidance Essential Characteristics and Performance Parameters for Annexes

Wytyczne dotyczące tłumaczenia zasadniczych właściwości oraz parametrów użytkowych dla załączników

Mechanical resistance and stability (BWR 1) **Wytrzymałość mechaniczna i stabilność osadzenia (BWR 1)**		
Characteristic resistance for static and quasi-static loading: **Nośność charakterystyczna pod obciążeniem statycznym i quasi-statycznym:**		
1	Characteristic resistance to steel failure of a single anchor under tension loading: **Nośność charakterystyczna na zniszczenie stali pojedynczej kotwy przy obciążeniu rozciągającym:**	$N_{Rk,s}$ [kN]
2	Characteristic resistance to steel failure of a single anchor under shear loading with and without level arm: **Nośność charakterystyczna na zniszczenie stali pojedynczej kotwy przy obciążeniu ścinającym z ramieniem poziomującym i bez niego:**	$V_{Rk,s}$ [kN], $M^0_{Rk,s}$ [Nm]
3	Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading, Reduction factor: **Nośność charakterystyczna na wyrwanie pojedynczej kotwy lub wyrwanie z cegły pod obciążeniem rozciągającym, współczynnik redukcyjny:**	$N_{Rk,p}$; $N_{Rk,b}$; [kN] $N_{Rk,p,c}$; $N_{Rk,b,c}$ [kN], β [-]
4	Characteristic resistance to local brick failure or brick breakout failure of a single anchor under shear loading: **Nośność charakterystyczna pojedynczej kotwy na miejscowe zniszczenie cegły lub wyrwanie cegły pod obciążeniem ścinającym:**	$V_{Rk,b}$; $V_{Rk,c,II}$; $V_{Rk,c,\perp}$ [kN]
5	Characteristic resistance to brick breakout failure of an anchor group under tension loading: **Nośność charakterystyczna grupy kotew na wyrwanie cegły przy obciążeniu rozciągającym:**	N^g_{Rk} [kN], $\alpha_{g,N}$ [-]
6	Characteristic resistance to local brick failure or brick breakout failure of an anchor group under shear loading: **Nośność charakterystyczna grupy kotew na miejscowe zniszczenie cegły lub wyrwanie cegły pod obciążeniem ścinającym:**	$V^g_{Rk,b}$; $V^g_{Rk,c,II}$; $V^g_{Rk,c,\perp}$ [kN]; $\alpha_{g,V,II}$; $\alpha_{g,V,\perp}$ [-]
7	Edge distances, spacing, member thickness: **Odległości od krawędzi, odległości osiowe, grubość powierzchni:**	c_{cr}; s_{cr}; c_{min}; $s_{min,II}$; $s_{min,\perp}$; h_{min} [mm]
8	Displacements under tension and shear loading: **Przemieszczenia pod obciążeniem rozciągającym i ścinającym:**	δ_{N0}; $\delta_{N\infty;}$ $\delta_{V0;}$ $\delta_{V\infty}$ [mm]
9	Maximum installation torque: **Maksymalny moment montażowy:**	max. T_{inst} [Nm]
Characteristic resistance and displacements for seismic loading: **Nośność charakterystyczna i przemieszczenia pod obciążeniem sejsmicznym:**		
10	Resistance to tension load, displacements: **Nośność na wyrywanie, zmiany:**	$N_{Rk,s,eq}$; $N_{Rk,eq}$ [kN], $\alpha_{N,seis}$ [-]; $\delta_{N,eq}$ [mm]
11	Resistance to shear load, displacements: **Nośność na ścinanie, zmiany:**	$V_{Rk,s,eq}$; $V_{Rk,b,eq}$ [kN], $\alpha_{V,seis}$ [-]; $\delta_{V,eq}$ [mm]
12	Factor annular gap: **Współczynnik szczeliny pierścieniowej:**	α_{gap} [-]
Safety in case of fire (BWR 2) **Ochrona przeciwpożarowa (BWR 2)**		
13	Reaction to fire: **Reakcja na ogień:**	-
14	Resistance to fire under tension and shear loading with and without level arm, minimum edge distances and spacing: **Odporność ogniowa pod obciążeniem rozciągającym i ścinającym z ramieniem poziomującym lub bez, minimalne odległości od krawędzi i odstępy:**	$N_{Rk,s,fi}$; $N_{Rk,p,fi}$; [kN], $N_{Rk,b,fi}$; $V_{Rk,s,fi}$ [kN], $M^0_{Rk,s}$ [Nm], $c_{cr,fi}$, $s_{cr,fi}$ [mm]
Hygiene, health and the environment (BWR 3) **Higiena, zdrowie i środowisko (BWR 3)**		
15	Content, emission and/or release of dangerous substances: **Treść, emisja i / lub uwalnianie substancji niebezpiecznych:**	-

Specific Part

1 Technical description of the product

The fischer injection system FIS P Plus for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar fischer FIS P Plus, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for static and quasi-static loading	See Annexes B4 to B6, B13, B14, C1 to C28
Characteristic resistance and displacements for seismic loading	No performance assessed

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire under tension and shear loading with and without lever arm. Minimum edge distances and spacing	No performance assessed

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base


In accordance with the European Assessment Document EAD 330076-01-0604 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1


Installation conditions part 1

Anchor rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned installation:

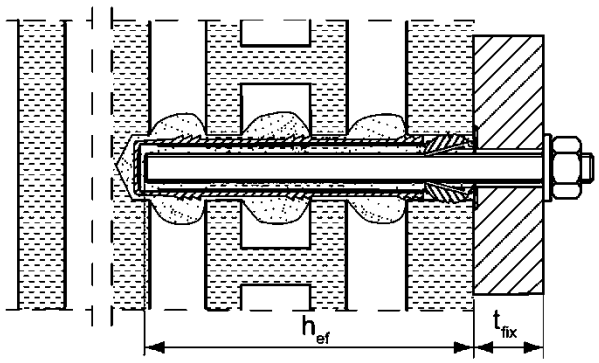


Installation with render bridge

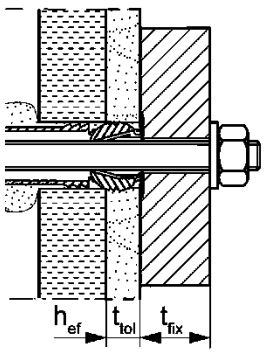

Size of the perforated sleeve: FIS H 12x50 K, FIS H 12x85 K, FIS H 16x85 K, FIS H 16x130 K, FIS H 20x85 K, FIS H 20x130 K, FIS H 20x200 K

Internal threaded anchor FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned installation:

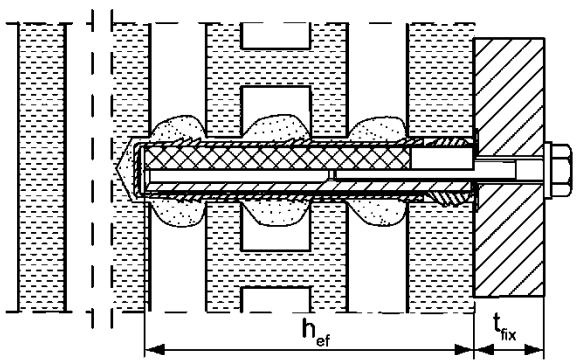

Figures not to scale

h_{ef} = effective anchorage depth


t_{tol} = thickness of unbearing layer (e.g. plaster)

t_{fix} = thickness of fixture


Installation conditions part 2


Anchor rods without perforated sleeve FIS H K;
installation in solid brick masonry and autoclaved aerated concrete

Pre-positioned installation:

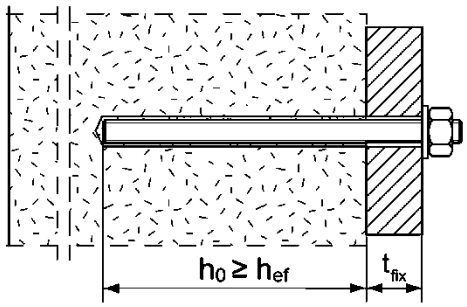

Push through installation: Annular gap filled with mortar







Installation with render bridge

Internal threaded anchors FIS E without perforated sleeve FIS H K;
installation in solid brick masonry and autoclaved aerated concrete

Pre-positioned installation:

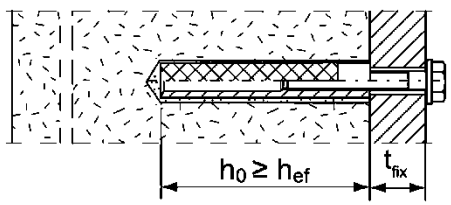

Installation with render bridge

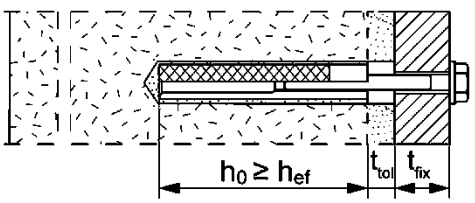

Figures not to scale

h_0 = depth of drill hole
h_{ef} = effective anchorage depth
t_{tol} = thickness of unbearing layer (e.g. plaster)
t_{fix} = thickness of fixture

fischer injection system FIS P Plus for masonry

Product description
Installation conditions part 2, Anchor rods and internal threaded anchor without perforated sleeve / with centring sleeve

Annex A2
Appendix 3 / 48

Overview system components part 1

Mortar cartridge (shuttle cartridge) with sealing cap

1

Size: 360 ml, 825 ml

Imprint: fischer FIS P Plus, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume




Mortar cartridge (coaxial cartridge) with sealing cap


1

Size: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml


Imprint: fischer FIS P Plus, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume

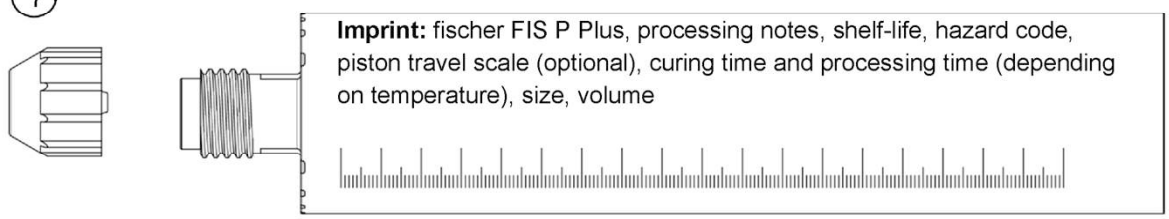

Static mixer FIS MR Plus for injection cartridges up to 410 ml




Static mixer FIS JMR for injection cartridges 825 ml



Extension tube Ø 9 for static mixer FIS MR Plus;
Extension tube Ø 9 or Ø 15 for static mixer FIS JMR



Cleaning brush BS



Blow-out pump ABG



compressed-air cleaning tool ABP



Figures not to scale


Overview system components part 2

fischer anchor rod

(2) 

Size: M6, M8, M10, M12, M16

Internal threaded anchor FIS E

(5) 

Size: 11x85 M6 / M8
15x85 M10 / M12

Perforated sleeve FIS H K


(7) 

Size: FIS H 12x50 K
FIS H 12x85 K
FIS H 16x85 K
FIS H 20x85 K

(7) 

Size: FIS H 16x130 K
FIS H 20x130 K
FIS H 20x200 K

Washer

(3) 

Hexagon nut

(4) 

Figures not to scale

Table A5.1: Materials

Part	Designation	Material		
1	Mortar cartridge	Mortar, hardener; filler		
		Steel	Stainless steel R	High corrosion resistant steel HCR
		zinc plated	acc. to EN 10088-1:2023 Corrosion resistance class CRC III acc. to EN 1993-1-4:2006+A1:2015	acc. to EN 10088-1:2023 Corrosion resistance class CRC V acc. to EN 1993-1-4:2006+A1:2015
2	Anchor rod	Property class 4.6; 4.8; 5.8 or 8.8; EN ISO 898-1: 2013 zinc plated ≥ 5µm, ISO 4042:2022 or hot-dip galvanised EN ISO 10684:2004+AC:2009 $f_{uk} \leq 1000$ N/mm² $A_5 > 8\%$ fracture elongation	Property class 50, 70 or 80 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062; 1.4662; 1.4462; EN 10088-1:2023 $f_{uk} \leq 1000$ N/mm² $A_5 > 8\%$ fracture elongation	Property class 50 or 80 EN ISO 3506-1:2020 or property class 70 with f_{yk}= 560 N/mm² 1.4565; 1.4529 EN 10088-1:2023 $f_{uk} \leq 1000$ N/mm² $A_5 > 8\%$ fracture elongation
3	Washer ISO 7089:2000	zinc plated ≥ 5µm, ISO 4042:2022 or hot-dip galvanised EN ISO 10684:2004+AC:2009	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2023	1.4565;1.4529 EN 10088-1:2023
4	Hexagon nut	Property class 5 or 8; EN ISO 898-2:2022 zinc plated ≥ 5µm, ISO 4042:2022 or hot-dip galvanised EN ISO 10684:2004+AC:2009	Property class 50, 70 or 80 EN ISO 3506-2:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2023	Property class 50, 70 or 80 EN ISO 3506-2:2020 1.4565; 1.4529 EN 10088-1:2023
5	Internal threaded anchor FIS E	Property class 5.8; EN ISO 898-1:2013 zinc plated ≥ 5µm, ISO 4042:2022	Property class 70 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2023	Property class 70 EN ISO 3506-1:2020 1.4565; 1.4529 EN 10088-1:2023
6	Commercial standard screw or threaded rod for internal threaded anchor FIS E	Property class 4.6, 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5µm, ISO 4042:2022	Property class 70 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2023	Property class 70 EN ISO 3506-1:2020 1.4565; 1.4529 EN 10088-1:2023
7	Perforated sleeve	PP		

Specifications of intended use part 1

Table B1.1: Overview use and performance categories

Anchorages subject to		fischer injection system fischer FIS P Plus for masonry	
Hole drilling with hammer drill mode		all bricks	
Hole drilling with rotary drill mode		all bricks	
Static and quasi static load, in masonry		all bricks	
Installation	Pre-positioned installation	Anchor rod or internal threaded anchor (in solid brick masonry and autoclaved aerated concrete)	Perforated sleeve with anchor rod or internal threaded anchor (in perforated and solid brick masonry) Size: FIS H 12x50 K FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K
	Push through installation	Anchor rod; use in cylindrical drill hole (in solid brick masonry and autoclaved aerated concrete)	
Installation and use conditions	conditions d/d (dry/dry)	all bricks	
	conditions w/d (wet/dry)		
	conditions w/w (wet/wet)		
Installation direction		D3 (downward and horizontal installation)	
Installation temperature		$T_{i,min}$ = -5 °C to $T_{i,max}$ = +40 °C	
In-service temperature	Temperature range Tb	-40 °C to +80 °C	(max. short term temperature +80 °C max. long term temperature +50 °C)
	Temperature range Tc	-40 °C to +120 °C	(max. short term temperature +120 °C; max. long term temperature +72 °C)

Specifications of intended use part 2

Anchorages subject to:

- Static and quasi-static loads

Base materials:

- Solid brick masonry (base material group b) and autoclaved aerated concrete (base material group d), acc. to Annex B10.
- Hollow brick masonry (base material group c), according to Annex B10.
- For minimum thickness of masonry member is h_{ef}+30mm.
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2016.
- For other bricks in solid masonry, hollow or perforated masonry and autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 053:2022-07 under consideration of the β-factor according to Annex C28, Table C28.1.

  Note (only applies to solid bricks and autoclaved aerated concrete):
  The characteristic resistance is also valid for larger brick sizes, higher compressive strength and higher raw density of the masonry unit.

Temperature Range:

- **Tb:** From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)
- **Tc:** From -40°C to +120°C (max. short term temperature +120°C and max. long term temperature +72°C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel)
- For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance classes to Annex A5, Table A5.1.

Specifications of intended use part 3 continued

Design:

- The anchorages have to be designed in accordance with EOTA Technical Report TR 054:2023-12 (included the dimensioning for fire exposure), Design method A under the responsibility of a designer experienced in anchorages and masonry work.

  Applies to all bricks, if no other values are specified:

  $N_{Rk} = N_{Rk,b} = N_{Rk,p} = N_{Rk,b,c} = N_{Rk,p,c}$

  $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$

  For the calculation of pulling out a brick under tension loading $N_{Rk,pb}$ or pushing out a brick under shear loading $V_{Rk,pb}$ see EOTA Technical Report TR 054:2023-12.

  $N_{Rk,s}$, $V_{Rk,s}$ and $M^0_{Rk,s}$ see annexes C1-C3.

  Factors for job site tests and displacements see annex C28.

- Verifiable calculation notes and drawings have to be prepared taking into account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is to be indicated on the design drawings.

Installation:

- Conditions d/d: - Installation and use in dry structures.
- Conditions w/w:- Installation and use in dry and wet structures.
- Conditions w/d: - Installation in wet structures and use in dry structures.
- Hole drilling see Annex C (drilling method).
- In case of aborted hole: The hole shall be filled with injection mortar.
- Bridging of unbearing layer (e.g., plaster) is permitted for masonry with solid bricks and cylindrical drill hole. At perforated brick masonry see Annex B6, Table B6.1.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Fastening screws or anchor rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E mentioned in Annex A5, Table A5.1.
- Minimum curing time see Annex B7, Table B7.3.
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

  Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A5, Table A5.1

  Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored.


  Marking of the anchor rod with the envisage embedment depth. This may be done by the manufacturer of the rod or by a person on job site.

Table B4.1: Installation parameters for anchor rods in solid bricks and autoclaved aerated concrete without perforated sleeves

Anchor rod	Thread	M6	M8	M10	M12	M16
Nominal drill hole diameter	d_0 [mm]	8	10	12	14	18
Effective anchorage depth h_{ef} [1] in AAC cylindrical drill hole	$h_{0,min} \geq h_{ef,min}$ [mm]	100				
	$h_{0,max} \geq h_{ef,max}$ [mm]	h-30, ≤200				
Effective anchorage depth h_{ef} [1] in solid brick (depth of drill hole $h_0 \geq h_{ef}$)	$h_{ef,min}$ [mm]	50				
	$h_{ef,max}$ [mm]	h-30, ≤200				
Diameter of clearance hole in the fixture	pre-positioning $d_f \leq$ [mm]	7	9	12	14	18
	push through $d_f \leq$ [mm]	9	11	14	16	20
Diameter of cleaning brush	$d_b \geq$ [mm]	see Table B7.1				
Maximum installation torque	T_{inst} [Nm]	see parameters of brick				

[1] $h_{ef,min} \leq h_{ef} \leq h_{ef,max}$ is possible.

fischer anchor rods M6, M8, M10, M12, M16

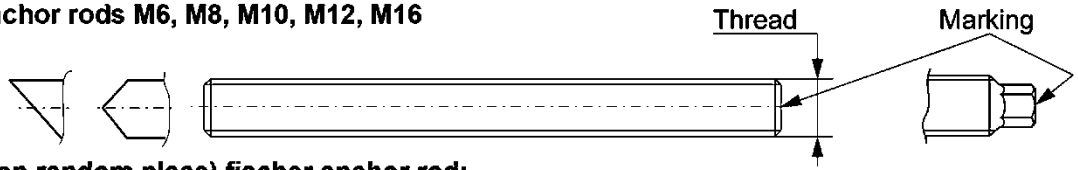

Marking (on random place) fischer anchor rod:


Steel zinc plated PC[1] 8.8	• or +	Steel hot-dip galvanised PC[1] 8.8	•
High corrosion resistant steel HCR PC[1] 50	•	High corrosion resistant steel HCR PC[1] 70	–
High corrosion resistant steel HCR PC[1] 80	(	Stainless steel R property class 50	~
Stainless steel R property class 80	*		

Alternatively: Colour coding according to DIN 976-1: 2016; property class 4.6 marking according to EN ISO 898-1:2013

[1] PC = property class

Installation conditions:

Anchor rod in cylindrical drill hole

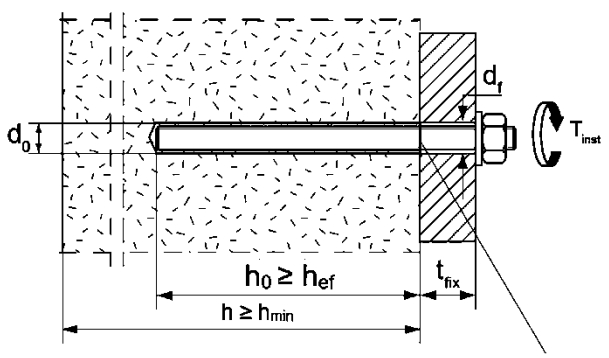

Figures not to scale

fischer injection system FIS P Plus for masonry

Intended Use
Installation parameters for anchor rods without perforated sleeve


Annex B4
Appendix 10 / 48

Table B5.1: Installation parameters for internal threaded anchors FIS E in solid bricks and autoclaved aerated concrete without perforated sleeves


Internal threaded anchor FIS E		**11x85 M6**	**11x85 M8**	**15x85 M10**	**15x85 M12**
Diameter of anchor	d_H [mm]	11		15	
Nominal drill hole diameter	d_0 [mm]	14		18	
Length of anchor	L_H [mm]	85			
Effective anchorage depth	$h_0 \geq h_{ef}$ [mm]	85			
Diameter of cleaning brush	$d_b \geq$ [mm]	see Table B7.1			
Maximum installation torque	T_{inst} [Nm]	see parameters of brick			
Diameter of clearance hole in the fixture	d_f [mm]	7	9	12	14
Screw-in depth	$l_{E,min}$ [mm]	6	8	10	12
	$l_{E,max}$ [mm]	60			

fischer Internal threaded anchor FIS E

FIS E 11x85 M6, FIS E 11x85 M8

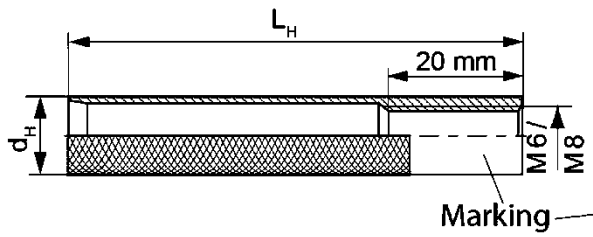

FIS E 15x85 M10, FIS E 15x85 M12

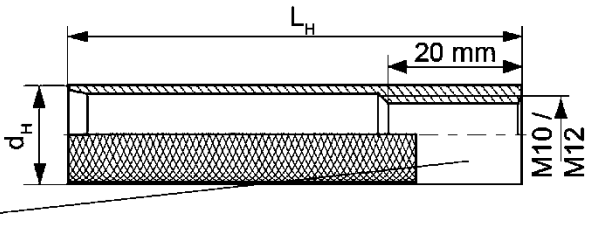


Marking:

Size, e.g. **M8**, Stainless steel: R, e.g. **M8 R**, High corrosion resistant steel: HCR, e.g. **M8 HCR**

Installation conditions:

Internal threaded anchor in cylindrical drill hole

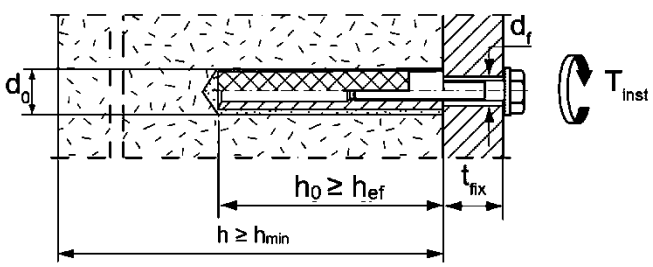

Figures not to scale

Table B6.1: Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeves (pre-positioned installation)

perforated sleeve FIS H K		12x50	12x85[2)]	16x85	16x130[2)]	20x85	20x130[2)]	20x200[2)]
Nominal drill hole diameter $d_0 = D_{sleeve,nom}$	d_0 [mm]	12		16		20		
Depth of drill hole	h_0 [mm]	55	90	90	135	90	135	205
Effective anchorage depth	$h_{ef,min}$ [mm]	50	65	85	110	85	110	180
	$h_{ef,max}$ [mm]	50	85	85	130	85	130	200
Size of threaded rod	[-]	M6 and M8		M8 and M10		M12 and M16		
Size of internal threaded anchor FIS E		-	-	11x85	-	15x85	-	-
Diameter of cleaning brush[1)]	$d_b \geq$ [mm]	see Table B7.1						
Maximum installation torque	T_{inst} [Nm]	see parameters of brick						


[1)] Only for solid areas in hollow bricks and solid bricks.

[2)] Bridging of unbearing layer (e.g. plaster) is possible. When reducing the effective anchorage depth $h_{ef,min}$, the values of the next shorter perforated sleeve of the same diameter must be used. The smaller value of charastereristic resistance must be taken.


Perforated sleeve

FIS H 12x50 K; FIS H 12x85 K; FIS H 16x85 K; FIS H 16x130 K;
FIS H 20x85 K; FIS H 20x130 K; FIS H 20x200 K

Marking:
Size $D_{sleeve,nom}$ x L_{sleeve}
(e.g.: 16x85)




$D_{sleeve,nom}$

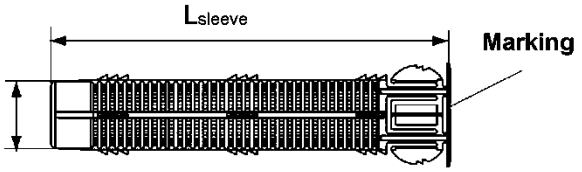


fischer Internal threaded anchor FIS E

FIS E 11x85 M6, FIS E 11x85 M8

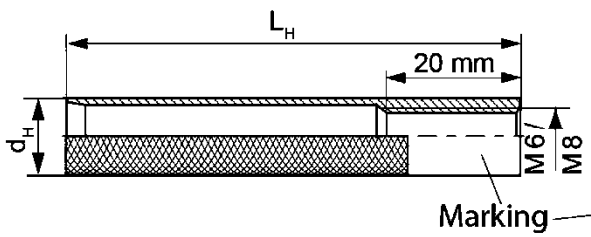


FIS E 15x85 M10, FIS E 15x85 M12

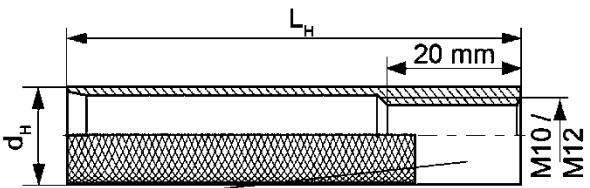


Installation conditions:

Anchor rod with perforated sleeve

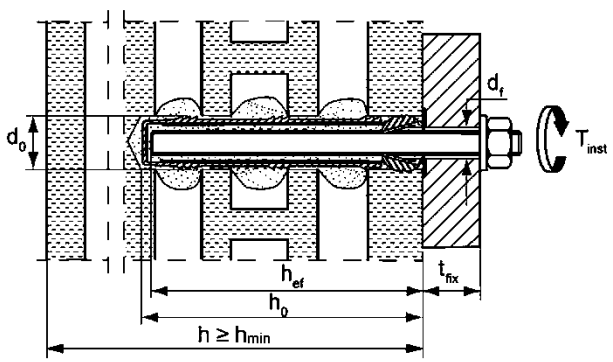

Internal threaded anchor with perforated sleeve

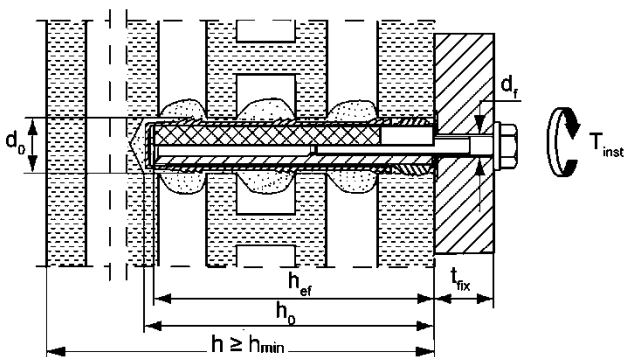

Figures not to scale

fischer injection system FIS P Plus for masonry


Intended Use
Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeve (pre-positioned installation)

Annex B6
Appendix 12 / 48

Table B7.1: Parameters of the cleaning brush BS (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

Drill hole diameter	d_0 [mm]	8	10	12	14	16	18	20	22
Brush diameter	d_b [mm]	9	11	14	16	20	20	25	25

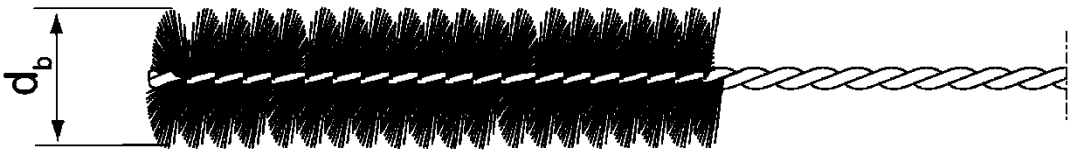

Only for solid bricks and autoclaved aerated concrete or solid areas of perforated bricks and hollow blocks

Table B7.2: Conditions for use static mixer without an extension tube

Nominal drill hole diameter		d_0	[mm]	10	12	14	16	18	20	22
Drill hole depth h_0 by using	FIS MR Plus		[mm]	≤90		≤120	≤140	≤150	≤160	≤170
	FIS JMR		[mm]	-		≤90			≤260	

Table B7.3: Maximum processing times and minimum curing times (During the curing time of the mortar the masonry temperature may not fall below the listed minimum temperature)

Temperature at anchoring base [°C]	Maximum processing time [2] t_{work}	Minimum curing time [1], [2] t_{cure}
	FIS P Plus	FIS P Plus
> -5 to 0	> 13 min	24 h
> 0 to 5	13 min	3 h
> 5 to 10	9 min	90 min
> 10 to 20	5 min	60 min
> 20 to 30	4 min	45 min
> 30 to 40	2 min	35 min












[1] For wet bricks the curing time must be doubled.

[2] Minimum cartridge temperature +5°C.

Figures not to scale

Installation instruction part 1









Installation in solid brick and autoclaved aerated concrete (without perforated sleeve)

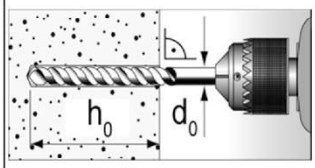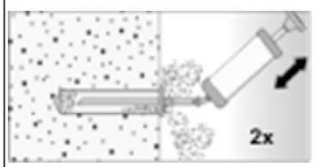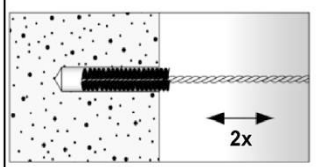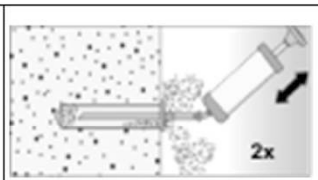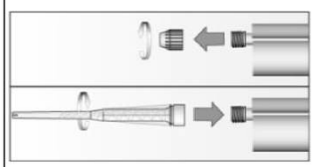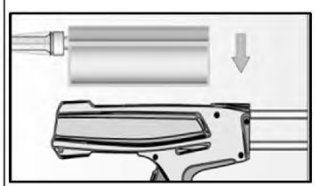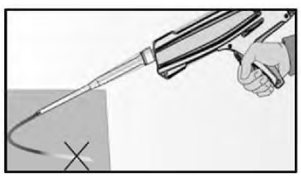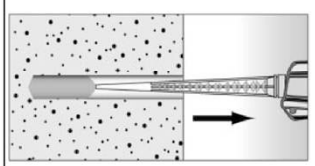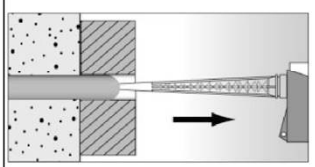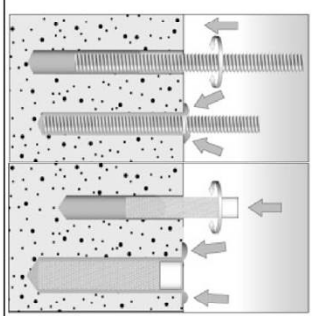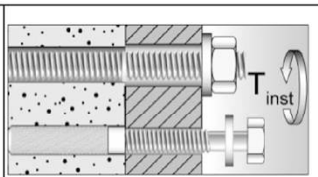1		Drill the hole (drilling method see Annex C of the respective brick) depth of drill hole $\mathbf{h_0}$ and drill hole diameter $\mathbf{d_0}$ see **Table B4.1; B5.1**.		
2				Blow out the drill hole twice. Brush twice and blow out twice again.
3		Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible).		
4		Place the cartridge into a suitable dispenser.		Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of.
5		Fill approximetly 2/3 of the drill hole with mortar beginning from the bottom of the hole[1)]. Avoid bubbles!		For push through installation fill the annular clearance with mortar.
6		Only use clean and oil-free metal parts. Mark the anchor rod for setting depth. Insert the anchor rod or internal threaded anchor FIS E by hand using light turning motions. When reaching the setting depth marking, excess mortar must emerge from the mouth of the drill hole.		
7		Do not touch. Minimum curing time see **Table B7.3**.		Mounting the fixture. max T_{inst} see parameter of brick in **Annex C**.

[1)] Exact volume of mortar see manufacturer´s specification.

Installation instruction part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned installation)

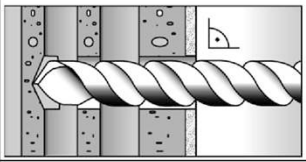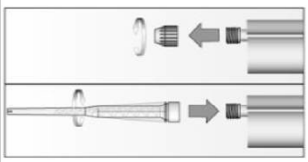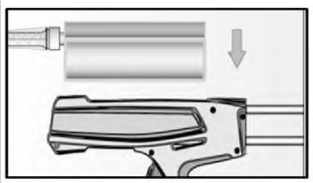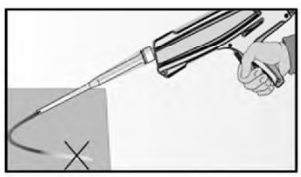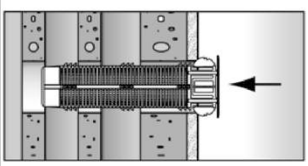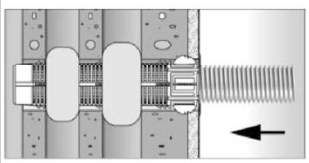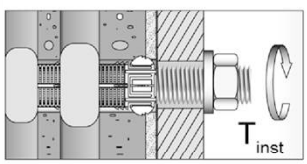1		Drill the hole (drilling method see Annex C of the respective brick). depth of drill hole h_0 and drill hole diameter d_0 see **Table B6.1**	When install perforated sleeves in solid bricks or solid areas of hollow bricks, also clean the hole by blowing out and brushing.	
2		Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible).		
3		Place the cartridge into a suitable dispenser.		Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of.
4		Insert the perforated sleeve flush with the surface of the masonry or plaster.		Fill the perforated sleeve completely with mortar beginning from the bottom of the hole[1].
5		Only use clean and oil-free metal parts. Mark the ancher rod for setting depth. Insert the anchor rod or the internal threaded anchor FIS E by hand using light turning motions until reaching the setting depth marking (anchor rod) or flush with the surface (internal threaded anchor).		
6		Do not touch. Minimum curing time see **Table B7.3**		Mounting the fixture. max T_{inst} see parameter of brick in **Annex C**.


[1] Exact volume of mortar see manufacturer´s specification.

Table B10.1: Overview of assessed bricks


Kind of masonry	Brick format [mm]	Mean compressive strength [N/mm²]	Main country of origin	Mean gross density ρ [kg/dm³]	Annex
Solid brick Mz					
Solid brick Mz	**NF** ≥240x115x71	15 / 25 / 35	Germany	≥1,8	C4 – C7
Solid calcium silicate (sand- lime) brick KS / perforated calcium silicate (sand- lime) brick KSL					
Solid calcium silicate brick KS	**NF** ≥240x115x71	15 / 25 / 35	Germany	≥2,0	C8 / C9
	≥ 240x115x113	12,5 / 25	Germany	≥1,8	C10 / C11
Perforated calcium silicate brick KSL	**3DF** 240x175x113	10 / 12,5 / 15 / 20 / 25	Germany	≥1,4	C12 – C14
Vertical perforated brick HLz					
Vertical perforated brick HLz	370x240x237	5 / 7,5 / 10 / 12,5 / 15	Germany	≥1,0	C15 / C16
	500x175x237	5 / 7,5 / 10 / 12,5 / 15	Germany	≥1,0	C15 / C16
	2DF 240x115x113	7,5 / 12,5 / 20 / 25 / 35	Germany	≥1,4	C17 / C18
	365x248x245	10	Austria	≥0,6	C19 – C20
	240x175x113	12,5	Germany	≥0,9	C21 / C22
Light-weight concrete hollow block Hbl					
Light-weight concrete hollow block Hbl	362x240x240	2,5 / 5	Germany	≥1,0	C23 / C24
Autoclaved aerated concrete (AAC)					
PP2 / AAC	-	2,5	Germany	0,35	C25 – C27
PP4 / AAC	-	5	Germany	0,5	C25 – C27
PP6 / AAC	-	8	Germany	0,65	C25 – C27

Table B11.1: Overview dimensions of perforated and hollow bricks part 1


Perforated calcium silicate brick KSL, 3DF,
EN 771-2:2011+A1:2015; e.g. KS Wemding according to Annex C12

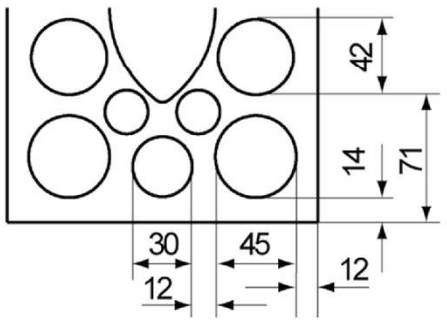

Vertical perforated brick HLz,
EN 771-1:2011+A1:2015: e.g. Wienerberger, Poroton according to Annex C15

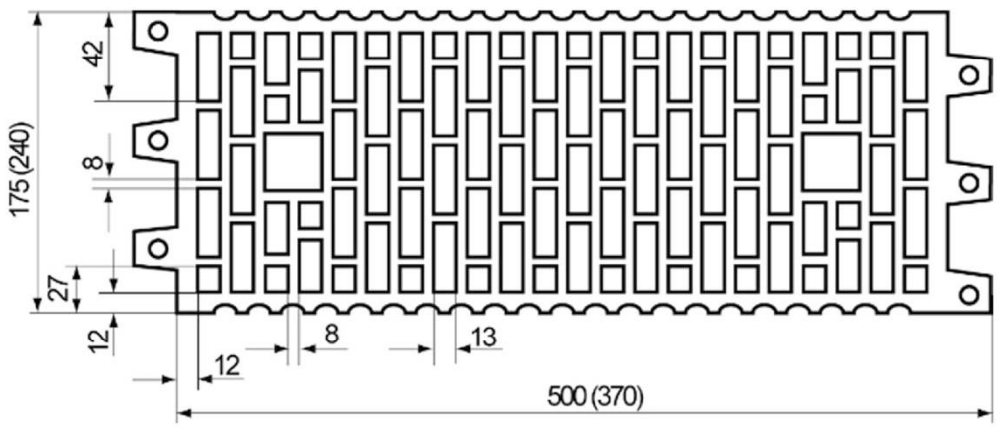


Vertical perforated brick HLz, 2DF,
EN 771-1:2011+A1:2015; e.g. Wienerberger according to Annex C17

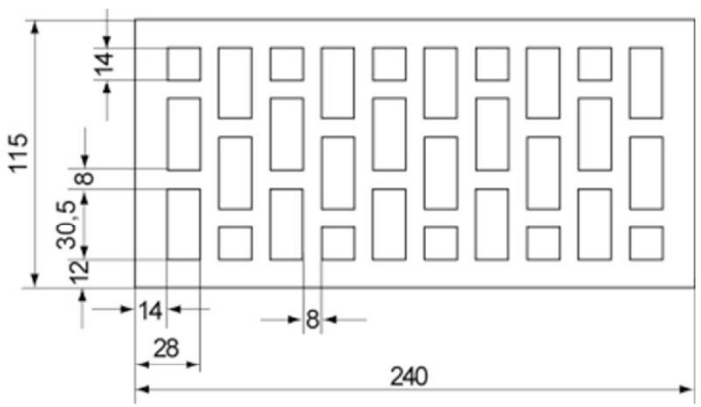


Measures in [mm]
Figures not to scale

Table B14.1: Overview dimensions of perforated and hollow bricks part 2


Vertical perforated brick filled with mineral wool,
EN 771-1:2011+A1:2015; according to Annex C19

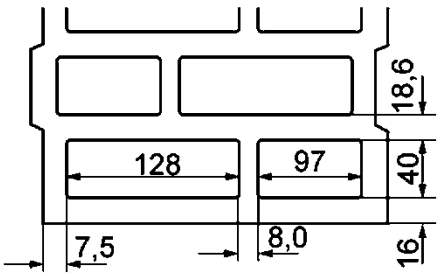

Vertical perforated brick HLz,
EN 771-1:2011+A1:2015; e.g. Wienerberger according to Annex C21

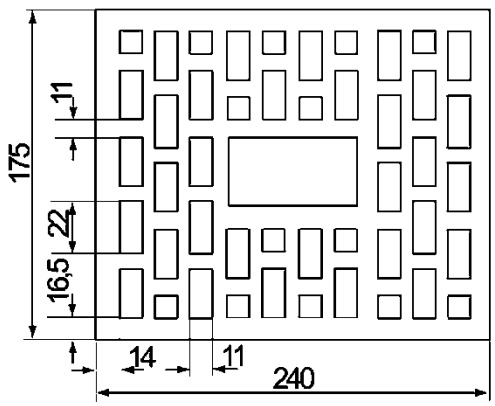


Light-weight concrete hollow block Hbl,
EN 771-3:2011+A1:2015; according to Annex C23

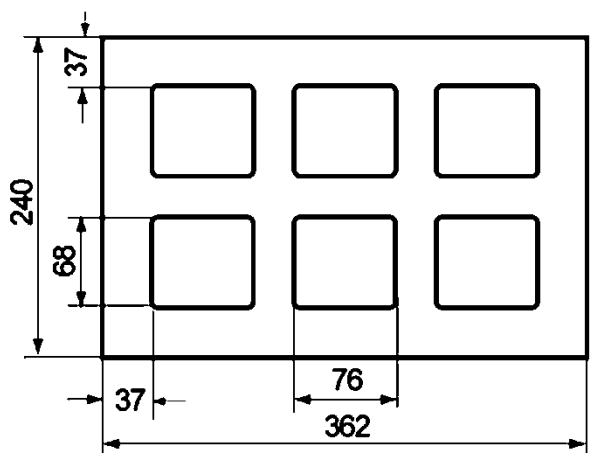

Measures in [mm]
Figures not to scale

Spacing and edge distance part 1

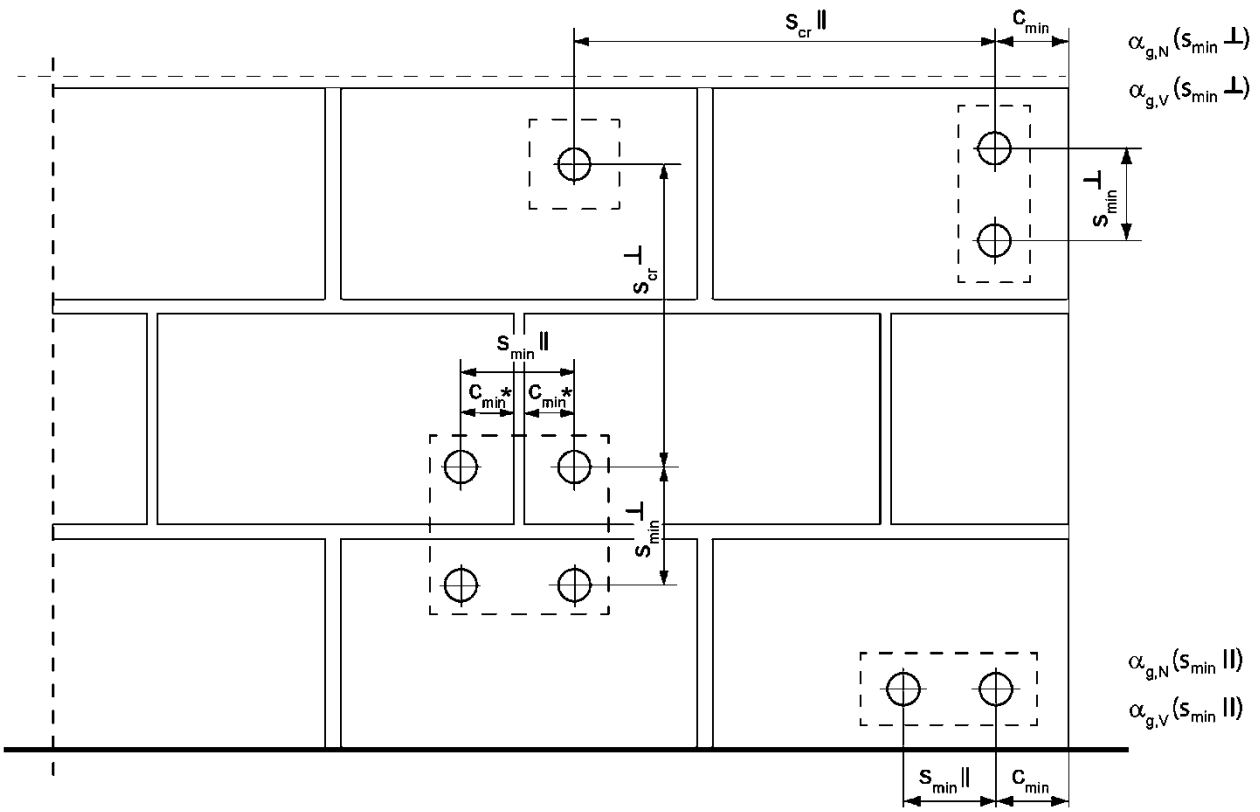

* Only, if vertical joints are not completely filled with mortar

s_{min} ‖	=	Minimum spacing parallel to horizontal joint
s_{min} ⊥	=	Minimum spacing perpendicular to horizontal joint
s_{cr} ‖	=	Characteristic spacing parallel to horizontal joint
s_{cr} ⊥	=	Characteristic spacing perpendicular to horizontal joint
$c_{cr} = c_{min}$	=	Edge distance
$\alpha_{g,N}$ (s_{min} ‖)	=	Group factor for tension load, anchor group parallel to horizontal joint
$\alpha_{g,V}$ (s_{min} ‖)	=	Group factor for shear load, anchor group parallel to horizontal joint
$\alpha_{g,N}$ (s_{min} ⊥)	=	Group factor for tension load, anchor group perpendicular to horizontal joint
$\alpha_{g,V}$ (s_{min} ⊥)	=	Group factor for shear load, anchor group perpendicular to horizontal joint

Figures not to scale

Spacing and edge distance part 2

For $s \geq s_{cr}$: $\alpha_g = 2$

For $s_{min} \leq s < s_{cr}$: α_g according to installation parameters of brick Annex C

Group of 2 anchors

$N^g_{Rk} = \alpha_{g,N} \bullet N_{Rk}$; $V^g_{Rk,b} = V^g_{Rk,c,II} = V^g_{Rk,c,\perp} = \alpha_{g,V} \bullet V_{Rk}$

Group of 4 anchors

$N^g_{Rk} = \alpha_{g,N}\ (s_{min}II) \bullet\ \alpha_{g,N}\ (s_{min}\perp) \bullet N_{Rk}$;

$V^g_{Rk,b} = V^g_{Rk,c,II} = V^g_{Rk,c,\perp} = \alpha_{g,V}\ (s_{min}II) \bullet \alpha_{g,V}\ (s_{min}\perp) \bullet V_{Rk}$

with N_{Rk} and $\alpha_{g,N}$ depending on $s_{min}II$ or $s_{min}\perp$ acc. to Annex C

with V_{Rk} and $\alpha_{g,V}$ depending on $s_{min}II$ or $s_{min}\perp$ acc. to Annex C

Table C1.1: Characteristic resistance to **steel failure** under **tension loading** of **fischer anchor rods** and **standard threaded rods**

Anchor rod / standard threaded rod				**M6**	**M8**[3]	**M10**[3]	**M12**	**M16**
Characteristic resistance to steel failure under tension loading								
Characteristic resistance $N_{Rk,s}$	Steel zinc plated	Property class	4.6	[kN]	8,0	14,6(13,2)	23,2(21,4)	33,7	62,8
			4.8		8,0	14,6(13,2)	23,2(21,4)	33,7	62,8
			5.8		10,0	18,3(16,6)	29,0(26,8)	42,1	78,5
			8.8		16,0	29,2(26,5)	46,4(42,8)	67,4	125,6
	Stainless steel R and High corrosion resistant steel HCR		50		10,0	18,3	29,0	42,1	78,5
			70		14,0	25,6	40,6	59,0	109,9
			80		16,0	29,2	46,4	67,4	125,6
Partial factors [1]								
Partial factors $\gamma_{Ms,N}$	Steel zinc plated	Property class	4.6	[-]	2,00				
			4.8		1,50				
			5.8		1,50				
			8.8		1,50				
	Stainless steel R and High corrosion resistant steel HCR		50		2,86				
			70		1,50[2] / 1,87				
			80		1,60				

[1] In absence of other national regulations

[2] Only for fischer FIS A made of high corrosion resistant steel HCR

[3] Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hot-dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009.

Table C2.1: Characteristic resistance to **steel failure** under **shear loading** of **fischer anchor rods** and **standard threaded rods**

Anchor rod / standard threaded rod				M6	M8[3]	M10[3]	M12	M16
Characteristic resistance to steel failure under shear loading								
without lever arm								
Characteristic resistance $V^0_{Rk,s}$	Steel zinc plated	Property class	4.6	4,8	8,7(7,9)	13,9(12,8)	20,2	37,6
			4.8	4,8	8,7(7,9)	13,9(12,8)	20,2	37,6
			5.8	6,0	10,9(9,9)	17,4(16,0)	25,2	47,1
			8.8	8,0	14,6(13,2)	23,2(21,4)	33,7	62,8
	Stainless steel R and High corrosion resistant steel HCR		50	5,0	9,1	14,5	21,0	39,2
			70	7,0	12,8	20,3	29,5	54,9
			80	8,0	14,6	23,2	33,7	62,8
		[kN]						
with lever arm								
Characteristic resistance $M^0_{Rk,s}$	Steel zinc plated	Property class	4.6	6,1	14,9(12,9)	29,9(26,5)	52,3	132,9
			4.8	6,1	14,9(12,9)	29,9(26,5)	52,3	132,9
			5.8	7,6	18,7(16,1)	37,3(33,2)	65,4	166,2
			8.8	12,2	29,9(25,9)	59,8(53,1)	104,6	265,9
	Stainless steel R and High corrosion resistant steel HCR		50	7,6	18,7	37,3	65,4	166,2
			70	10,6	26,2	52,3	91,5	232,6
			80	12,2	29,9	59,8	104,6	265,9
		[Nm]						
Partial factors[1]								
Partial factors $\gamma_{Ms,V}$	Steel zinc plated	Property class	4.6	1,67				
			4.8	1,25				
			5.8	1,25				
			8.8	1,25				
	Stainless steel R and High corrosion resistant steel HCR		50	2,38				
			70	1,25[2] / 1,56				
			80	1,33				
		[-]						

[1] In absence of other national regulations

[2] Only for fischer FIS A made of high corrosion resistant steel HCR


[3] Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hot-dip galvanised standard threaded rods (M8 resp. M10) according to EN ISO 10684:2004+AC:2009.

Table C3.1: Characteristic resistance to **steel failure** under **tension / shear loading** of **internal threaded anchors FIS E**

fischer internal threaded anchor FIS E					**M6**	**M8**	**M10**	**M12**
Characteristic resistance to steel failure under tension loading, decisive values of internal threaded anchor FIS E with screw/threaded rod								
Characteristic resistance	$N_{Rk,s}$	Property class	4.6	[kN]	8,0	14,6	23,2	33,7
		Property class	5.8		10,0	18,3	29,0	42,1
		Property class 70	R		14,0	25,6	40,6	59,0
			HCR		14,0	25,6	40,6	59,0
Partial factors[1)]								
Partial factors	$\gamma_{Ms,N}$	Property class	4.6	[-]	2,00			
		Property class	5.8		1,50			
		Property class 70	R		1,87			
			HCR		1,87			
Characteristic resistance to steel failure under shear loading; decisive values of internal threaded anchor FIS E with screw/threaded rod								
without lever arm								
Characteristic resistance	$V_{Rk,s}$	Property class	4.6	[kN]	4,8	8,7	13,9	20,2
		Property class	5.8		6,0	10,9	15,0	21,0
		Property class 70	R		7,0	12,8	20,3	29,5
			HCR		7,0	12,8	20,3	29,5
with lever arm								
Characteristic resistance	$M^0_{Rk,s}$	Property class	4.6	[Nm]	6,1	14,9	29,9	52,3
		Property class	5.8		7,6	18,7	37,3	65,4
		Property class 70	R		10,6	26,2	52,3	91,5
			HCR		10,6	26,2	52,3	91,5
Partial factors[1)]								
Partial factors	$\gamma_{Ms,V}$	Property class	4.6	[-]	1,67			
		Property class	5.8		1,25			
		Property class 70	R		1,56			
			HCR		1,56			

[1)] In absence of other national regulations

Solid brick Mz, NF, EN 771-1:2011+A1:2015

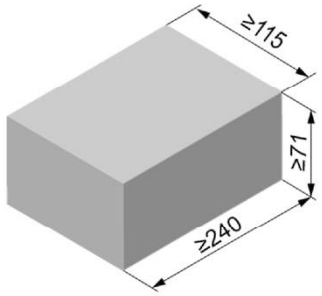

Producer		e.g. Wienerberger		
Nominal dimensions	[mm]	length L	width W	height H
		≥ 240	≥ 115	≥ 71
Mean gross dry density ρ	[kg/dm³]	≥ 1,8		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	15 / 12 or 25 / 20 or 35 / 28		
Standard or annex		EN 771-1:2011+A1:2015		

Table C4.1: Installation parameters for edge distance c=100mm

Anchor rod			**M6**	**M8**	**M10**	**M12**	-		-	
Internal threaded anchor FIS E			-	-	-	-	**M6**	**M8**	**M10**	**M12**
							11x85		**15x85**	
Anchor rod and internal threaded anchor FIS E without perforated sleeve										
Effective anchorage depth	h_{ef}	[mm]	50	50	50	50	85			
			80	80	80	80				
			200	200	200	200				
Max. installation torque	max T_{inst}	[Nm]	4	10			4	10		
General installation parameters										
Edge distance	$c_{min} = c_{cr}$	[mm]	100				100			
Edge distance h_{ef}=200	$c_{min} = c_{cr}$		150				-[2]			
Spacing	s_{min} II,N		60				60			
	h_{ef}=200 s_{min} II,N		240				-[2]			
	s_{min} II,V		240				240			
	s_{cr} II		240				240			
	$s_{cr} \perp = s_{min} \perp$		75				75			
Drilling method										
Hammer drilling with hard metal hammer drill										

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.
[2] No performance assessed

Table C4.2: Group factors

Anchor rods			**M6**	**M8**	**M10**	**M12**	-		-	
Internal threaded anchor FIS E			-	-	-	-	**M6**	**M8**	**M10**	**M12**
							11x85		**15x85**	
Edge distance	c_{min}	[mm]	**100**							
Group factor	$\alpha_{g,N}$ (s_{min} II)	[-]	1,5							
	$\alpha_{g,V}$ (s_{min} II)		2,0							
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} II)		1,5							
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} II)		2,0							
	$\alpha_{g,N}$ ($s_{min} \perp$)		2,0							
	$\alpha_{g,V}$ ($s_{min} \perp$)		2,0							
	h_{ef}=200 $\alpha_{g,N}$ ($s_{min} \perp$)		2,0							
	h_{ef}=200 $\alpha_{g,V}$ ($s_{min} \perp$)		2,0							

Solid brick Mz, NF, EN 771-1:2011+A1:2015

Table C5.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading for edge distance c=100mm

Anchor rod		**M6**	**M8**	**M10**		**M12**		-		-	
Internal threaded anchor FIS E		-	-	-		-		**M6**	**M8**	**M10**	**M12**
								11x85		**15x85**	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]											
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions	Effective anchorage depth h_{ef} [mm]									
		≥50	≥50	50	80	200	50	80	200	85	
15 / 12 N/mm²	w/w w/d	2,5	2,5	2,0	3,0	7,5	2,0	3,5	5,0	3,5	
	d/d	4,0	4,0	3,5	5,0	12,0	3,0	5,5	8,0	5,5	
25 / 20 N/mm²	w/w w/d	3,5	3,5	3,0	4,5	11,0	3,0	5,0	7,0	5,0	
	d/d	5,5	5,5	5,0	7,0	12,0	4,5	8,0	11,5	8,0	

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.

Table C5.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading for edge distance c=100mm

Anchor rod		**M6**	**M8**	**M10**		**M12**		-		-	
Internal threaded anchor FIS E		-	-	-		-		**M6**	**M8**	**M10**	**M12**
								11x85		**15x85**	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C											
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions	Effective anchorage depth h_{ef} [mm]									
		≥50	≥50	≥50	200	≥50	200	85			
15 / 12 N/mm²	w/w w/d d/d	2,5	2,5	4,0	8,5	4,0	11,5	2,5			
25 / 20 N/mm²	w/w w/d d/d	4,0	4,0	6,0	12,0	5,5	12,0	4,0			

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Solid brick Mz, NF, EN 771-1:2011+A1:2015

Table C6.1: Installation parameters for edge distance c=60mm

Anchor rod			**M6**	**M8**	**M10**	**M12**	**M16**	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	**M6**	**M8**	**M10**	**M12**
								11x85		**15x85**	
Anchor rod and internal threaded anchor FIS E without perforated sleeve											
Effective anchorage depth	h_{ef}	[mm]	50	50	50	50	50	85			
			100	100	100	100	100				
			200	200	200	200	200				
Max. installation torque	max T_{inst}	[Nm]	4	10				4	10		
General installation parameters											
Edge distance	$c_{min} = c_{cr}$	[mm]	60								
Edge distance h_{ef}=200	c_{min}		60								
Spacing	s_{min} II,N		80								
	h_{ef}=200 s_{min} II,N		80								
	s_{min} II,V		80								
	s_{cr} II		3x h_{ef}								
	s_{min} ⊥		80								
	s_{cr} ⊥		3x h_{ef}								
Drilling method											
Hammer drilling with hard metal hammer drill											

Table C6.2: Group factors

Anchor rods			**M6**	**M8**	**M10**	**M12**	**M16**	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	**M6**	**M8**	**M10**	**M12**
								11x85		**15x85**	
Edge distance	c_{min}	[mm]	60								
Group factor	$\alpha_{g,N}$ (s_{min} II)	[-]	0,6								
	$\alpha_{g,V}$ (s_{min} II)		1,3								
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} II)		1,4								
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} II)		1,5								
	$\alpha_{g,N}$ (s_{min} ⊥)		0,3								
	$\alpha_{g,V}$ (s_{min} ⊥)		1,3								
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ⊥)		2,0								
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ⊥)		1,1								

Solid brick Mz, NF, EN 771-1:2011+A1:2015

Table C7.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading for edge distance c=60mm

Anchor rod		M6	M8	M10	M12	M16	-	-
Internal threaded anchor FIS E		-	-	-	-	-	M6 M8	M10 M12
							11x85	15x85

$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [3]

Mean compressive strength / Min. compressive strength single brick [1]	Use conditions	Effective anchorage depth h_{ef} [mm]												
		50	100	50	100	50	100	200	50	100	200	50	100	200	85
15 / 12 N/mm²	w/w w/d	1,5		2,0	2,0	2,0	2,5	-[2]	2,0	2,5	-[2]	2,0	5,5	-[2]	-[2]
	d/d	2,5		3,0	4,0	3,0	4,0	9,5	3,0	4,0	9,5	3,0	8,5	9,5	-[2]
25 / 20 N/mm²	w/w w/d	2,0		2,5	3,0	2,5	3,5	-[2]	3,0	3,5	-[2]	3,0	7,5	-[2]	-[2]
	d/d	3,5		4,5	5,5	4,5	5,5	12	4,5	5,5	12	4,5	12	12	-[2]
35 / 28 N/mm²	w/w w/d	2,5		3,0	4,0	3,0	4,0	-[2]	3,5	4,0	-[2]	3,5	9,0	-[2]	-[2]
	d/d	4,0		5,5	6,5	5,5	6,5	12	5,5	6,5	12	5,5	12	12	-[2]

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2] No performance assessed.

[3] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.

Table C7.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading for edge distance c=60mm

Anchor rod		M6	M8	M10	M12	M16	-	-
Internal threaded anchor FIS E		-	-	-	-	-	M6 M8	M10 M12
							11x85	15x85

$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C


Mean compressive strength / Min. compressive strength single brick [1]	Use conditions	Effective anchorage depth h_{ef} [mm]												
		50	100	50	100	50	100	200	50	100	200	50	100	200	85
15 / 12 N/mm²	w/w w/d d/d	1,2	2,5	1,2	3,0	2,0	3,0	1,5	1,5	3,0	3,0	0,6	3,0	4,5	-[2]
25 / 20 N/mm²		1,5	3,5	1,5	4,5	3,0	4,5	2,5	2,0	4,5	4,5	0,9	4,5	6,0	-[2]
35 / 28 N/mm²		2,0	4,0	2,0	5,0	3,5	5,0	3,0	2,5	5,0	5,0	1,2	5,0	7,5	-[2]

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2] No performance assessed.

Factor for job site tests and displacements see annex C28.

Solid calcium silicate brick KS, NF, EN 771-2:2011+A1:2015

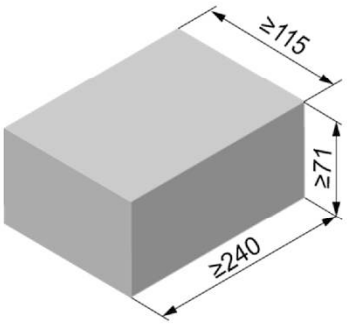

Producer		-		
Nominal dimensions	[mm]	length L	width W	height H
		≥ 240	≥ 115	≥ 71
Mean gross dry density ρ	[kg/dm³]	≥ 1,8		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	15 / 12 or 25 / 20 or 35 / 28		
Standard or annex		EN 771-2:2011+A1:2015		

Table C8.1: Installation parameters

Anchor rod			**M6**		**M8**		**M10**		**M12**		**M16**		-		-	
Internal threaded anchor FIS E			-		-		-		-		-		**M6**	**M8**	**M10**	**M12**
													11x85		**15x85**	
Anchor rod and internal threaded anchor FIS E without perforated sleeve																
Effective anchorage depth	h_{ef}	[mm]	50	100	50	100	50	100	50	100	50	100	85		85	
							200		200		200					
Max. installation torque	max T_{inst}	[Nm]	3		5		15		15		25		3	5	15	
General installation parameters																
Edge distance	$c_{min} = c_{cr}$	[mm]	60													
Spacing	s_{min} ∥		80													
	s_{cr} ∥		80													
	s_{min} ⊥		3x h_{ef}													
	s_{cr} ⊥		3x h_{ef}													
Drilling method																
Hammer drilling with hard metal hammer drill																

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength..

Table C8.2: Group factors

Anchor rod			**M6**	**M8**	**M10**	**M12**	**M16**	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	**M6**	**M8**	**M10**	**M12**
								11x85		**15x85**	
Group factor	$\alpha_{g,N}$ (s_{min} ∥)	[-]	0,7								
	$\alpha_{g,V}$ (s_{min} ∥)		1,3								
	$\alpha_{g,N}$ (s_{min} ⊥)		2,0								
	$\alpha_{g,V}$ (s_{min} ⊥)		2,0								

Solid calcium silicate brick KS, NF, EN 771-2:2011+A1:2015

Table C9.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		M6		M8		M10			M12			M16			-	-
Internal threaded anchor FIS E		-		-		-			-			-			M6 M8	M10 M12
															11x85	15x85
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]																
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions	Effective anchorage depth h_{ef} [mm]														
		50	100	50	100	50	100	200	50	100	200	50	100	200	85	85
15 / 12 N/mm²	w/w w/d	2,0	3,0	2,5	4,5	2,5	3,5	7,0	2,5	3,0	6,5	2,5	3,5	8,0	2,5	2,5
	d/d	4,0	5,5	4,0	8,0	4,0	5,5	12	4,0	4,5	12	4,5	5,5	12	4,0	4,0
25 / 20 N/mm²	w/w w/d	3,0	4,5	3,5	6,5	3,5	4,5	10	3,5	4,0	9,5	4,0	5,0	11	3,5	3,5
	d/d	5,5	7,5	6,0	11	6,0	8,0	12	6,0	6,5	12	6,5	8,0	12	6,0	6,0
35 / 28 N/mm²	w/w w/d	3,5	5,0	4,0	8,0	4,5	5,5	12	4,5	5,0	11	4,5	5,5	12	4,5	4,5
	d/d	6,5	9,0	7,0	12	7,0	9,0	12	7,0	7,5	12	7,5	9,5	12	7,0	7,0

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.


Table C9.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		M6		M8		M10		M12		M16		-	-
Internal threaded anchor FIS E		-		-		-		-		-		M6 M8	M10 M12
												11x85	15x85
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C													
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions	Effective anchorage depth h_{ef} [mm]											
		50	100	50	100	50	≥100	50	≥100	50	≥100	85	85
15 / 12 N/mm²	w/w w/d	1,5	3,0	1,5	3,0	1,2	2,0	1,2	2,0	1,2	2,0	1,2	1,2
	d/d												
25 / 20 N/mm²	w/w w/d	2,5	4,0	2,5	4,0	1,5	3,0	1,5	3,0	1,5	3,0	1,5	1,5
	d/d												
35 / 28 N/mm²	w/w w/d	3,0	4,5	3,0	4,5	1,5	3,5	1,5	3,5	1,5	3,5	1,5	1,5
	d/d												

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Solid calcium silicate brick KS, EN 771-2:2011+A1:2015

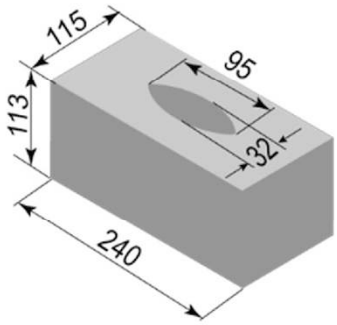

Producer		-		
Nominal dimensions	[mm]	length L	width W	height H
		≥ 240	≥ 115	≥ 113
Mean gross dry density ρ	[kg/dm³]	1,8		
Mean compressive strength / Min. compressive strength single brick [1)]	[N/mm²]	12,5 / 10 or 25 / 20		
Standard or annex		EN 771-2:2011+A1:2015		

Table C10.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

Anchor rod	**M6**	**M8**	**-**	**M8**	**M10**	**M8**	**M10**	**-**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E	**-**		**M6 M8** 11x85	**-**		**-**		**M10 M12** 15x85	**-**		**-**	
Perforated sleeve FIS H K	**12x85**		**16x85**			**16x130**		**20x85**			**20x130**	
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K												
Max. installation torque $\max T_{inst}$	[Nm]	2	4									
General installation parameters												
Edge distance $c_{min} = c_{cr}$	[mm]	100										
Spacing s_{min} ∥		255	255			390		255			390	
Spacing s_{cr} ∥												
Spacing s_{min} ⊥												
Spacing s_{cr} ⊥												
Drilling method												
Hammer drilling with hard metal hammer drill												

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C10.2: Group factors

Anchor rod	**M6**	**M8**	**M8**	**M10**	**M8**	**M10**	**M12**	**M16**	**M12**	**M16**
Perforated sleeve FIS H K	**12x85**		**16x85**		**16x130**		**20x85**		**20x130**	
Group factors $\alpha_{g,N}$ (s_{min} ∥) = $\alpha_{g,V}$ (s_{min} ∥)	[-]	2								
Group factors $\alpha_{g,N}$ (s_{min} ⊥) = $\alpha_{g,V}$ (s_{min} ⊥)										

Solid calcium silicate brick KS, EN 771-2:2011+A1:2015

Table C11.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
				11x85						**15x85**					
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]															
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions														
12,5 / 10 N/mm²	w/w	3,5		2,0		2,0		2,0		6,5				4,5	
	d/d	6,0		4,0		3,5		3,5		10,5				7,0	
25 / 20 N/mm²	w/w	5,0		3,0		3,0		3,0		9,5				6,0	
	d/d	8,5		5,5		5,5		5,5		12,0				10,0	

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.
[2)] For temperature range 72/120°C no performance assessed.


Table C11.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
				11x85						**15x85**					
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C [2)]															
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions														
12,5 / 10 N/mm²	w/w	3,0		3,5											
	d/d														
25 / 20 N/mm²	w/w	4,0		5,5											
	d/d														


[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.
[2)] For temperature range 72/120°C no performance assessed.

Factor for job site tests and displacements see annex C28.

Perforated calcium silicate brick KSL, 3DF, EN 771-2:2011+A1:2015

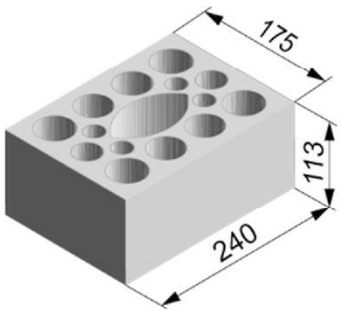

Producer			-	
Nominal dimensions	[mm]	length L	width W	height H
		240	175	113
Mean gross dry density ρ	[kg/dm³]	≥ 1,4		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	10 / 8 or 12,5 / 10 or 15 / 12 or 20 / 16 or 25 / 20		
Standard or annex		EN 771-2:2011+A1:2015		

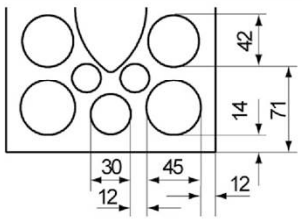

Dimension see also Annex B11

Table C12.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**	**M8**	**M10**	**M8**	**M10**	**-**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		-		-		**M6** / **11x85**	**M8** / **11x85**	-	-		**M10** / **15x85**	**M12** / **15x85**	-	-	
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**			**16x130**		**20x85**			**20x130**	
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K															
Max. installation torque	$\max T_{inst}$	[Nm]	2												
General installation parameters															
Edge distance	$c_{min} = c_{cr}$	[mm]	60			80									
Spacing	s_{min} ∥	[mm]	100												
	s_{cr} ∥	[mm]	240												
	s_{min} ⊥	[mm]	115												
	s_{cr} ⊥	[mm]	115												
Drilling method															
Hammer drilling with hard metal hammer drill															

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C12.2: Group factors

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**	**M8**	**M10**	**M8**	**M10**	**-**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		-		-		**M6** / **11x85**	**M8** / **11x85**	-	-		**M10** / **15x85**	**M12** / **15x85**	-	-	
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**			**16x130**		**20x85**			**20x130**	
Group factors	$\alpha_{g,N}$ (s_{min} ∥) = $\alpha_{g,V}$ (s_{min} ∥)	[-]	1,5												
	$\alpha_{g,N}$ (s_{min} ⊥) = $\alpha_{g,V}$ (s_{min} ⊥)	[-]	2,0												

fischer injection system FIS P Plus for masonry

Performance
Perforated calcium silicate brick KSL, 3DF, dimensions, installation parameters, Group factors

Annex C12
Appendix 32 / 48

Perforated calcium silicate brick KSL, 3DF, EN 771-2:2011+A1:2015

Table C13.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
						11x85						**15x85**					
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]																	
Mean compressive strength/ Min. comp. strength single brick [1)]	Use conditions																
10 / 8 N/mm²	w/w w/d	1,5				2,0				2,0		2,0				2,0	
	d/d	1,5				2,0				2,5		2,5				2,5	
12,5 / 10 N/mm²	w/w w/d	2,0				2,0				2,5		2,5				2,5	
	d/d	2,0				2,5				3,0		3,0				3,0	
15 / 12 N/mm²	w/w w/d	2,5				2,5				3,0		3,0				3,0	
	d/d	2,5				3,0				3,5		3,5				3,5	
20 / 16 N/mm²	w/w w/d	3,0				3,5				4,5		4,5				4,5	
	d/d	3,5				4,0				4,5		4,5				4,5	
25 / 20 N/mm²	w/w w/d	4,0				4,5				5,5		5,5				5,5	
	d/d	4,5				5,0				6,0		6,0				6,0	

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.

Factor for job site tests and displacements see annex C28.

Perforated calcium silicate brick KSL, 3DF, EN 771-2:2011+A1:2015


Table C14.1: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**-**		**M6** / **11x85**	**M8** / **11x85**	**-**		**-**		**M10** / **15x85**	**M12** / **15x85**	**-**		**-**	
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ **[kN]; temperature range 50/80°C and 72/120°C**																	
Mean compressive strength / Min. compressive strength single brick [1]	Use conditions																
10 / 8 N/mm²	w/w, w/d, d/d	1,5						3,0						2,5		3,0	2,5
12,5 / 10 N/mm²	w/w, w/d, d/d	2,0						3,5									
15 / 12 N/mm²	w/w, w/d, d/d	2,5						4,5						4,0		4,5	4,0
20 / 16 N/mm²	w/w, w/d, d/d	3,0	3,5	3,0	3,5	3,0		6,0						5,5		6,0	5,5
25 / 20 N/mm²	w/w, w/d, d/d	4,0	4,5	4,0	4,5	4,0		7,5						6,5		7,5	6,5


[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Vertical perforated brick HLz, EN 771-1:2011+A1:2015

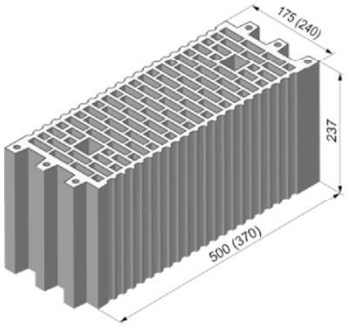

Producer		e.g. Wienerberger, Poroton		
Nominal dimensions	[mm]	length L	width W	height H
		500	175	237
		370	240	237
Mean gross dry density ρ	[kg/dm³]	≥ 1,0		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	5 / 4 or 7,5 / 6 or 10 / 8 or 12,5 / 10 or 15 / 12		
Standard or annex		EN 771-1:2011+A1:2015		

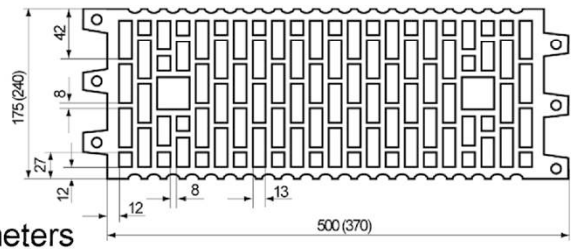

Dimension see also Annex B11

Table C15.1: Installation parameters

Anchor rod	**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E	**-**		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
					11x85						**15x85**					
Perforated sleeve FIS H K	**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K																
Max. installation torque	$\max T_{inst}$	[Nm]	2													
General installation parameters																
Edge distance	$c_{min} = c_{cr}$	[mm]	100													
Spacing	s_{min} ∥		100													
	s_{cr} ∥		500 (370)													
	s_{min} ⊥		100													
	s_{cr} ⊥		240													
Drilling method																
Hammer drilling with hard metal hammer drill																

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C15.2: Group factors

Anchor rod	**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E	**-**		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
					11x85						**15x85**					
Perforated sleeve FIS H K	**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
Group factors $\frac{\alpha_{g,N}(s_{min}\parallel)}{\alpha_{g,V}(s_{min}\parallel)} = \frac{\alpha_{g,N}(s_{min}\perp)}{\alpha_{g,V}(s_{min}\perp)}$		[-]	1													

fischer injection system FIS P Plus for masonry

Performance
Vertical perforated brick HLz, dimensions, installation parameters, Group factors

Annex C15
Appendix 35 / 48

Vertical perforated brick HLz, EN 771-1:2011+A1:2015

Table C16.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		M6 M8	M6 M8	-	M8 M10	M8 M10	-	M12 M16	M12 M16
Internal threaded anchor FIS E		-	-	M6 M8 11x85	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K		12x50	12x85	16x85		16x130	20x85		20x130
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2]									
Mean compressive strength / Min. comp. strength single brick [1]	Use conditions								
5 / 4 N/mm²	w/w w/d	0,30		0,90					1,20
	d/d	0,40		0,90					1,20
7,5 / 6 N/mm²	w/w w/d	0,50		1,50					2,00
	d/d	0,60		1,50					2,00
10 / 8 N/mm²	w/w w/d	0,75		2,00					2,50
	d/d	0,75		2,00					2,50
12,5 / 10 N/mm²	w/w w/d	0,90		2,50					3,00
	d/d	0,90		2,50					3,50
15 / 12 N/mm²	w/w w/d	0,90		3,00					3,50
	d/d	1,20		3,00					4,00

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.


Table C16.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		M6 M8	M6 M8	-	M8 M10	M8 M10	-	M12 M16	M12 M16
Internal threaded anchor FIS E		-	-	M6 M8 11x85	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K		12x50	12x85	16x85		16x130	20x85		20x130
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C									
Mean compressive strength / Min. comp. strength single brick [1]	Use conditions								
5 / 4 N/mm²	w/w w/d d/d	0,50				0,60	0,50		0,60
7,5 / 6 N/mm²		0,75				0,90	0,75		0,90
10 / 8 N/mm²		0,90				1,20	0,90		1,20
12,5 / 10 N/mm²		1,20				1,50	1,20		1,50
15 / 12 N/mm²		1,50				2,00	1,50		2,00


[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Vertical perforated brick HLz, 2DF, EN 771-1:2011+A1:2015

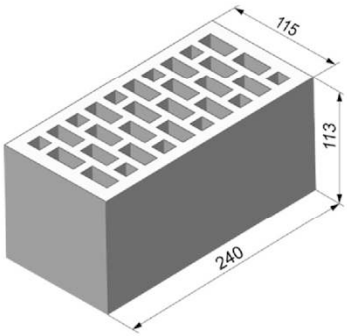

Producer		e.g. Wienerberger		
Nominal dimensions	[mm]	length L	width W	height H
		240	115	113
Mean gross dry density ρ	[kg/dm³]	≥ 1,4		
Mean compressive strength / Min. compressive strength single brick [1)]	[N/mm²]	7,5 / 6 or 12,5 / 10 or 20 / 16 or 25 / 20 or 35 / 28		
Standard or annex		EN 771-1:2011+A1:2015		

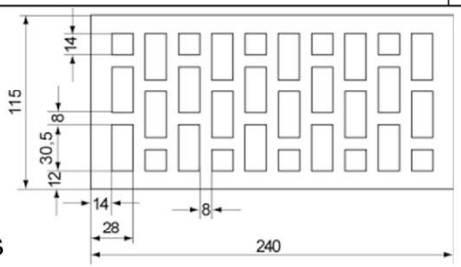

Dimension see also Annex B11

Table C20.1: Installation parameters

Anchor rod		M6	M8	M6	M8	-		M8	M10	-		M12	M16
Internal threaded anchor FIS E		-		-		M6	M8	-		M10	M12	-	
						11x85				15x85			
Perforated sleeve FIS H K		12x50		12x85		16x85				20x85			
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K													
Max. installation torque	$\max T_{inst}$	[Nm]	2										
General installation parameters													
Edge distance	$c_{min} = c_{cr}$	[mm]	80										
Spacing	s_{cr} II = s_{min} II		240										
	$s_{cr} \perp = s_{min} \perp$		115										
Drilling method													
Hammer drilling with hard metal hammer drill													

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C20.2: Group factors

Anchor rod		M6	M8	M6	M8	-		M8	M10	-		M12	M16
Internal threaded anchor FIS E		-		-		M6	M8	-		M10	M12	-	
						11x85				15x85			
Perforated sleeve FIS H K		12x50		12x85		16x85				20x85			
Group factors	$\alpha_{g,N}$ (s_{min} II)	[-]	2										
	$\alpha_{g,V}$ (s_{min} II)												
	$\alpha_{g,N}$ ($s_{min} \perp$)												
	$\alpha_{g,V}$ ($s_{min} \perp$)												

Vertical perforated brick HLz, 2DF, EN 771-1:2011+A1:2015

Table C18.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**-**		**M12**	**M16**
Internal threaded anchor FIS E		**-**		**-**		**M6**	**M8**	**-**		**M10**	**M12**	**-**	
						11x85				**15x85**			
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**20x85**			
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]													
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions												
7,5 / 6 N/mm²	w/w w/d	0,75		0,90		0,75				0,90			
	d/d	0,75		1,20		0,75				0,90			
12,5 / 10 N/mm²	w/w w/d	1,20		1,50		1,20				1,50			
	d/d	1,20		2,00		1,20				1,50			
20 / 16 N/mm²	w/w w/d	2,00		2,50		2,00				2,00			
	d/d	2,00		3,00		2,00				2,50			
25 / 20 N/mm²	w/w w/d	2,50		3,50		2,50				3,00			
	d/d	2,50		4,00		2,50				3,00			
35 / 28 N/mm²	w/w w/d	3,00		5,00		3,50				4,00			
	d/d	3,50		5,50		3,50				4,50			

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C: $N_{Rk\ (72/120°C)} = 0,83 \cdot N_{Rk\ (50/80°C)}$.


Table C18.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**-**		**M12**	**M16**
Internal threaded anchor FIS E		**-**		**-**		**M6**	**M8**	**-**		**M10**	**M12**	**-**	
						11x85				**15x85**			
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**20x85**			
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C													
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions												
7,5 / 6 N/mm²	w/w w/d d/d	1,2	1,5	1,2	2,0	1,2	1,5			2,5			
12,5 / 10 N/mm²		2,0	2,5	2,0	4,0	2,0	2,5			4,5			
20 / 16 N/mm²		3,0	3,5	3,0	6,0	3,0	3,5			7,0			
25 / 20 N/mm²		4,0	4,5	4,0	7,5	4,0	4,5			8,5			
35 / 28 N/mm²		5,0	6,5	5,0	9,5	5,0	6,5			12,0			


[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Vertical perforated brick HLz filled with mineral wool, EN 771-1:2011+A1:2015

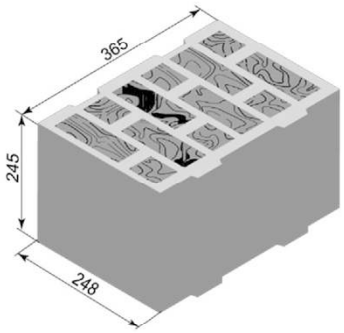

Producer		e.g. Wienerberger		
Nominal dimensions	[mm]	length L	width W	height H
		≥ 365	≥ 248	≥ 245
Mean gross dry density ρ	[kg/dm³]	0,6		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	10 / 8		
Standard or annex		EN 771-1:2011+A1:2015		

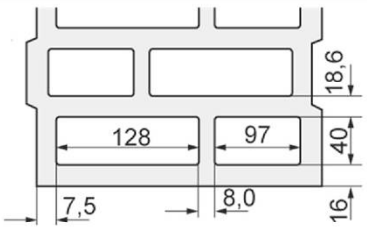

Dimension see also Annex B12

Table C19.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

Anchor rod	**M6**	**M8**	**-**	**M8**	**M10**	**M8**	**M10**	**-**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E	**-**		**M6** **M8** **11x85**	**-**		**-**		**M10** **M12** **15x85**	**-**		**-**	
Perforated sleeve FIS H K	**12x85**		**16x85**			**16x130**		**20x85**			**20x130**	

Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K				
Max. installation torque	$\max T_{inst}$	[Nm]	2	4
General installation parameters				
Edge distance	$c_{min} = c_{cr}$	[mm]	100	
Spacing	$s_{min} \parallel$	[mm]	250	
	$s_{cr} \parallel$	[mm]		
	$s_{min} \perp$	[mm]	245	
	$s_{cr} \perp$	[mm]		
Drilling method				
Hammer drilling with hard metal hammer drill				

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C19.2: Group factors

Anchor rod	**M6**	**M8**	**M8**	**M10**	**M8**	**M10**	**M12**	**M16**	**M12**	**M16**
Perforated sleeve FIS H K	**12x85**		**16x85**		**16x130**		**20x85**		**20x130**	

Group factors	$\alpha_{g,N}(s_{min} \parallel) = \alpha_{g,V}(s_{min} \parallel)$	[-]	2
	$\alpha_{g,N}(s_{min} \perp) = \alpha_{g,V}(s_{min} \perp)$	[-]	

Vertical perforated brick HLz filled with mineral wool, EN 771-1:2011+A1:2015

Table C20.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**		**-**	
				11x85						**15x85**							
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**		**20x200**	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]																	
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions																
10 / 8 N/mm²	w/w	2,0		1,5		2,5				2,0				2,0		3,0	
	d/d	2,0		2,0		3,0				2,0				2,0		3,0	

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C no performance assessed.

Table C20.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading (Pre-positioned installation)


Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**		**-**	
				11x85						**15x85**							
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**		**20x200**	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C [2)]																	
Mean compressive strength / Min. compressive strength single brick [1)]	Use conditions																
10 / 8 N/mm²	w/w	2,5	3,0	3,0				3,0		1,5		1,5		1,5	1,5		
	d/d	2,5	3,0	3,0				3,0		1,5		1,5		1,5	1,5		

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.


[2)] For temperature range 72/120°C no performance assessed.

Factor for job site tests and displacements see annex C28.

Vertical perforated brick HLz, EN 771-1:2011+A1:2015

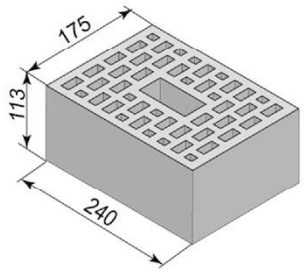

Producer		e.g. Wienerberger		
Nominal dimensions	[mm]	length L	width W	height H
		≥ 240	≥ 175	≥ 113
Mean gross dry density ρ	[kg/dm³]	0,9		
Mean compressive strength / Min. compressive strength single brick [1]	[N/mm²]	12,5 / 10		
Standard or annex		EN 771-1:2011+A1:2015		



Dimension see also Annex B12

Table C21.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

Anchor rod	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E	**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
			11x85						**15x85**					
Perforated sleeve FIS H K	**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	

Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K			
Max. installation torque	$\max T_{inst}$	[Nm]	2 / 4

General installation parameters			
Edge distance	$c_{min} = c_{cr}$	[mm]	100
Spacing	s_{min} ∥		240
	s_{cr} ∥		
	s_{min} ⊥		115
	s_{cr} ⊥		

Drilling method
Hammer drilling with hard metal hammer drill

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C21.2: Group factors

Anchor rod	**M6**	**M8**	**M8**	**M10**	**M8**	**M10**	**M12**	**M16**	**M12**	**M16**
Perforated sleeve FIS H K	**12x85**		**16x85**		**16x130**		**20x85**		**20x130**	

Group factors	$\alpha_{g,N}(s_{min} \parallel) = \alpha_{g,V}(s_{min} \parallel)$	[-]	2
	$\alpha_{g,N}(s_{min} \perp) = \alpha_{g,V}(s_{min} \perp)$		

fischer injection system FIS P Plus for masonry

Performance
Vertical perforated brick HLz, dimensions, installation parameters, Group factors

Annex C21
Appendix 41 / 48

Vertical perforated brick HLz, EN 771-1:2011+A1:2015

Table C22.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading (Pre-positioned installation)

Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
				11x85						**15x85**					
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2)]															
Mean compressive strength/ Min. compressive strength single brick [1)]	Use con-ditions														
12,5 / 10 N/mm²	w/w	3,5		4,0				4,5		4,5				4,0	
	d/d	4		4,5				5,0		5,0				4,0	

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2)] For temperature range 72/120°C no performance assessed.

Table C22.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading (Pre-positioned installation)


Anchor rod		**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		**-**		**M6**	**M8**	**-**		**-**		**M10**	**M12**	**-**		**-**	
				11x85						**15x85**					
Perforated sleeve FIS H K		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C [2)]															
Mean compressive strength / Min. compressive strength single brick [1)]	Use con-ditions														
12,5 / 10 N/mm²	w/w	4,0	5,5	4,0	5,5	5,5	7,0	5,5	7,0	7,0	6,0	6,0	8,0	6,0	8,0
	d/d	4,0	5,5	4,0	5,5	5,5	7,0	5,5	7,0	7,0	6,0	6,0	8,0	6,0	8,0

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.


[2)] For temperature range 72/120°C no performance assessed.

Factor for job site tests and displacements see annex C28.

Light-weight concrete hollow block Hbl, EN 771-3:2011+A1:2015

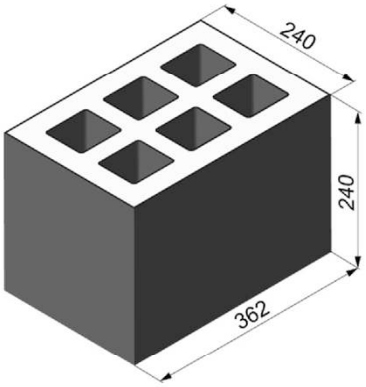

Producer		-		
Nominal dimensions	[mm]	length L	width W	height H
		362	240	240
Mean gross dry density ρ	[kg/dm³]	≥ 1,0		
Mean compressive strength / Min. compressive strength single brick 1)	[N/mm²]	2,5 / 2 or 5 / 4		
Standard or annex		EN 771-3:2011+A1:2015		

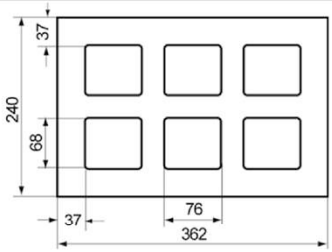

Dimension see also Annex B12

Table C23.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		-		-		**M6**	**M8**	-		-		**M10**	**M12**	-		-		-	
						11x85						**15x85**							
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**		**20x200**	
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K																			
Max. installation torque	max T_{inst}	[Nm]	2																
General installation parameters																			
Edge distance	$c_{min} = c_{cr}$	[mm]	60																
Spacing	s_{min} II		100																
	s_{cr} II		362																
	$s_{min} \perp = s_{cr} \perp$		240																
Drilling method																			
Hammer drilling with hard metal hammer drill																			

1) The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Table C23.2: Group factors

Anchor rod		**M6**	**M8**	**M6**	**M8**	**-**		**M8**	**M10**	**M8**	**M10**	**-**		**M12**	**M16**	**M12**	**M16**	**M12**	**M16**
Internal threaded anchor FIS E		-		-		**M6**	**M8**	-		-		**M10**	**M12**	-		-		-	
						11x85						**15x85**							
Perforated sleeve FIS H K		**12x50**		**12x85**		**16x85**				**16x130**		**20x85**				**20x130**		**20x200**	
Group factors	$\alpha_{g,N}$ (s_{min} II)	[-]	1,2																
	$\alpha_{g,V}$ (s_{min} II)		1,1																
	$\alpha_{g,N}$ ($s_{min} \perp$)		2,0																
	$\alpha_{g,V}$ ($s_{min} \perp$)																		

Light-weight concrete hollow block Hbl, EN 771-3:2011+A1:2015

Table C24.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading (Pre-positioned installation)

Anchor rod	M6	M8	M6	M8	-	M8	M10	M8	M10	-	M12	M16	M12	M16	M12	M16
Internal threaded anchor FIS E	-		-		M6 M8	-		-		M10 M12	-		-		-	
					11x85					15x85						
Perforated sleeve FIS H K	12x50		12x85		16x85			16x130		20x85			20x130		20x200	

$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [2]				
Mean compressive strength / Min. compressive strength single brick [1]	Use conditions			
2,5 / 2 N/mm²	w/w w/d	1,2	1,5	2,5
	d/d	1,2	1,5	2,5
5 / 4 N/mm²	w/w w/d	2,0	3,0	5,0
	d/d	2,5	3,0	5,5

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[2] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.

Table C24.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading (Pre-positioned installation)


Anchor rod	M6	M8	M6	M8	-	M8	M10	M8	M10	-	M12	M16	M12	M16	M12	M16
Internal threaded anchor FIS E	-		-		M6 M8	-		-		M10 M12	-		-		-	
					11x85					15x85						
Perforated sleeve FIS H K	12x50		12x85		16x85			16x130		20x85			20x130		20x200	

$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C		
Mean compressive strength / Min. compressive strength single brick [1]	Use conditions	
2,5 / 2 N/mm²	w/w w/d	0,9
	d/d	
5 / 4 N/mm²	w/w w/d	2,0
	d/d	

[1] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Factor for job site tests and displacements see annex C28.

Autoclaved aerated concrete, EN 771-4:2011+A1:2015



Producer		e.g. Ytong		
Mean gross dry density ρ	[kg/dm³]	0,35	0,5	0,65
Mean compressive strength / Min. compressive strength single brick [1)]	[N/mm²]	2,5 / 2	5 / 4	8 / 6
Standard or annex		EN 771-4:2011+A1:2015		

Table C25.1: Installation parameters

Anchor rod			**M6**		**M8**		**M10**		**M12**		**M16**		-		-	
Internal threaded anchor FIS E			-		-		-		-		-		**M6**	**M8**	**M10**	**M12**
													11x85		**15x85**	
Anchor rod and internal threaded anchor FIS E without perforated sleeve																
Effective anchorage depth	h_{ef}	[mm]	100	200	100	200	100	200	100	200	100	200	85			
Max. installation torque	max T_{inst}	[Nm]	1	4	1	8	2	12	2	16	2	20	1		2	
General installation parameters																
Edge distance	$c_{min} = c_{cr}$	[mm]	100													
Spacing	s_{cr} II = s_{min} II		250													
	h_{ef}=200mm s_{min} II		80													
	h_{ef}=200mm s_{cr} II		3x h_{ef}													
	$s_{cr} \perp = s_{min} \perp$		250													
	h_{ef}=200mm $s_{min} \perp$		80													
	h_{ef}=200mm $s_{cr} \perp$		3x h_{ef}													
Drilling method																
Hammer drilling with hard metal hammer drill																

[1)] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

Autoclaved aerated concrete, EN 771-4:2011+A1:2015

Table C26.1: Group factors for autoclaved aerated concrete (Min. compressive strength single brick = 2 N/mm²)

Anchor rod			M6	M8	M10	M12	M16	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	M6	M8	M10	M12
								11x85		15x85	
Group factors	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ∥)	[-]	1,6					-[1]		-[1]	
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ∥)		1,1					-[1]		-[1]	
	$\alpha_{g,N}$ ∥, $\alpha_{g,V}$ (s_{min} ∥)		2,0								
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ⊥)		1,6					-[1]		-[1]	
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ⊥)		0,8					-[1]		-[1]	
	$\alpha_{g,N}$ ⊥, $\alpha_{g,V}$ (s_{min} ⊥)		2,0								

[1] No performance assessed.

Table C26.2: Group factors for autoclaved aerated concrete (Min. compressive strength single brick = 4 N/mm²)

Anchor rod			M6	M8	M10	M12	M16	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	M6	M8	M10	M12
								11x85		15x85	
Group factors	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ∥)	[-]	0,7					-[1]		-[1]	
	h_{ef}=200 α_{gV} (s_{min} ∥)		2,0					-[1]		-[1]	
	$\alpha_{g,N}$ ∥, α_{gV} (s_{min} ∥)		2,0								
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ⊥)		0,7					-[1]		-[1]	
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ⊥)		1,2					-[1]		-[1]	
	$\alpha_{g,N}$ ⊥, α_{gV} (s_{min} ⊥)		2,0								

[1] No performance assessed.

Table C26.3: Group factors for autoclaved aerated concrete (Min. compressive strength single brick = 6 N/mm²)

Anchor rod			M6	M8	M10	M12	M16	-		-	
Internal threaded anchor FIS E			-	-	-	-	-	M6	M8	M10	M12
								11x85		15x85	
Group factors	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ∥)	[-]	0,7					-[1]		-[1]	
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ∥)		2,0					-[1]		-[1]	
	$\alpha_{g,N}$ ∥, $\alpha_{g,V}$ (s_{min} ∥)		2,0								
	h_{ef}=200 $\alpha_{g,N}$ (s_{min} ⊥)		0,7					-[1]		-[1]	
	h_{ef}=200 $\alpha_{g,V}$ (s_{min} ⊥)		1,2					-[1]		-[1]	
	$\alpha_{g,N}$ ⊥, $\alpha_{g,V}$ (s_{min} ⊥)		2,0								

[1] No performance assessed.

Autoclaved aerated concrete, EN 771-4:2011+A1:2015

Table C27.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

Anchor rod		M6		M8		M10		M12		M16		-		-	
Internal threaded anchor FIS E		-		-		-		-		-		M6	M8	M10	M12
												11x85		15x85	
$N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN]; temperature range 50/80°C [3]															
Mean compressive strength / Min. compressive strength single brick [2]	Use conditions	Effective anchorage depth h_{ef} [mm]													
		100	200	100	200	100	200	100	200	100	200	85			
2,5 / 2 N/mm²	w/w w/d	1,2	1,2	1,5	2,0	1,5	3,0	1,5	3,0	2,0	3,0	1,5		1,5	
	d/d	1,5	3,0	1,5	3,0	1,5	3,5	2,0	4,0	2,0	4,0	1,5		1,5	
5 / 4 N/mm²	w/w w/d	1,2	-[1]	2,0	1,5	2,5	3,5	2,5	3,5	2,0	3,5	2,0		1,5	
	d/d	1,5	-[1]	2,0	3,0	3,0	5,0	2,5	5,0	2,0	5,0	2,0		1,5	
8 / 6 N/mm²	w/w w/d	1,5	-[1]	3,0	2,5	4,5	5,0	4,5	7,0	3,0	8,5	3,5		2,5	
	d/d	1,5	-[1]	3,5	4,0	5,0	7,0	5,0	9,0	3,0	11,5	3,5		2,5	

[1] No performance assessed.

[2] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength.

[3] For temperature range 72/120°C: $N_{Rk\,(72/120°C)} = 0{,}83 \cdot N_{Rk\,(50/80°C)}$.

Table C27.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

Anchor rod		M6		M8		M10		M12		M16		-		-	
Internal threaded anchor FIS E		-		-		-		-		-		M6	M8	M10	M12
												11x85		15x85	
$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN]; temperature range 50/80°C and 72/120°C															
Mean compressive strength / Min. compressive strength single brick [2]	Use conditions	Effective anchorage depth h_{ef} [mm]													
		100	200	100	200	100	200	100	200	100	200	85			
2,5 / 2 N/mm²	w/w w/d d/d	1,2	1,2	1,2	1,2	1,2	1,2	1,5	1,2	1,2	1,2	1,2		1,5	
5 / 4 N/mm²	w/w w/d d/d	2,0	-[1]	2,5	2,0	2,0	2,0	2,5	2,0	2,0	2,0	2,0		2,5	
8 / 6 N/mm²	w/w w/d d/d	2,5	-[1]	3,0	2,5	3,0	3,0	3,5	4,0	4,5	4,5	2,5		3,5	

[1] No performance assessed.

[2] The minimum compressive strength of the single brick must not be less than 80% of the mean compressive strength

Factor for job site tests and displacements see annex C28.

β-factors for job site tests; displacements

Table C28.1: β-factors for job site tests

use conditions		w/w and w/d		d/d	
temperature range [°C]		50/80	72/120	50/80	72/120
Material	Size	β-factors [-]			
solid units	M6	0,55	0,46	0,96	0,80
	M8	0,57	0,51		
	M10	0,59	0,52		
	M12 FIS E 11x85	0,60	0,54		
	M16 FIS E 15x85	0,62	0,52		
	FIS H 16x85 K	0,55	0,46		
hollow units	all sizes	0,86	0,72	0,96	0,80
Autoclaved aerated concrete cylindrical drill hole	all sizes	0,73	0,73	0,81	0,81

Table C28.2: Displacements

Material	N /[kN]	δN_0 [mm]	δN_∞ [mm]	V [kN]	δV_0 [mm]	δV_∞ [mm]
solid units and autoclaved aerated concrete h_{ef}=100mm	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,03	0,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	0,82	0,88
hollow units	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,48	0,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,71	2,56
solid brick Mz NF Annex C4 - C7	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,74	1,48	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,23	1,85
solid brick KS NF Annex C8 / C9	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,20	0,40	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	0,91	1,37
AAC h_{ef}=200 mm Annex C25 – C27	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	1,03	2,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,25	1,88

For anchorage in autoclaved aerated concrete (AAC), the partial factor γ_{MAAC} shall be used instead of γ_{Mm}.