



DECLARAȚIA DE PERFORMANȚĂ

DoP 0270

pentru ancore de BCA FPX-I (ancoră metalică expandabilă pentru utilizare în beton celular autoclavizat)

RO

1. Cod unic de identificare al produsului-tip:

DoP 0270

2. Utilizare (utilizări) preconizată (preconizate):

Ancoră post-instalată pentru utilizare în plăci armate fisurate sau nefisurate sau în zidărie din beton cellular autoclavizat, consultați suplimentul, în special anexele B1 - B5.

3. Fabricant:

fischerwerke GmbH & Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Germany

4. Reprezentant autorizat:

-

5. Sistemul (sistemele) de evaluare și de verificare a constantei performantei:

1

6. Documentul de evaluare europeană:

EAD 330014-00-0601

ETA-12/0456; 2019-07-19

DIBt- Deutsches Institut für Bautechnik

Organismul de evaluare tehnică:

Organism (organisme) notificat(e):

2873 TU Darmstadt

7. Performanța (performante) declarată (declarate):

Rezistență mecanică și stabilitate (BWR 1)

Rezistență în orice direcție de încărcare fără braț de levier: Anexa C1

Rezistență la sarcina de forfecare cu braț de levier: Anexa C1

Distanța între ancore, distanța față de margine, grosimea elementului: Anexele B3, B4, C1

Deplasări: Anexa C2

Durabilitate: Anexa B1

Siguranță în caz de incendiu (BWR 2)

Reacție la foc: Clasa A1

Rezistență la foc în orice direcție de încărcare fără braț de levier: Anexa C2

Rezistență la foc la forță de forfecare cu braț de levier: NPD

Distanța între ancore, distanța față de margine pentru rezistență la foc: Anexa C2

8. Documentație tehnică adecvată și/sau documentație tehnică specifică: **-**

Performanța produsului identificat mai sus este în conformitate cu setul de performanțe declarate. Această declarație de performanță este eliberată în conformitate cu Regulamentul (UE) nr. 305/2011, pe răspunderea exclusivă a fabricantului identificat mai sus.

Semnată pentru și în numele fabricantului de către:

Dr.-Ing. Oliver Geibig, Director Executiv Departament Business & Inginerie
Tumlingen, 2021-01-15

Jürgen Grün, Director Executiv Departament Chimic & Calitate

Această declarație de performanță a fost întocmită în mai multe limbi. În cazul unei divergențe de interpretare, versiunea în limba engleză prevalează întotdeauna.

Suplimentul include informații voluntare și complementare în limba engleză, în afara cerințelor legale (specificate neutră din punct de vedere al limbii).

Specific Part

1 Technical description of the product

The fischer aircrete anchor FPX-I is a deformation controlled expansion anchor made of galvanised steel. The anchor consists of an internal threaded socket, a cone bolt and an expansion sleeve. The anchor transfers loads into autoclaved aerated concrete via mechanical interlock.

The anchor is set into a predrilled bore hole and anchored with a hexagon installation tool until the installation tool is pushed out of the internal hexagon socket. The fixture is installed with a screw-in part (threaded rods or screw).

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Resistance in any load direction without lever arm	See Annex C 1
Resistance in any load direction with lever arm	See Annex C 1
Spacing, edge distance, member thickness	See Annex B 3 and B 4
Displacements	See Annex C 2
Durability	Durability is ensured if the specifications of intended use according to Annex B are taken into account.

3.2 Safety in case of fire (BWR 2)


Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 2

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base


In accordance with European Assessment Document EAD No. 330014-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1

Product description

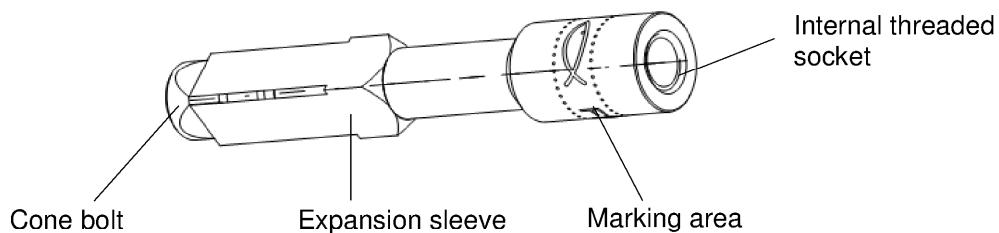

Product installed

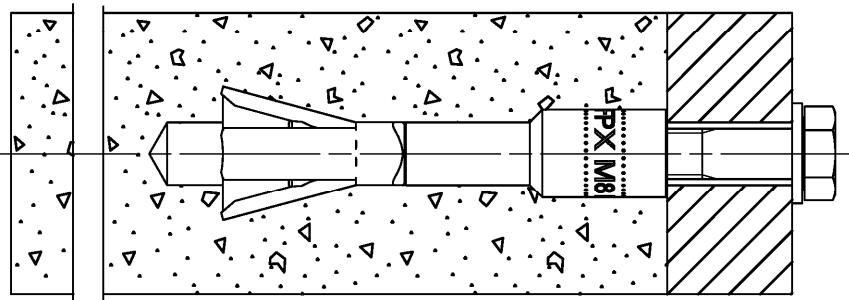

Product label


Product label, example: FPX-I M8

Brand | type of fastener Thread size / identification

Product dimensions

Table A1.1: Dimension [mm]

Anchor type	FPX-I			
Internal thread	M6	M8	M10	M12
Anchor length L			75	
Diameter head internal threaded socket $\varnothing D$		14		16
Diameter cone bolt $\varnothing d_c$			11	

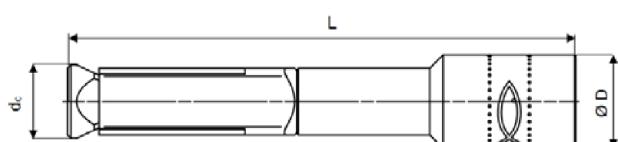

fischer aircrete anchor FPX-I

Product description

Description, label and dimension

Annex A 1

Specifications of intended use

fischer aircrete anchor FPX-I	M6	M8	M10	M12
Galvanized steel				
Static and quasi-static loads				
Cracked and uncracked Autoclaved Aerated Concrete (AAC)				
Fire exposure in reinforced slabs according to EN 12602:2016 of strength class $f_{AAC} \geq 3,3 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,50 \text{ kg/dm}^3$ and strength class $f_{AAC} \geq 4,4 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,55 \text{ kg/dm}^3$			✓	

Base material:

- Cracked reinforced slabs (uncracked slabs are included) according to EN 12602:2016 of strength class $f_{AAC} \geq 3,3 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,50 \text{ kg/dm}^3$ and strength class $f_{AAC} \geq 4,4 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,55 \text{ kg/dm}^3$
- Uncracked reinforced slabs according to EN 12602:2016 of strength class $f_{AAC} \geq 1,6 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,25 \text{ kg/dm}^3$ and strength class $f_{AAC} \geq 6,0 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,65 \text{ kg/dm}^3$
- Masonry units according to EN 771-4:2011+A1:2015 of strength class $f_{AAC} \geq 1,6 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,25 \text{ kg/dm}^3$ and strength class $f_{AAC} \geq 6,0 \text{ N/mm}^2$ with dry density $\rho_m \geq 0,65 \text{ kg/dm}^3$
- The mortar strength class of the masonry has to be M 2,5 according to EN 998-2:2017 at minimum

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (FPX-I)

Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete and masonry work
- Verifiable calculation notes and drawings are to be prepared taking account in the loads to be anchored. The position of the anchor is to be indicated on the design drawings
- Design of fastenings according to TR 054, Design Method B.

Table B1.1: Material

Designation	FPX-I
Cone bolt ¹⁾	Steel EN 10263:2018
Expansion sleeve ¹⁾	Steel EN 10277:2018
Internal threaded bolt ¹⁾	Steel EN 10277:2018
Screw-in-parts ^{1, 2)}	Minimum steel strength class 4,8, DIN EN ISO 898-1:2013

¹⁾ Galvanized according to EN ISO 4042:2018, $\geq 5 \mu\text{m}$

²⁾ Screw-in parts (screws and threaded rods including nuts and washer) must comply with the specification in Annex C1.

fischer aircrete anchor FPX-I

Intended use
Specifications


Annex B 1

Table B2.1: Installation parameters

Size	FPX-I			
	M6	M8	M10	M12
Nominal drill hole diameter	d_0	=		10
Maximum drill bit diameter	d_{cut}	\leq		10,45
Depth of drill hole to deepest point	h_1	\geq	[mm]	
	with cleaning ¹⁾		80	
	without cleaning		95	
Diameter of clearance hole in the fixture	d_f	\leq		7 9 12 14
Effective embedment depth	h_{ef}	=		70
Maximum fastening torque ²⁾	T_{max}	[Nm]		3
Screw-in depth internal thread	$l_{s,min}$	[mm]	6 8 10 12	
	$l_{s,max}$			15

¹⁾ For member thickness $h < 120$ mm the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall

²⁾ If the anchor cannot retain against the fixture no installation torque may be applied ($T_{max} = 0$ Nm)

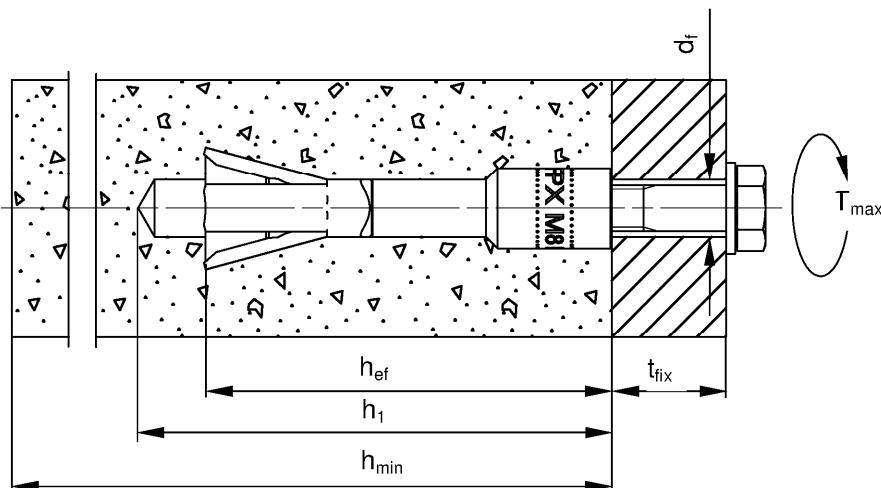

- h_{ef} = Effective embedment depth
- t_{fix} = Thickness of fixture
- h_1 = Depth of drill hole to deepest point
- h_{min} = Minimum thickness of AAC member
- T_{max} = Maximum setting torque
- d_f = Diameter of clearance hole in the fixture

fischer aircrete anchor FPX-I

Intended use
Installation parameters

Annex B 2

Table B3.1: Minimum member thickness, minimum spacing and edge distance in AAC - slabs

Size	FPX-I			
	M6	M8	M10	M12
Minimum thickness of AAC - slab	with cleaning ¹⁾ without cleaning	h_{min}		
Minimum spacing		s_{min}		
Minimum edge distance	single anchor ²⁾ anchor groups ³⁾	c_1	[mm]	
Minimum edge distance, orthogonal to c_1		c_2		
Minimum spacing between	single anchors anchors groups ^{3) 4)}	a		


¹⁾ For member thickness $h < 120$ mm the drill dust has to be cleaned out of the hole and the depth of the drill hole has to be reduced to 80 mm in order to avoid damage on the opposite side of the slab

²⁾ Maximum 2 single anchors in the same formation as anchor groups. For 2 single anchors with spacing smaller than 600 mm ($s_{min} \geq 100$ mm) the same spacing in between and edge distances ($a; c_1$) like for the anchor group are valid

³⁾ For exclusive tension loads the spacing and edge distances for groups can be reduced to the spacing and edge distances of single anchors

⁴⁾ If there is no (free) edge, or the edge distance is $\geq a$, the spacing between anchor groups can be reduced to the spacing between single anchors

⁵⁾ The edge distance of reinforced slabs with a width ≤ 700 mm has to be ≥ 150 mm

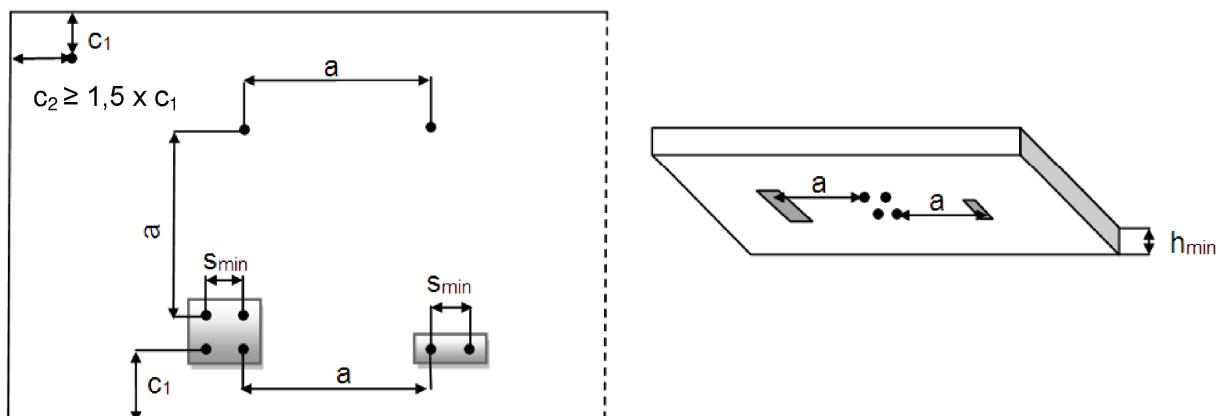

fischer aircrete anchor FPX-I

Intended use

Minimum member thickness, minimum spacing and edge distance in AAC slabs

Annex B 3

Table B4.1: Minimum member thickness, minimum spacing and edge distance in AAC - masonry

Size	FPX-I			
	M6	M8	M10	M12
Minimum thickness of AAC - masonry	[mm]	100		
with cleaning ¹⁾		120		
without cleaning		100		
Minimum spacing		0 ⁵⁾ / 75 ⁶⁾ / 125 ⁷⁾		
Minimum distance to non-filled joints, single anchor		125		
Minimum edge distance		250		
Minimum edge distance, orthogonal to c_1		$1,5 \times c_1$		
Minimum spacing between anchors groups ^{3) 4)}		375		750

¹⁾ For member thickness $h < 120$ mm, the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall

²⁾ Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than 375 mm ($s_{min} \geq 100$ mm) the same spacing in between and edge distances (a ; c_1) like for the anchor group are valid


³⁾ For exclusive tension loads the spacing and edge distances of anchor groups can be reduced to the spacing and edge distances of single anchors

⁴⁾ If there is no edge, or the edge distance is $\geq a$, the spacing between anchor groups can be reduced to the spacing between single anchors

⁵⁾ For joints completely filled with mortar and a joint width ≤ 12 mm and a compressive strength according to EN 998-2 $\geq f_{AAC}$ AAC no distances to joints are required

⁶⁾ c_F for only tension and /or shear loads parallel to the joints which are not filled with mortar and a joint width ≤ 2 mm

⁷⁾ $c_F = c_1$ for shear load or with a part of the load orthogonal to the joint which are not filled with mortar and a joint width ≥ 0 mm

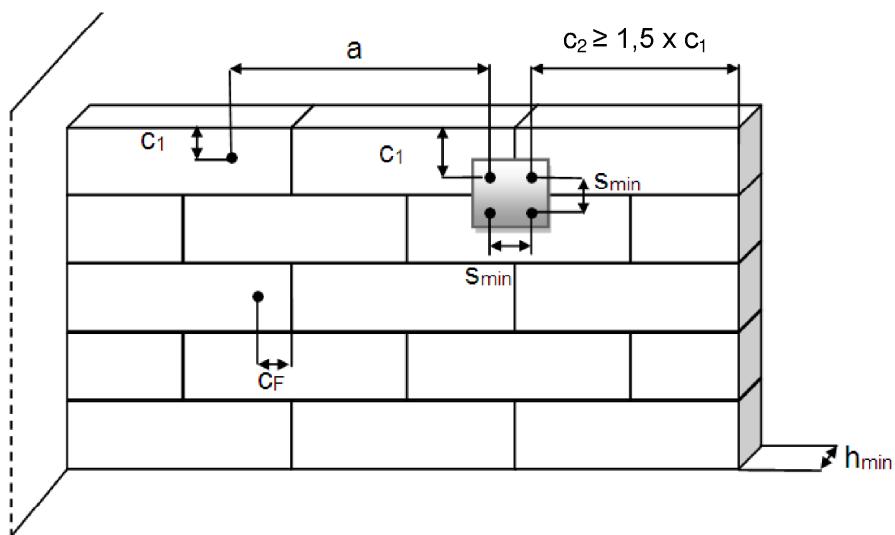

fischer aircrete anchor FPX-I


Intended use

Minimum member thickness, minimum spacing and edge distance in AAC masonry


Annex B 4

Installation instruction


- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
 - Use of the anchor only as supplied by the manufacturer without exchanging the components of the anchor
 - Checking before placing the anchor to ensure that the strength class of the aircrete in which the anchor is to be placed is in the range given and is not lower than that of the aircrete to which the characteristic loads apply
 - Drill hole created perpendicular +/- 5° to AAC surface, positioning without damaging the reinforcement
 - In case of aborted hole: New drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with non-shrinkage, high strength mortar (pressure strength $\geq 30 \text{ N/mm}^2$) and if under shear or oblique tension load it is not the direction of the load application



1: Drill the hole. Other methods like punching, to make the hole, are allowed. When the AAC is covered with a hard layer like tiles, the tile has to be drilled with minimum diameter of the head of the internal threaded bolt $\varnothing D$



2: Set the fastener until it is flush with the surface of the AAC




3: Turning the internal thread bolt with the hexagon (approximately 15 turnings are required)




Setting tool for FPX-I M6




Setting tool for FPX-I M8 – M12



4: By turning the internal thread bolt, the cone is driven into the expansion sleeve. When the optimal expansion is reached, the hexagon is thrown out of the socket. **The turning of the internal thread bolt until the hexagon is thrown out of the socket is compulsory** if tightening is impossible the anchor cannot be loaded



5a: Optional tightening the fastener with a torque $T_{\max} \leq 3$ Nm. The anchor could be pulled against the fixture depending on the compressive strength of the AAC.



5b: If the anchor cannot support against the fixture (with cover layer) no installation torque may be applied ($T_{max} = 0$)

fischer aircrete anchor EPX-I

Intended use

Intended use

Annex B 5

Table C1.1: Characteristic resistance for all load directions

Size	F_{Rk} [kN]	FPX-I					
		M6	M8	M10	M12		
Single anchor in AAC - slabs¹⁾							
Characteristic resistance in cracked AAC - slabs	$f_{AAC} \geq 3,3, \rho_m \geq 0,50$				1,5		
					2,0		
Characteristic resistance in uncracked AAC - slabs	$f_{AAC} \geq 4,4, \rho_m \geq 0,55$				2,0		
					3,0		
Partial safety factor for AAC - slabs	γ_{MAAC} ²⁾				1,73		
Single anchor in AAC - masonry¹⁾							
Characteristic resistance in AAC - masonry ³⁾	$f_{AAC} \geq 1,6, \rho_m \geq 0,25$				0,9		
					1,2		
Intermediate values by linear interpolation	$f_{AAC} \geq 4,0, \rho_m \geq 0,50$				2,5		
					4,0		
Partial safety factor for AAC - masonry	γ_{MAAC} ²⁾				2,0		
Single anchor in AAC - slabs and AAC - masonry¹⁾							
Characteristic bending resistance with lever arm in combination with screw / threaded rod complying with:	ISO 898-1: 2013	$M_{Rk,s}$ [Nm]	4,8	6	15		
			5,8	8	19		
Characteristic bending resistance with lever arm in combination with screw / threaded rod complying with:			6,8	9	23		
			8,8	12	30		
Partial safety factor for steel failure		γ_{Ms}			1,25		
Anchor groups in cracked and uncracked AAC - slabs and AAC - masonry with n = 2 to n = 4 anchors³⁾							
Characteristic resistance for n = 2, n = 4 ⁴⁾ $s_{min} \geq 100$ mm, $c_1 \geq 250$ mm ⁵⁾	$F_{Rk,n}$ [kN]				2 x F_{Rk}		
					$n \times F_{Rk}$		
Characteristic resistance for n ≥ 3 $s_{min} \geq 140$ mm, $c_{min, anchor group} \geq 700$ mm ⁵⁾							
Characteristic resistance redundancy when the joints are not visible ⁵⁾	$F_{Rk,n,Redundancy}$				0,5 x $F_{Rk,n}$		
Partial safety factor for AAC - slabs	γ_{MAAC} ²⁾				1,73		
Partial safety factor for AAC - masonry	γ_{MAAC} ²⁾				2,0		
¹⁾ Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than a ($s_{min} \geq 100$ mm) the characteristic resistance of the anchor group is decisive							
²⁾ The installation safety factor $\gamma_2 = 1,0$ is included							
³⁾ The evaluation of $N_{Rk,pb}$ according to TR 054, Section 4.2.1.5 is necessary. The smaller value of $N_{Rk,pb}$ and F_{Rk} is decisive							
⁴⁾ Rectangular arrangement according to drawing Annex B3 and B4							
⁵⁾ Only for multiple use according to EAD 330747-00-0601							
The characteristic strength class f_{AAC} [N/mm ²] and the characteristic dry density ρ_m [kg/dm ³] have to comply with EN 771-4:2011+A1:2015 for AAC - masonry and EN 12602:2016 for AAC - slabs							
fischer aircrete anchor FPX-I							
Performances Characteristic resistance for all load directions			Annex C 1 Appendix 9 / 10				

Table C2.1: Characteristic resistance for each anchor under fire exposure for all load directions

Size		F _{Rk,fi}	[kN]	FPX-I			
				M6	M8	M10	M12
Characteristic resistance for cracked slabs of strength class $f_{AAC} \geq 3,3, \rho_m \geq 0,50$		R30 R60 R90 R120		0,4			
					0,4		
				0,3		0,4	
					0,3		
Characteristic resistance for cracked slabs of strength class $f_{AAC} \geq 4,4, \rho_m \geq 0,55$		R30 R60 R90 R120		0,5			
				0,4		0,5	
				0,3		0,5	
				0,3		0,4	
Minimum spacing	S _{min,fi}		[mm]	100			
Minimum edge distance	C _{min,fi}		[mm]	C _{min,fi} = 140 for fire exposure from more than one side C _{min,fi} ≥ 300 mm			

It must be ensured that local spalling of the autoclaved aerated concrete cover does not occur.

Table C2.2: Displacement under tension loads, shear loads and oblique loads in AAC ¹⁾

Size			[mm]	FPX-I			
				M6	M8	M10	M12
Displacement tension load in cracked AAC for all AAC strength classes		δ_{N0} $\delta_{N\infty}$		1,0			
					2,0		
Displacement tension load in uncracked AAC for all AAC strength classes		δ_{N0} $\delta_{N\infty}$		1,0			
					1,0		
Displacement shear load in cracked and uncracked AAC $f_{AAC} = 1,6 - \rho_m \geq 0,25$ ²⁾		δ_{V0} $\delta_{V\infty}$		2,5			
					3,7		
Displacement shear load in cracked and uncracked AAC $f_{AAC} \geq 6,0 - \rho_m \geq 0,65$ ²⁾		δ_{V0} $\delta_{V\infty}$		5,0			
					7,3		

¹⁾ Displacement at service load level F_{Rk} / ($\gamma_{AAC} \times 1,4$)

²⁾ Intermediate values by linear interpolation, taking in account the AAC strength

fischer aircrete anchor FPX-I

Performances

Characteristic resistance of a fixing point under fire exposure for all load directions
Displacements under tension, shear loads and oblique loads

Annex C 2

Appendix 10 / 10