



## VYHLÁSENIE O PARAMETROCH

### Dop 0195

pre fischer chemický kotiaci systém FIS VL (Kovové injektážne koty pre použitie v murive)

SK

1. Jedinečný identifikačný kód typu výrobku:

**Dop 0195**

2. Zamýšľané použitie/použitia:

**Dodatačné upevenenie do muriva**

Pozri prílohu, najmä prílohy

**B1- B11**

**fischerwerke GmbH & Co. KG, Klaus-Fischer-Str. 1, 72178 Waldachtal, Germany**

3. Výrobca:

–

4. Splnomocnený zástupca:

–

5. Systém(-v) posudzovania a overovania nemennosti parametrov:

1

6. Európsky hodnotiaci dokument:

**EAD 330076-00-0604, Edition 11/ 2017**

ETA-15/0263; 2020-07-07

**DBIT- Deutsches Institut für Bautechnik**

1343 MPA Darmstadt / 2873 TU Darmstadt

7. Deklarované parametre:

**Mechanická odolnosť a stabilita (BWR 1)**

Charakteristické hodnoty únosnosti:

Redukčný faktor:

Prílohy C27

Charakteristická odolnosť jednej kotvy pri zaťažení ľahom:

Prílohy B3, C1, C3, C5, C7, C9, C11, C13, C15, C17, C19, C21, C23, C25, C26

Charakteristická odolnosť skupiny kotiev pri zaťažení ľahom:

Prílohy B11

Charakteristická odolnosť jednej kotvy pri zaťažení šmykom:

Prílohy B3, C2, C3, C5, C7, C9, C11, C13, C15, C17, C19, C21, C23, C26

Charakteristická odolnosť skupiny kotiev pri zaťažení šmykom bez a s ovplyvnením od okrajov:

Prílohy B11

Charakteristická okrajová a osová vzdialenosť:

Prílohy B11, C4, C6, C8, C10, C12, C14, C16, C18, C20, C22, C24, C25

Minimálna vzdialenosť od okraja a osová vzdialosť:

Prílohy B11, C4, C6, C8, C10, C12, C14, C16, C18, C20, C22, C24, C25

Skupinový faktor pri zaťažení ľahom a šmykom:

Prílohy C4, C6, C8, C10, C12, C14, C16, C18, C20, C22, C24, C25

Minimálne hrúbka základného materiálu:

Prílohy B2

Durabilitate:

Prílohy A5, B2

Deplasări:

Prílohy C27

**Siguranță în caz de incendiu (BWR 2)**

Reactie la foc:

Clasa (A1)

**Igienă, sănătate și mediu (BWR 3)**

Conținutul, emisia și / sau eliberarea de substanțe periculoase:

NPA

8. Vhodná technická dokumentácia a/alebo špecifická - technická dokumentácia:

Uvedené parametre výrobku sú v zhode so súborom deklarovaných parametrov. Toto vyhlásenie o parametroch sa v súlade s nariadením (EÚ) č. 305/2011 vydáva na výhradnú zodpovednosť uvedeného výrobcu.

Podpísal(-a) za a v mene výrobcu:

Thilo Pregartner, Dr.-Ing.  
Tumlingen, 2020-08-04

Peter Schillinger, Dipl.-Ing.

Toto vyhlásenie o vlastnostiach bolo vyhotovené v rôznych jazykoch. V prípade, že dôjde k rozdielnemu výkladu má anglická verzia vždy prednosť.

Príloha obsahuje dobrovoľné a dopĺňujúce informácie v anglickom jazyku. Tieto vychádzajú zo zákonom stanovených požiadaviek (jazykovo neutrálnych).

## **Specific Part**

### **1 Technical description of the product**

The fischer injectionsystem FIS VL for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar fischer FIS VL, FIS VL Low Speed and FIS VL High Speed, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

### **2 Specification of the intended use in accordance with the applicable European Assessment Document**

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### **3 Performance of the product and references to the methods used for its assessment**

#### **3.1 Mechanical resistance and stability (BWR 1)**

<b>Essential characteristic</b>	<b>Performance</b>
Characteristic values for resistance	See Annexes C 1 to C 26
Displacements	See Annex C 27
Durability	See annex B 2

#### **3.2 Safety in case of fire (BWR 2)**

<b>Essential characteristic</b>	<b>Performance</b>
Reaction to fire	Class A1

#### **3.3 Hygiene, health and the environment (BWR 3)**

<b>Essential characteristic</b>	<b>Performance</b>
Content, emission and/or release of dangerous substances	No performance assessed

### **4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**


In accordance with the European Assessment Document EAD 330076-00-0604 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1


## Installation conditions part 1

### Anchor rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

#### Pre-positioned anchorage:

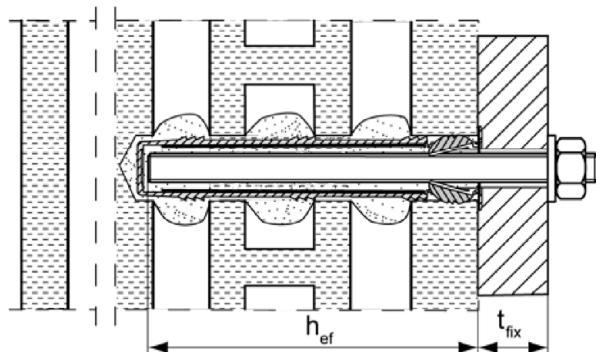

#### Installation with render bridge

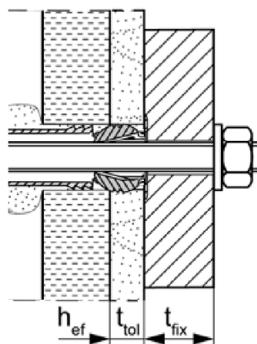

#### Size of the perforated sleeve:

FIS H 12x85 K

FIS H 16x130 K

FIS H 20x130 K

FIS H 16x85 K


FIS H 20x85 K

FIS H 20x200 K


### Internal threaded anchor FIS E with perforated sleeve FIS H K;

### Installation in perforated and solid brick masonry

#### Pre-positioned anchorage:

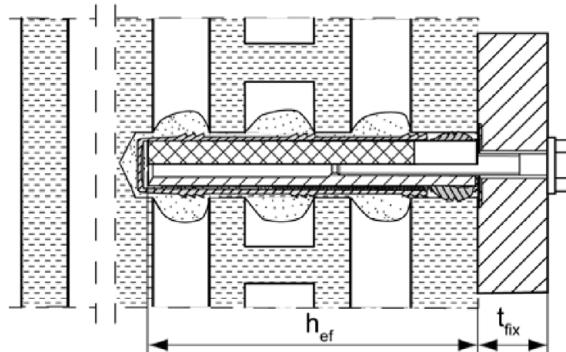

#### Installation with render bridge

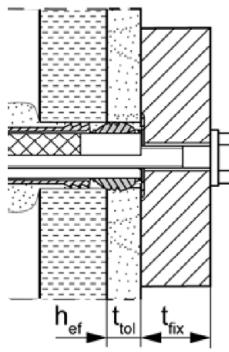

Pictures not to scale

$h_{ef}$  = effective anchorage depth

$t_{tol}$  = thickness of unbearing layer (e.g. plaster)

$t_{fix}$  = thickness of fixture

fischer injection system FIS VL for masonry

#### Product description

Installation conditions part 1, Installation in perforated and solid brick masonry  
Anchor rods and internal threaded anchor with perforated sleeve

#### Annex A 1


Appendix 2/ 44

## Installation conditions part 2



Anchor rods without perforated sleeve FIS H K;

Installation in solid brick masonry and autoclaved aerated concrete

Pre-positioned anchorage:

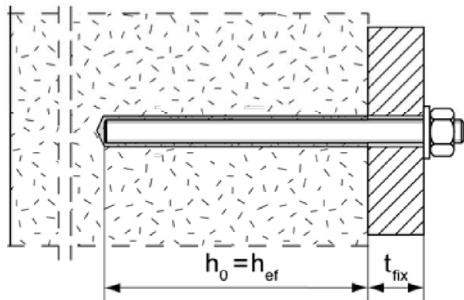

Push through anchorage: Annular gap filled with mortar




Installation with render bridge


Internal threaded anchors FIS E without perforated sleeve FIS H K;

Installation in solid brick masonry and autoclaved aerated concrete

Pre-positioned anchorage:

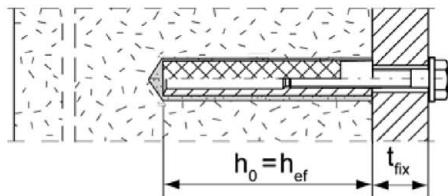

Installation with render bridge

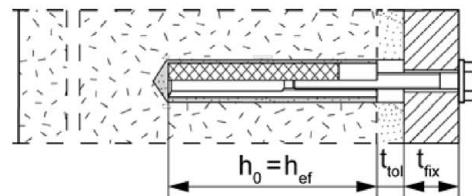

Pictures not to scale

$h_0$  = depth of drill hole

$t_{tol}$  = thickness of unbearing layer (e.g. plaster)

$h_{ef}$  = effective anchorage depth

$t_{fix}$  = thickness of fixture

fischer injection system FIS VL for masonry

### Product description

Installation conditions part 2, Installation in solid brick masonry and autoclaved aerated concrete. Anchor rods and internal threaded anchors without perforated sleeve

### Annex A 2



Appendix 3/ 44

## Overview system components part 1

### Mortar cartridge (shuttle cartridge) with sealing cap

1

Size: 350 ml, 360 ml, 390 ml, 550 ml, 825 ml





**Imprint:** fischer FIS VL or FIS VL Low Speed or FIS VL High Speed, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume



### Mortar cartridge (coaxial cartridge) with sealing cap

1

Size: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml




**Imprint:** fischer FIS VL or FIS VL Low Speed or FIS VL High Speed, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume



### Static mixer MR Plus with extension tube

Static mixer



Extension tube



### Cleaning brush BS



### Blow-out pump ABG or ABP



Pictures not to scale

fischer injection system FIS VL for masonry


#### System description

Overview system components part 1: cartridge / static mixer / cleaning tools

#### Annex A 3

## Overview system components part 2

### fischer anchor rod




Size: M8, M10, M12

### Internal threaded anchor FIS E



Size: 11x85 M6 / M8  
15x85 M10 / M12

### Perforated sleeve FIS H K



Size: FIS H 12x85 K  
FIS H 16x85 K  
FIS H 20x85 K



Size: FIS H 16x130 K  
FIS H 20x130 K  
FIS H 20x200 K

### Washer



### Hexagon nut



Pictures not to scale

fischer injection system FIS VL for masonry

#### System description

Overview system components part 2: steel parts / perforated sleeve

#### Annex A 4

Appendix 5/ 44

**Table A5.1:** Materials

Part	Designation	Material		
1	Mortar cartridge	Mortar, hardener; filler		
		Steel	Stainless steel R	High corrosion-resistant steel HCR
		zinc plated	acc. to EN 10088-1:2014 Corrosion resistance class CRC III acc. to EN 1993-1-4:2015	acc. to EN 10088-1:2014 Corrosion resistance class CRC V acc. to EN 1993-1-4:2015
2	Anchor rod	Property class 4.8; 5.8 or 8.8; EN ISO 898-1: 2013 zinc plated $\geq 5\mu\text{m}$ , EN ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised EN ISO 10684:2004 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation	Property class 50, 70 or 80; EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062; 1.4662; 1.4462; EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation	Property class 50 or 80; EN ISO 3506-1:2009 or property class 70 with $f_{yk} = 560 \text{ N/mm}^2$ 1.4565; 1.4529 EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation
3	Washer ISO 7089:2000	zinc plated $\geq 5\mu\text{m}$ , EN ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised EN ISO 10684:2004	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565; 1.4529 EN 10088-1:2014
4	Hexagon nut	Property class 5 or 8; EN ISO 898-2:2012 zinc plated $\geq 5\mu\text{m}$ , EN ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised ISO 10684:2004	Property class 50, 70 or 80; EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 50, 70 or 80; EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
5	Internal threaded anchor FIS E	Property class 5.8; EN 10277-1:2008-06 zinc plated $\geq 5\mu\text{m}$ , EN ISO 4042:2018 Zn5/An(A2K)	Property class 70; EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
6	Commercial standard screw or threaded rod for internal threaded anchor FIS E	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated $\geq 5\mu\text{m}$ , EN ISO 4042:2018 Zn5/An(A2K)	Property class 70; EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 70; EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
7	Perforated sleeve	PP / PE		

fischer injection system FIS VL for masonry

## Specifications of intended use (part 1)

**Table B1.1:** Overview use and performance categories

		<b>fischer injection system FIS VL for masonry</b>			
Hole drilling with hammer drill mode		all bricks			
Hole drilling with rotary drill mode		all bricks			
Static and quasi static load, in masonry		all bricks			
Use category	dry or wet masonry	all bricks			
Installation	Pre-positioned anchorage	Anchor rod or internal threaded anchor (in solid brick masonry and autoclaved aerated concrete)	Perforated sleeve with anchor rod or internal threaded anchor (in perforated and solid brick masonry) Size: FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K		
	Push through anchorage	Anchor rod (in solid brick masonry and autoclaved aerated concrete)	---		
Installation conditions	category d/d	all bricks			
	category w/d				
	category w/w				
Installation direction	D3 (downward and horizontal and upwards (e.g. overhead) installation)				
Installation temperature	$T_{i,\min} = 0 \text{ }^\circ\text{C}$ bis $T_{i,\max} = +40 \text{ }^\circ\text{C}$				
In-service temperature	Temperature range Tb	-40 °C to +80 °C	(max. short term temperature +80 °C max. long term temperature +50 °C)		
fischer injection system FIS VL for masonry					
<b>Intended Use</b> Specifications (part 1)		<b>Annex B 1</b>			
		Appendix 7 / 44			

## Specifications of intended use (part 2)

### Anchorages subject to:

- Static and quasi-static loads

### Base materials:

- Solid brick masonry (Use category b) and autoclaved aerated concrete (Use category d), acc. to Annex B 10
- Hollow brick masonry (use category c), according to Annex B 10
- For minimum thickness of masonry member is  $h_{ef}+30\text{mm}$
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry and autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 053, Annex B under consideration of the  $\beta$ -factor according to Annex C 27, Table C27.

Note (only applies to solid bricks and autoclaved aerated concrete):

The characteristic resistance is also valid for larger brick sizes, higher compressive strength and higher raw density of the masonry unit.

### Temperature Range:

- **T<sub>b</sub>**: From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)

### Use conditions (Environmental conditions):

- **X1**: Structures subject to dry internal conditions exist  
(zinc coated steel, stainless steel or high corrosion resistant steel)
- **X2**: Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particularly aggressive conditions exist  
(stainless steel or high corrosion resistant steel)
- **X3**: Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particularly aggressive conditions exist (high corrosion resistant steel)

Note: Particularly aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

fischer injection system FIS VL for masonry

**Intended Use**  
Specifications (part2)

**Annex B 2**

Appendix 8/ 44

## Specifications of intended use (part 2 continued)

### Design:

- The anchorages have to be designed in accordance with EOTA Technical Report TR 054, Design method A under the responsibility of an engineer experienced in anchorages and masonry work.

Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,b} = N_{Rk,p}$$

$$V_{Rk} = V_{Rk,b} = V_{Rk,c}$$

For the Calculation of pulling out a brick under tensile load  $N_{Rk,pb}$  or pushing out a brick under shear load  $V_{Rk,pb}$  see EOTA Technical Report TR 054.

$N_{Rk,s}$ ,  $V_{Rk,s}$  and  $M^0_{Rk,s}$  see annex C1-C3

Factors for job site tests and displacements see Annex C27

- Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.

### Installation:

- Category d/d: - Installation and use in dry structures
- Category w/w: - Installation and use in dry and wet structures
- Category w/d: - Installation in wet structures and use in dry structures
- Hole drilling see Annex C (drilling method)
- In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) at perforated brick masonry see Annex B 6, Table B6.1
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or anchor rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E.
- minimum curing time see Annex B 7, Table B7.2
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A 5, Table 5.1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored.

Marking of the anchor rod with the envisaged embedment depth. This may be done by the manufacturer of the rod or by a person on job site.

fischer injection system FIS VL for masonry

**Intended Use**  
Specifications (part2 continued)

**Annex B 3**

Appendix 9/ 44

**Table B4.1:** Installation parameters for anchor rods in solid bricks and autoclaved aerated concrete without perforated sleeves

Anchor rod	Thread	M8	M10	M12
Nominal drill hole diameter	$d_0$ [mm]	10	12	14
Effective anchorage depth $h_{\text{ef}}$ <sup>1)</sup> in AAC	$h_{0,\text{min}}=h_{\text{ef,min}}$ [mm] $h_{0,\text{max}}=h_{\text{ef,max}}$ [mm]		100 200	
Effective anchorage depth $h_{\text{ef}}$ <sup>1)</sup> in solid brick (depth of drill hole $h_0 = h_{\text{ef}}$ )	$h_{\text{ef,min}}$ [mm] $h_{\text{ef,max}}$ [mm]		50 $h-30, \leq 200$	
Diameter of clearance hole in the fixture	pre-position $d_f \leq$ [mm] push through $d_f \leq$ [mm]	9 11	12 14	14 16
Diameter of cleaning brush	$d_b \geq$ [mm]		see Table B7.1	
Maximum installation torque	$T_{\text{inst}}$ [Nm]		see parameters of brick	

<sup>1)</sup>  $h_{\text{ef,min}} \leq h_{\text{ef}} \leq h_{\text{ef,max}}$  is possible.

#### fischer anchor rods M8, M10, M12




#### Marking (on random place) fischer anchor rod:

Steel zinc plated PC <sup>1)</sup> 8.8	• or +	Steel hot-dip PC <sup>1)</sup> 8.8	•
High corrosion resistant steel HCR PC <sup>1)</sup> 50	•	High corrosion resistant steel HCR PC <sup>1)</sup> 70	-
High corrosion resistant steel HCR PC <sup>1)</sup> 80	(	Stainless steel R property class 50	~
Stainless steel R property class 80	*		

Alternatively: Colour coding according to DIN 976-1: 2016

<sup>1)</sup> PC = property class

#### Installation condition:

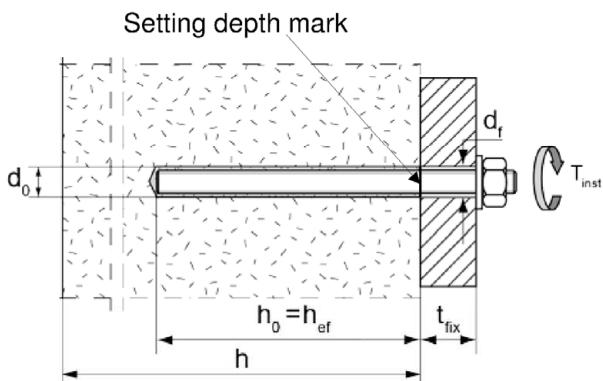

Pictures not to scale

fischer injection system FIS VL for masonry

#### Intended Use


Installation parameters for anchor rods without perforated sleeve

#### Annex B 4

**Table B5.1:** Installation parameters for internal threaded anchors FIS E in solid bricks and autoclaved aerated concrete without perforated sleeves

Internal threaded anchor FIS E	11x85 M6	11x85 M8	15x85 M10	15x85 M12
Diameter of anchor $d_H$ [mm]		11		15
Nominal drill hole diameter $d_0$ [mm]		14		18
Length of anchor $L_H$ [mm]			85	
Effective anchorage depth $h_0 = h_{ef}$ [mm]			85	
Diameter of cleaning brush $d_b \geq$ [mm]			see Table B7.1	
Maximum installation torque $T_{inst}$ [Nm]			see parameters of brick	
Diameter of clearance hole in the fixture $d_f$ [mm]	7	9	12	14
Screw-in depth $l_{E,min}$ [mm]	6	8	10	12
$l_{E,max}$ [mm]			60	


### fischer internal threaded anchor FIS E

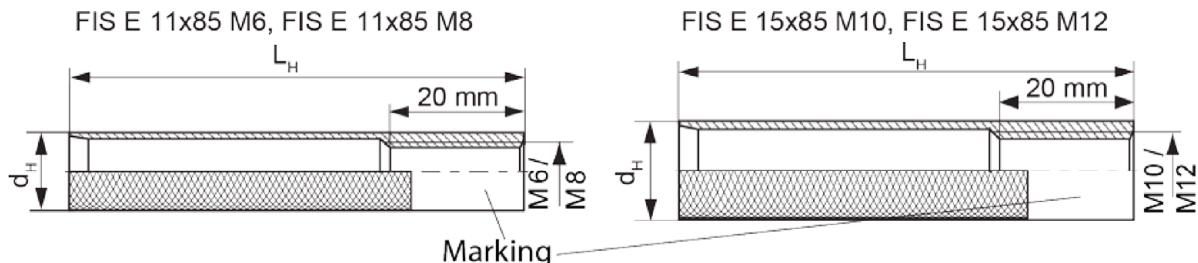

#### Marking:

Size, e.g. **M8**, Stainless steel: R, e.g. **M8 R**, High corrosion-resistant steel: HCR, e.g. **M8 HCR**

### Installation condition:

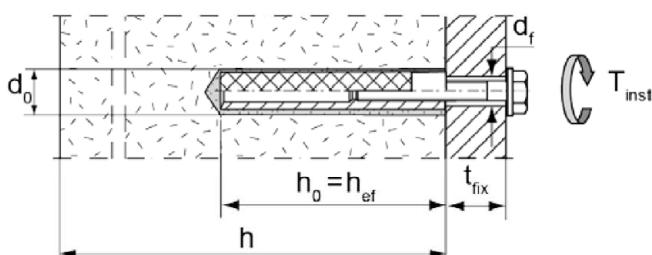

Pictures not to scale

fischer injection system FIS VL for masonry

#### Intended Use

Installation parameters for internal threaded rods FIS E without perforated sleeve

#### Annex B 5

**Table B6.1:** Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeves (pre-positioned anchorage)

perforated sleeve FIS H K	12x85	16x85	16x130 <sup>2)</sup>	20x85	20x130 <sup>2)</sup>	20x200 <sup>2)</sup>
Nominal drill hole diameter $d_0 = D_{\text{ sleeve,nom }}$	12	16		20		
Depth of drill hole	$h_0 [\text{mm}]$	90	90	135	90	135
Effective anchorage depth	$h_{\text{ef,min }} [\text{mm}]$	65	85	110	85	110
	$h_{\text{ef,max }} [\text{mm}]$	85	85	130	85	130
Size of threaded rod	[ - ]	M8	M8 and M10		M12	
Size of internal threaded anchor FIS E	---	11x85	---	15x85	---	---
Diameter of cleaning brush <sup>1)</sup>	$d_b \geq [\text{mm}]$	see Table B7.1				
Maximum installation torque	$T_{\text{inst }} [\text{Nm}]$	see parameters of brick				

<sup>1)</sup> Only for solid areas in hollow bricks and solid bricks.



<sup>2)</sup> Bridging of unbearing layer (e.g. plaster) is possible. When reducing the effective anchorage depth  $h_{\text{ef,min }}$ , the values of the next shorter perforated sleeve of the same diameter must be used. The smaller value of characteristic resistance must be taken.

### Perforated sleeve

FIS H 12x85 K; FIS H 16x85 K; FIS H 16x130 K;  
FIS H 20x85 K; FIS H 20x130 K; FIS H 20x200 K


#### Marking:

Size  $D_{\text{ sleeve,nom }}$  x  $L_{\text{ sleeve }}$   
(e.g.: 16x85)

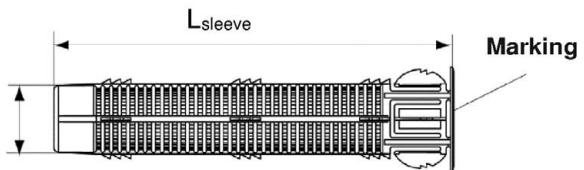


### fischer internal threaded anchor FIS E

FIS E 11x85 M6, FIS E 11x85 M8

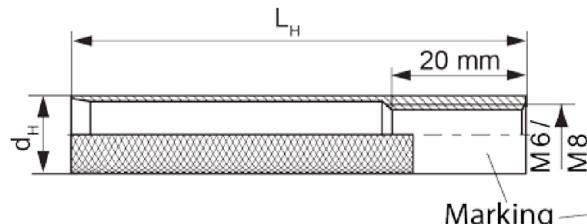


FIS E 15x85 M10, FIS E 15x85 M12

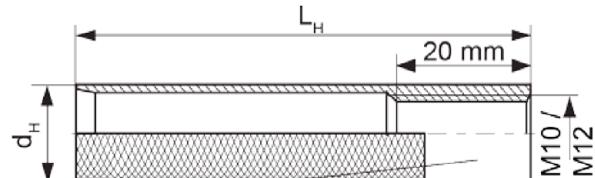


### Installation conditions:

#### Anchor rod with perforated sleeve

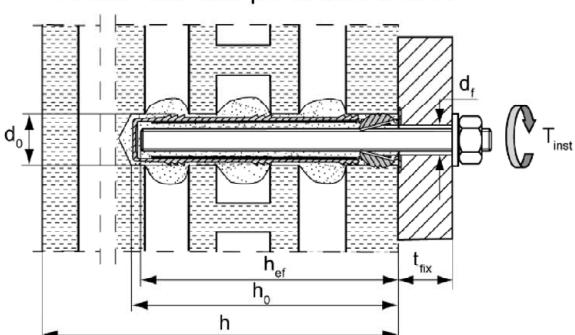

#### Internal threaded anchor with perforated sleeve

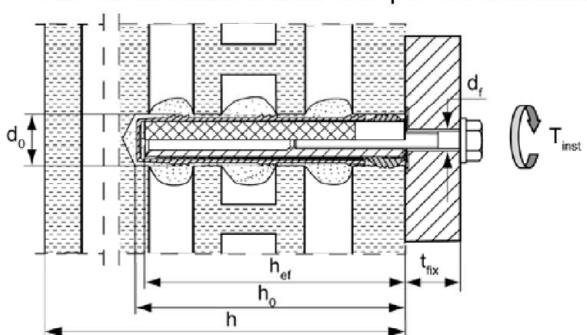

Pictures not to scale

### fischer injection system FIS VL for masonry

#### Intended Use


Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeve (pre-positioned anchorage)

#### Annex B 6

**Table B7.1:** Parameters of the cleaning brush BS (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

Drill hole diameter	$d_0$ [mm]	10	12	14	16	18	20
Brush diameter	$d_b$ [mm]	11	14	16	20	20	25

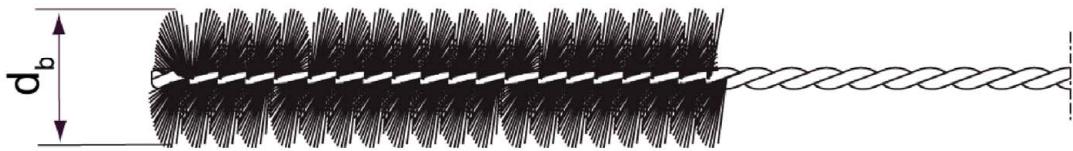

Only for solid bricks and autoclaved aerated concrete

**Table B7.2:** Maximum processing times and minimum curing times

(During the curing time of the mortar the masonry temperature may not fall below the listed minimum temperature)

Temperature at anchoring base [°C]	Maximum processing time $t_{work}$			Minimum curing time <sup>1)</sup> $t_{cure}$		
	FIS VL High Speed <sup>3)</sup>	FIS VL <sup>2)</sup>	FIS VL Low Speed <sup>2)</sup>	FIS VL High Speed <sup>3)</sup>	FIS VL <sup>2)</sup>	FIS VL Low Speed <sup>2)</sup>
> 0 to 5	5 min	13 min	20 min	90 min	3 h	6 h
> 5 to 10	3 min	9 min	20 min	45 min	90 min	3 h
> 10 to 20	1 min	5 min	10 min	30 min	60 min	2 h
> 20 to 30	-	4 min	6 min	-	45 min	60 min
> 30 to 40	-	2 min	4 min	-	35 min	30 min

<sup>1)</sup> For wet bricks the curing time must be doubled<sup>2)</sup> Minimum cartridge temperature +5°C<sup>3)</sup> Minimum cartridge temperature ±0°C

Pictures not to scale

fischer injection system FIS VL for masonry

**Intended use**

Cleaning brush (steel brush)

Maximum processing times and minimum curing times

**Annex B 7**

## Installation instruction part 1

Installation in solid brick and autoclaved aerated concrete (without perforated sleeve)

1		Drill the hole (drilling method see Annex C of the respective brick) depth of drill hole $h_0$ and drill hole diameter $d_0$ see <b>Table B4.1; B5.1</b>		
2				Blow out the drill hole twice. Brush twice and blow out twice again.
3		Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible)		
4		Place the cartridge into a suitable dispenser		Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of.
5		Fill approximately 2/3 of the drill hole with mortar beginning from the bottom of the hole <sup>1)</sup> . Avoid bubbles!		For push through anchorage (not FIS E) fill the annular clearance with mortar.
6		Only use clean and oil-free metal parts. Mark the anchor rod for setting depth. Insert the anchor rod or internal threaded anchor FIS E by hand using light turning motions. When reaching the setting depth marking, excess mortar must emerge from the mouth of the drill hole.		
7		Do not touch. Minimum curing time see Table B7.2		Mounting the fixture. $T_{inst}$ see parameter of brick.

<sup>1)</sup> Exact volume of mortar see manufacturer's specification.








fischer injection system FIS VL for masonry

**Intended use**  
Installation instruction (without perforated sleeve) part 1

**Annex B**

## Installation instruction part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage)

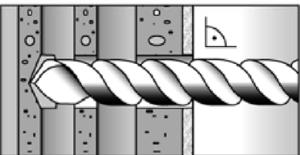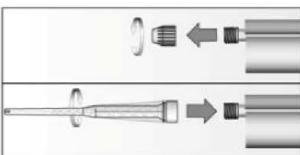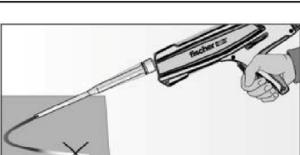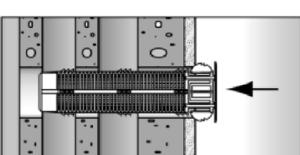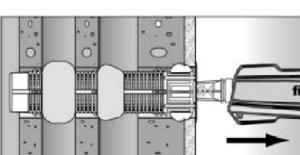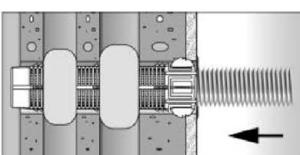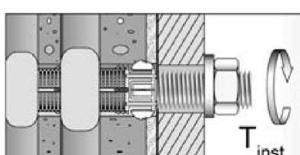
1		Drill the hole (drilling method see Annex C of the respective brick). depth of drill hole $h_0$ and drill hole diameter $d_0$ see <b>Table B6.1</b>	When install perforated sleeves in solid bricks or solid areas of hollow bricks, also clean the hole by blowing out and brushing.
2		Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible)	
3		Place the cartridge into a suitable dispenser.	 Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of.
4		Insert the perforated sleeve flush with the surface of the masonry or plaster.	 Fill the perforated sleeve completely with mortar beginning from the bottom of the hole <sup>1)</sup> .
5		Only use clean and oil-free metal parts. Mark the anchor rod for setting depth. Insert the anchor rod or the internal threaded anchor FIS E by hand using light turning motions until reaching the setting depth marking (anchor rod) or flush with the surface (internal threaded anchor).	
6		Do not touch. Minimum curing time see <b>Table B7.2</b>	 Mounting the fixture. $T_{inst}$ see parameter of brick.

<sup>1)</sup> Exact volume of mortar see manufacturer's specification.

**Table B10.1:** Overview of controlled bricks

Kind of masonry	Brick format [mm]	Compressive strength $f_b$ [N/mm <sup>2</sup> ]	Density $\rho$ [kg/dm <sup>3</sup> ]	Annex
<b>Solid brick Mz</b>				
<b>Solid brick Mz</b>	<b>NF</b>	240x115x71	$\geq 12$ or 20	$\geq 1,8$
<b>Solid sand- lime brick KS / perforated Sand- lime brick KSL</b>				
<b>Solid sand – lime brick KS</b>	<b>NF</b>	240x115x71	$\geq 12$ or 20	$\geq 1,8$
		240x115x113	$\geq 10$ or 20	$\geq 1,8$
<b>Perforated sand - lime brick KSL</b>	<b>3DF</b>	240x175x113	$\geq 12$ or 20	$\geq 1,4$
<b>Vertical perforated brick HLz</b>				
<b>Vertical perforated brick HLz</b>		240x175x113	$\geq 10$	$\geq 0,9$
	<b>2DF</b>	240x115x113	$\geq 20$	$\geq 1,4$
		500x175x237	$\geq 10$	$\geq 1,0$
		370x240x237	$\geq 10$	$\geq 1,0$
		370x250x245	$\geq 8$	$\geq 0,6$
<b>Light-weight concrete hollow block Hbl</b>				
<b>Light-weight concrete hollow block Hbl</b>		362x240x240	$\geq 4$	$\geq 1,0$
<b>Autoclaved aerated concrete (AAC)</b>				
<b>PP2 / AAC</b>			$\geq 2$	$\geq 0,35$
<b>PP4 / AAC</b>		500x300x250	$\geq 4$	$\geq 0,5$
<b>PP6 / AAC</b>			$\geq 6$	$\geq 0,65$
fischer injection system FIS VL for masonry				
<b>Intended use</b> Overview of controlled bricks				<b>Annex B 10</b>
Appendix 16/ 44				

## Spacing and edge distance

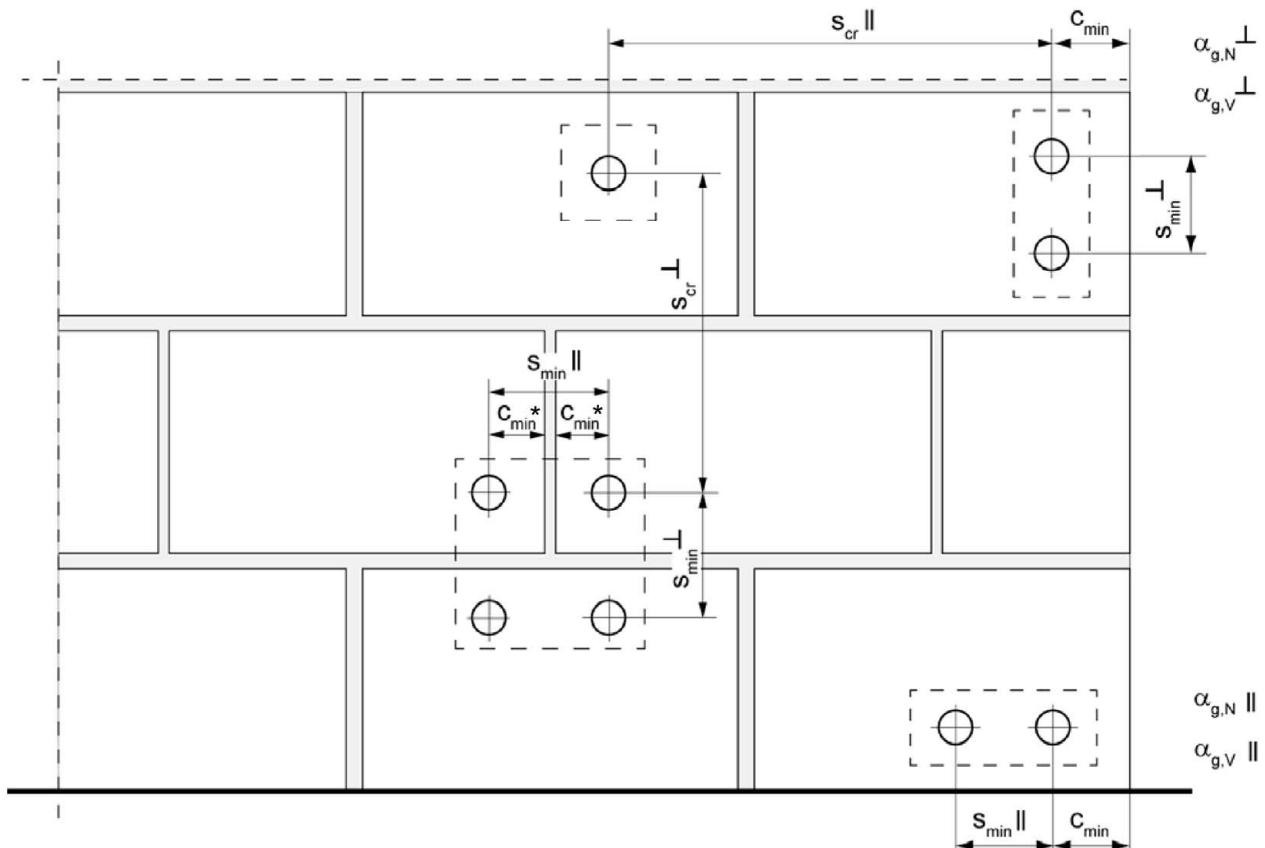

\* Only, if vertical joints are not completely filled with mortar

$s_{\min \parallel}$	= Minimum spacing parallel to bed joint
$s_{\min \perp}$	= Minimum spacing vertical to bed joint
$s_{cr \parallel}$	= Characteristic spacing parallel to bed joint
$s_{cr \perp}$	= Characteristic spacing vertical to bed joint
$c_{cr} = c_{min}$	= Edge distance
$\alpha_{g,N \parallel}$	= Group factor for tensile load, anchor group parallel to bed joint
$\alpha_{g,V \parallel}$	= Group factor for shear load, anchor group parallel to bed joint
$\alpha_{g,N \perp}$	= Group factor for tensile load, anchor group vertical to bed joint
$\alpha_{g,V \perp}$	= Group factor for shear load, anchor group vertical to bed joint

For  $s \geq s_{cr}$   $\alpha_g = 2$

For  $s_{\min} \leq s < s_{cr}$   $\alpha_g$  according to installation parameters of brick

$$N^g_{Rk} = \alpha_{g,N} \cdot N_{Rk}; \quad V^g_{Rk} = \alpha_{g,V} \cdot V_{Rk} \quad (\text{Group of 2 anchors})$$

$$N^g_{Rk} = \alpha_{g,N \parallel} \cdot \alpha_{g,N \perp} \cdot N_{Rk}; \quad V^g_{Rk} = \alpha_{g,V \parallel} \cdot \alpha_{g,V \perp} \cdot V_{Rk} \quad (\text{Group of 4 anchors})$$

**Table C1.1:** Characteristic values for the **steel bearing capacity** of **anchor rods** under tensile load

Anchor rod		M8	M10	M12
<b>Bearing capacity under tensile load, steel failure</b>				
Characteristic resistance $N_{Rk,s}$	Property class	4.8	15(13)	23(21)
		5.8	19(17)	29(27)
		8.8	29(27)	47(43)
		50	[kN]	19
		70	26	41
		80	30	47
				68
<b>Partial factors <sup>1)</sup></b>				
$\gamma_{Ms,N}$	Property class	4.8		1,50
		5.8		1,50
		8.8		1,50
		50		2,86
		70		1,50 <sup>2)</sup> / 1,87
		80		1,60

<sup>1)</sup> In absence of other national regulations

<sup>2)</sup> Only for fischer FIS A made of high corrosion-resistant steel HCR

<sup>3)</sup> Values in brackets are valid for undersized threaded rods with smaller stress area  $A_s$  for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009.

fischer injection system FIS VL for masonry

#### Performance

Characteristic steel bearing capacity of anchor rods under tensile load

#### Annex C 1


**Table C2.1:** Characteristic values for the **steel bearing capacity** of **anchor rods** under shear load

Anchor rod		M8	M10	M12		
<b>Bearing capacity under shear load, steel failure</b>						
<b>without lever arm</b>						
Characteristic resistance $V_{Rk,s}$	Property class	4.8	[kN]	9(8)		
		5.8		14(13)		
		8.8		20		
		50		11(10)		
		70		17(16)		
		80		25		
		15(13)		34		
<b>with lever arm</b>						
Characteristic resistance $M^0_{Rk,s}$	Property class	4.8	[Nm]	15(13)		
		5.8		30(27)		
		8.8		52		
		50		19(16)		
		70		37(33)		
		80		65		
		30(26)		105		
<b>Partial factors<sup>1)</sup></b>						
Partial factors $\gamma_{Ms,V}$	Property class	4.8	[-]	1,25		
		5.8		1,25		
		8.8		1,25		
		50		2,38		
		70		1,25 <sup>2)</sup> / 1,56		
		80		1,33		
1) In absence of other national regulations						
2) Only for fischer FIS A made of high corrosion-resistant steel HCR						
3) Values in brackets are valid for undersized threaded rods with smaller stress area $A_s$ for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009.						
fischer injection system FIS VL for masonry						
<b>Performance</b> Characteristic steel bearing capacity of anchor rods under shear load				<b>Annex C 2</b>		
				Appendix 19/ 44		

**Table C3.1:** Characteristic values for the **steel bearing capacity** of internal threaded anchors FIS E under tensile / shear load

fischer internal threaded anchor FIS E			M6	M8	M10	M12				
<b>Bearing capacity under tensile load, steel failure</b>										
Characteristic resistance with screw $N_{Rk,s}$	Property class	5.8	[kN]	10	18	29				
	Property class 70	R		14	26	41				
		HCR		14	26	41				
<b>Partial factors<sup>1)</sup></b>										
Partial factor $\gamma_{Ms,N}$	Property class	5.8	[-]	1,50						
	Property class 70	R		1,87						
		HCR		1,87						
<b>Bearing capacity under shear load, steel failure</b>										
<b>without lever arm</b>										
Characteristic resistance with screw $V_{Rk,s}$	Property class	5.8	[kN]	5	9	15				
	Property class 70	R		7	13	20				
		HCR		7	13	20				
<b>with lever arm</b>										
Characteristic resistance $M_{Rk,s}^0$	Property class	5.8	[Nm]	8	19	37				
	Property class 70	R		11	26	52				
		HCR		11	26	52				
<b>Partial factors<sup>1)</sup></b>										
Partial factor $\gamma_{Ms,V}$	Property class	5.8	[-]	1,25						
	Property class 70	R		1,56						
		HCR		1,56						
<sup>1)</sup> In absence of other national regulations										
fischer injection system FIS VL for masonry										
<b>Performance</b> Characteristic steel bearing capacity of fischer internal threaded anchor FIS E					<b>Annex C 3</b>					
					Appendix 20/ 44					

# Solid brick Mz, NF, EN 771-1



Solid brick Mz, NF, EN 771-1			
Producer	e.g. Wienerberger		
Nominal dimensions [mm]	length L	width W	height H
	≥ 240	≥ 115	≥ 71
Density ρ [kg/dm³]	≥ 1,8		
Compressive strength f <sub>b</sub> [N/mm²]	≥ 12 / ≥ 20		
Standard or annex	EN 771-1		

Table C4.1: Installation parameters for edge distance c=100mm

Anchor rod	M8	M10	M12	-	
<b>Internal threaded anchor FIS E</b>	-	-	-	<b>M6</b>	<b>M8</b>
<b>Anchor rod and internal threaded anchor FIS E without perforated sleeve</b>					
Effective anchorage depth h <sub>ef</sub>	[mm]	50	50	50	85
		80	80	80	
		200	200	200	
Max. installation torque T <sub>inst</sub>	[Nm]	10			4 10
<b>General installation parameters</b>					
Edge distance C <sub>min</sub>	[mm]	100			100
Edge distance h <sub>ef</sub> =200 C <sub>min</sub>		150			- <sup>1)</sup>
S <sub>min</sub> II,N		60			60
h <sub>ef</sub> =200 S <sub>min</sub> II,N		240			- <sup>1)</sup>
S <sub>min</sub> II,V		240			240
S <sub>cr</sub> II		240			240
S <sub>cr</sub> ⊥ = S <sub>min</sub> ⊥		75			75

## Drilling method

Hammer drilling with hard metal hammer drill

<sup>1)</sup> No performance assessed

Table C4.2: Group factors

Anchor rods	M8	M10	M12	-	
<b>Internal threaded anchor FIS E</b>	-	-	-	<b>M6</b>	<b>M8</b>
<b>11x85</b>					
Edge distance C <sub>min</sub>	[mm]	100			
Group factor	α <sub>g,N</sub> II	1,5			
	α <sub>g,V</sub> II	2,0			
	h <sub>ef</sub> =200 α <sub>g,N</sub> II	1,5			
	h <sub>ef</sub> =200 α <sub>g,V</sub> II	2,0			
	α <sub>g,N</sub> ⊥	2,0			
	α <sub>g,V</sub> ⊥	2,0			
	h <sub>ef</sub> =200 α <sub>g,N</sub> ⊥	2,0			
	h <sub>ef</sub> =200 α <sub>g,V</sub> ⊥	2,0			

fischer injection system FIS VL for masonry

## Performance

Solid brick Mz, NF, dimensions, installation parameters c=100mm

## Annex C 4

## Solid brick Mz, NF, EN 771-1

**Table C5.1:** Characteristic resistance under tensile load for edge distance c=100mm

Anchor rod		M8	M10		M12			-				
Internal threaded anchor FIS E		-	-		-			M6	M8			
Tensile load $N_{Rk}$ [kN] depending on the compressive strength $f_b$ (temperature range 50/80°C)												
compressive strength $f_b$	use categorie		Effective anchorage depth $h_{ef}$ [mm]									
$\geq 12\text{N/mm}^2$	w/w	w/d	$\geq 50$	50	80	200	50	80	200			
	d/d		2,5	2,0	3,0	7,5	2,0	3,5	5,0			
$\geq 20\text{N/mm}^2$	w/w	w/d	4,0	3,5	5,0	12,0	3,0	5,5	8,0			
	d/d		$\geq 50$	3,5	4,5	11,0	3,0	5,0	7,0			
			5,5	5,0	7,0	12,0	4,5	8,0	11,5			
									8,0			

**Table C5.2:** Characteristic resistance under shear load for edge distance c=100mm

Anchor rod		M8	M10		M12			-				
Internal threaded anchor FIS E		-	-		-			M6	M8			
Shear load $V_{Rk}$ [kN] depending on the compressive strength $f_b$ (temperature range 50/80°C)												
compressive strength $f_b$	use categorie		Effective anchorage depth $h_{ef}$ [mm]									
$\geq 12\text{N/mm}^2$	w/w	w/d	$\geq 50$	50	200	$\geq 50$	200	85				
	d/d		2,5	4,0	8,5	4,0	11,5	2,5				
$\geq 20\text{N/mm}^2$	w/w	w/d	$\geq 50$	6,0	12,0	5,5	12,0	4,0				
	d/d		4,0									

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry

**Performance**

Solid brick Mz, NF, Characteristic resistance under tensile and shear load c=100mm

**Annex C 5**

Appendix 22/ 44

# Solid brick Mz, NF, EN 771-1

**Table C6.1:** Installation parameters for edge distance c=60mm

Anchor rod	M8	M10	M12	-							
<b>Internal threaded anchor FIS E</b>	-	-	-		<b>M6</b>	<b>M8</b>					
					<b>11x85</b>						
<b>Anchor rod and internal threaded anchor FIS E without perforated sleeve</b>											
Effective anchorage depth $h_{\text{ef}}$	[mm]	50	50	50	85						
		100	100	100							
		200	200	200							
Max. installation torque	T <sub>inst</sub>	[Nm]	10		4	10					
<b>General installation parameters</b>											
Edge distance	C <sub>min</sub>	[mm]	60								
Edge distance $h_{\text{ef}}=200$	C <sub>min</sub>		60								
Spacing	s <sub>min II,N</sub>		80								
	$h_{\text{ef}}=200$ s <sub>min II,N</sub>		80								
	s <sub>min II,V</sub>		80								
	s <sub>cr II</sub>		3x $h_{\text{ef}}$								
	s <sub>min ⊥</sub>		80								
	s <sub>cr ⊥</sub>		3x $h_{\text{ef}}$								
<b>Drilling method</b>											
Hammer drilling with hard metal hammer drill											

**Table C6.2:** Group factors

Anchor rods	M8	M10	M12	-				
<b>Internal threaded anchor FIS E</b>	-	-	-		<b>M6</b>	<b>M8</b>		
					<b>11x85</b>			
Edge distance C <sub>min</sub>	[mm]	[-]	60					
Group factor	$\alpha_{g,N} \parallel$		0,6					
	$\alpha_{g,V} \parallel$		1,3					
	$h_{\text{ef}}=200 \alpha_{g,N} \parallel$		1,4					
	$h_{\text{ef}}=200 \alpha_{g,V} \parallel$		1,5					
	$\alpha_{g,N} \perp$		0,3					
	$\alpha_{g,V} \perp$		1,3					
	$h_{\text{ef}}=200 \alpha_{g,N} \perp$		2,0					
	$h_{\text{ef}}=200 \alpha_{g,V} \perp$		1,1					

fischer injection system FIS VL for masonry

**Performance**  
Solid brick Mz, NF, dimensions, installation parameters c=60mm

**Annex C 6**

Appendix 23/ 44

## Solid brick Mz, NF, EN 771-1

**Table C7.1:** Characteristic resistance under tensile load for edge distance c=60mm

Anchor rod		M8		M10			M12			-	
Internal threaded anchor FIS E										M6	M8
										11x85	
<b>Tensile load N<sub>Rk</sub> [kN] depending on the compressive strength f<sub>b</sub> (temperature range 50/80°C)</b>											
compressive strength f <sub>b</sub>	use category			Effective anchorage depth h <sub>ef</sub> [mm]							
		50	100	50	100	200	50	100	200		85
$\geq 12\text{N/mm}^2$	w/w	w/d	2,0	2,0	2,0	2,5	- <sup>1)</sup>	2,0	2,5	- <sup>1)</sup>	- <sup>1)</sup>
	d/d		3,0	4,0	3,0	4,0	9,5	3,0	4,0	9,5	- <sup>1)</sup>
$\geq 20\text{N/mm}^2$	w/w	w/d	2,5	3,0	2,5	3,5	- <sup>1)</sup>	3,0	3,5	- <sup>1)</sup>	- <sup>1)</sup>
	d/d		4,5	5,5	4,5	5,5	12	4,5	5,5	12	- <sup>1)</sup>

<sup>1)</sup> No performance assessed

**Table C7.2:** Characteristic resistance under shear load for edge distance c=60mm

Anchor rod		M8		M10			M12			-	
Internal threaded anchor FIS E										M6	M8
										11x85	
<b>Shear load V<sub>Rk</sub> [kN] depending on the compressive strength f<sub>b</sub> (temperature range 50/80°C)</b>											
compressive strength f <sub>b</sub>	use category			Effective anchorage depth h <sub>ef</sub> [mm]							
		50	100	50	100	200	50	100	200		85
$\geq 12\text{N/mm}^2$	w/w	w/d	1,2	3,0	2,0	3,0	1,5	1,5	3,0	3,0	- <sup>1)</sup>
	d/d										
$\geq 20\text{N/mm}^2$	w/w	w/d	1,5	4,5	3,0	4,5	2,5	2,0	4,5	4,5	- <sup>1)</sup>
	d/d										

<sup>1)</sup> No performance assessed

Factor for job site tests and displacements see annex C27


fischer injection system FIS VL for masonry

### Performance

Solid brick Mz, NF, Characteristic resistance under tensile and shear load c=60mm

### Annex C 7

# Solid sand-lime brick KS, NF, EN 771-2

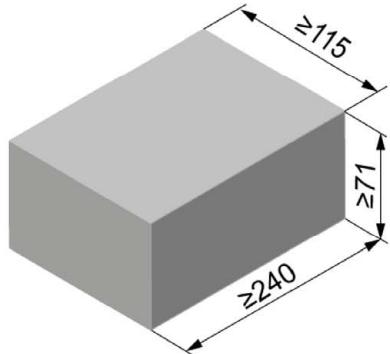

Solid sand-lime brick KS, NF, EN 771-2			
Producer			-
Nominal dimensions [mm]	length L	width W	height H
Density $\rho$ [kg/dm <sup>3</sup> ]	≥ 240		
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	≥ 115		
Standard or annex	≥ 12 / ≥ 20		
	EN 771-2		

**Table C8.1:** Installation parameters

Anchor rod		M8	M10	M12	-							
Internal threaded anchor FIS E		-	-	-	M6	M8						
					11x85							
Anchor rod and internal threaded anchor FIS E without perforated sleeve												
Effective anchorage depth $h_{\text{ef}}$	[mm]	50	50	50	85							
		100	100	100								
		- <sup>1)</sup>	200	200								
Max. installation torque	$T_{\text{inst}}$ [Nm]	5	15	15	3	5						
General installation parameters												
Edge distance $C_{\min}$		60										
		80										
		80										
		3x $h_{\text{ef}}$										
		3x $h_{\text{ef}}$										
Drilling method												
Hammer drilling with hard metal hammer drill												

<sup>1)</sup> No performance assessed

**Table C8.2:** Group factors

Anchor rod		M8	M10	M12	-			
Internal threaded anchor FIS E		-	-	-	M6	M8		
					11x85			
Group factor	$\alpha_{g,N} \parallel$ $\alpha_{g,V} \parallel$ $\alpha_{g,N} \perp$ $\alpha_{g,V} \perp$	[-]	0,7					
			1,3					
			2,0					
			2,0					

fischer injection system FIS VL for masonry

**Performance**  
Solid sand-lime brick KS, NF, dimensions, installation parameters

**Annex C 8**

# Solid sand-lime brick KS, NF, EN 771-2

**Table C9.1:** Characteristic resistance under tensile load

Anchor rod		M8		M10			M12			-	
Internal threaded anchor FIS E		-		-			-			M6	M8
										11x85	
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>											
compressive strength $f_b$	use category	50	100	50	100	200	50	100	200	85	
$\geq 12\text{N/mm}^2$	w/w	2,5	4,5	2,5	3,5	7,0	2,5	3,0	6,5	2,5	
	d/d	4,0	8,0	4,0	5,5	12	4,0	4,5	12	4,0	
$\geq 20\text{N/mm}^2$	w/w	3,5	6,5	3,5	4,5	10	3,5	4,0	9,5	3,5	
	d/d	6,0	11	6,0	8,0	12	6,0	6,5	12	6,0	

**Table C9.2:** Characteristic resistance under shear load

Anchor rod		M8		M10			M12			-	
Internal threaded anchor FIS E		-		-			-			M6	M8
										11x85	
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>											
compressive strength $f_b$	use category	50	100	50	$\geq 100$	50	$\geq 100$	50	$\geq 100$	85	
$\geq 12\text{N/mm}^2$	w/w	1,5	3,0	1,2	2,0	1,2	2,0	2,0	1,2		
	d/d										
$\geq 20\text{N/mm}^2$	w/w	2,5	4,0	1,5	3,0	1,5	3,0	1,5	3,0	1,5	
	d/d										

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


**Performance**

Solid sand-lime brick KS, NF, Characteristic resistance under tensile and shear load

**Annex C 9**

Appendix 26/ 44

# Solid sand-lime brick KS, EN 771-2

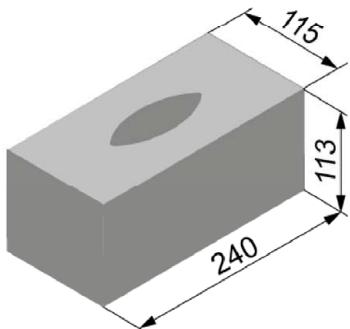

Solid sand-lime brick KS, EN 771-2			
Producer	-		
Nominal dimensions [mm]	length L	width W	height H
	240	115	113
Density $\rho$ [kg/dm <sup>3</sup> ]	$\geq 1,8$		
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	$\geq 10 / \geq 20$		
Standard or annex	EN 771-2		

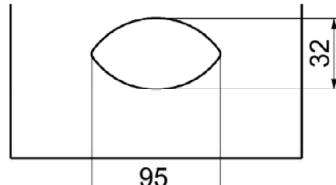


Table C10.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85	11x85				15x85	15x85	
Perforated sleeve FIS H K	12x85	16x85	16x130	16x130	20x85	20x85	20x130	20x130	20x130

## Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

Max. installation torque	$T_{inst}$	[Nm]	2
--------------------------	------------	------	---

## General installation parameters

Edge distance	$c_{min}$	[mm]	100
Spacing	$s_{min \parallel}$		240
	$s_{cr \parallel}$		240
	$s_{min \perp}$		115
	$s_{cr \perp}$		115

## Drilling method

Hammer drilling with hard metal hammer drill

Table C10.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85	11x85				15x85	15x85	
Perforated sleeve FIS H K	12x85	16x85	16x130	16x130	20x85	20x85	20x130	20x130	20x130
Group factor	$\alpha_{g,N} \parallel = \alpha_{g,V} \parallel$	[-]	2,0						-
	$\alpha_{g,N} \perp = \alpha_{g,V} \perp$		2,0						

fischer injection system FIS VL for masonry

## Performance

Perforated sand-lime brick KS, dimensions, installation parameters

## Annex C 10

# Solid sand-lime brick KS, EN 771-2

**Table C11.1:** Characteristic resistance under tensile load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12						
Internal threaded anchor FIS E		-	M6	M8	-		-		M10	M12						
			11x85						15x85							
Perforated sleeve FIS H K		12x85	16x85		16x130		20x85		20x130							
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>																
compressive strength $f_b$	use category															
$\geq 10\text{N/mm}^2$	w/w	w/d	3,5	2,0		2,0	6,5		4,5							
	d/d		6,0	3,5		3,5	8,5		7,0							
$\geq 20\text{N/mm}^2$	w/w	w/d	5,0	3,0		3,0	8,5		6,0							
	d/d		8,5	5,5		5,0	8,5		8,5							

**Table C11.2:** Characteristic resistance under shear load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12						
Internal threaded anchor FIS E		-	M6	M8	-		-		M10	M12						
			11x85						15x85							
Perforated sleeve FIS H K		12x85	16x85		16x130		20x85		20x130							
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>																
compressive strength $f_b$	use category															
$\geq 10\text{N/mm}^2$	w/w	w/d	3,0							3,5						
	d/d															
$\geq 20\text{N/mm}^2$	w/w	w/d	4,5							5,5						
	d/d															

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


**Performance**

Perforated sand-lime brick KS, Characteristic resistance under tensile and shear load

**Annex C 11**

Appendix 28/ 44

# Perforated sand-lime brick KSL, 3DF, EN 771-2

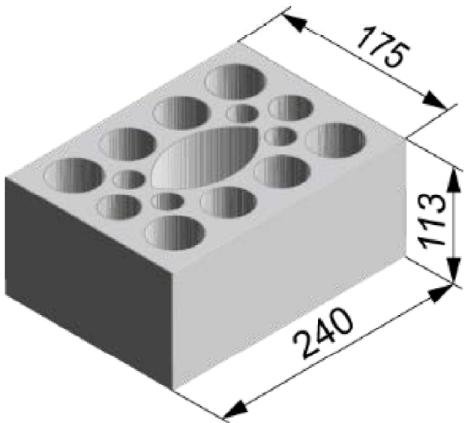

Perforated sand-lime brick KSL, 3DF, EN 771-2		
Producer	e.g. KS Wemding	
Nominal dimensions [mm]	length L	width W
	240	175
Density $\rho$ [kg/dm <sup>3</sup> ]	$\geq 1,4$	
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	$\geq 12 / \geq 20$	
Standard or annex	EN 771-2	




Table C12.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130

## Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

Max. installation torque	$T_{inst}$ [Nm]	2
--------------------------	-----------------	---

## General installation parameters

Edge distance	$c_{min}$	60	80
Spacing	$s_{min \parallel}$	100	
	$s_{cr \parallel}$ [mm]	240	
	$s_{min \perp}$	115	
	$s_{cr \perp}$	115	

## Drilling method

Hammer drilling with hard metal hammer drill

Table C12.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
Group factors	$\alpha_{g,N} \parallel = \alpha_{g,V} \parallel$ $\alpha_{g,N} \perp = \alpha_{g,V} \perp$	[ $\cdot$ ]					1,5		
							2,0		

fischer injection system FIS VL for masonry

## Performance

Perforated sand-lime brick KSL, 3DF, dimensions, installation parameters

## Annex C 12

## Perforated sand-lime brick KSL, 3DF, EN 771-2

**Table C13.1:** Characteristic resistance under tensile load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12								
Internal threaded anchor FIS E		-	M6	M8	-	-	-	M10	M12	-								
			11x85					15x85										
Perforated sleeve FIS H K		12x85	16x85		16x130		20x85		20x130									
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>																		
compressive strength $f_b$	use category																	
$\geq 12\text{N/mm}^2$	w/w	w/d	2,5	2,5		3,0	3,0		3,0									
	d/d		2,5	3,0		3,5	3,5		3,5									
$\geq 20\text{N/mm}^2$	w/w	w/d	4,0	4,5		5,5	5,5		5,5									
	d/d		4,5	5,0		6,0	6,0		6,0									

**Table C13.2:** Characteristic resistance under shear load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12								
Internal threaded anchor FIS E		-	M6	M8	-	-	-	M10	M12	-								
			11x85					15x85										
Perforated sleeve FIS H K		12x85	16x85		16x130		20x85		20x130									
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>																		
compressive strength $f_b$	use category																	
$\geq 12\text{N/mm}^2$	w/w	w/d	2,5															
	d/d																	
$\geq 20\text{N/mm}^2$	w/w	w/d	4,5	4,0														
	d/d																	

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


### Performance

Perforated sand-lime brick KSL, 3DF,  
Characteristic resistance under tensile and shear load

### Annex C 13

Appendix 30/ 44

# Vertical perforated brick HLz, EN 771-1

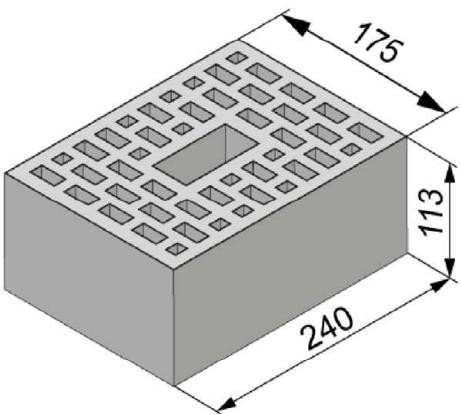

Vertical perforated brick HLz, EN 771-1			
Producer		e.g. Wienerberger	
Nominal dimensions [mm]		length L	width W
		240	175
Density $\rho$ [kg/dm <sup>3</sup> ]		$\geq 0,9$	
Compressive strength $f_b$ [N/mm <sup>2</sup> ]		$\geq 10$	
Standard or annex		EN 771-1	

Table C14.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	16x130	20x85	20x85	20x130	20x130	20x130
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K									
Max. installation torque	$T_{inst}$ [Nm]						2		
General installation parameters									
Edge distance	$c_{min}$						100		
Spacing	$s_{min \parallel}$						240		
	$s_{cr \parallel}$ [mm]						240		
	$s_{min \perp}$						115		
	$s_{cr \perp}$						115		
Drilling method									
Hammer drilling with hard metal hammer drill									

Table C14.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	16x130	20x85	20x85	20x130	20x130	20x130
Group factors	$\alpha_{g,N} \parallel = \alpha_{g,V} \parallel$ $\alpha_{g,N} \perp = \alpha_{g,V} \perp$	[ $\cdot$ ]					2,0		
							2,0		

fischer injection system FIS VL for masonry

Performance  
Vertical perforated brick HLz, dimensions, installation parameters

Annex C 14

Appendix 31/ 44

# Vertical perforated brick HLz, EN 771-1

**Table C15.1:** Characteristic resistance under tensile load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85					15x85		
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>									
compressive strength $f_b$	use category								
$\geq 10\text{N/mm}^2$	w/w	w/d	3,5		3,5			4,5	
	d/d		4,0		3,5			5,0	

**Table C15.2:** Characteristic resistance under shear load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85					15x85		
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>									
compressive strength $f_b$	use category								
$\geq 10\text{N/mm}^2$	w/w	w/d	4,0		5,5			6,0	
	d/d								

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


**Performance**

Vertical perforated brick HLz, Characteristic resistance under tensile and shear load

**Annex C 15**

Appendix 32/ 44

# Vertical perforated brick HLz, 2DF, EN 771-1

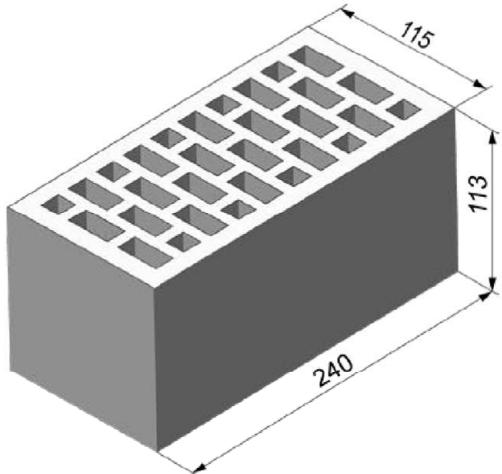

Vertical perforated brick HLz, 2DF, EN 771-1		
Producer	e.g. Wienerberger	
Nominal dimensions [mm]	length L	width W
	240	115
Density $\rho$ [kg/dm <sup>3</sup> ]	$\geq 1,4$	
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	$\geq 20$	
Standard or annex	EN 771-1	

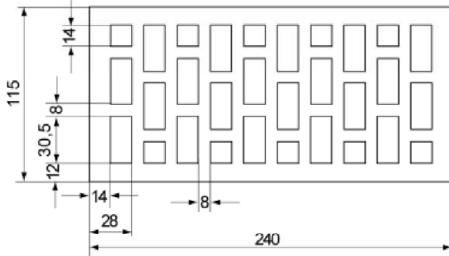


Table C16.1: Installation parameters

Anchor rod	M8	-	M8	M10	-	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x85	20x85	20x85	20x85
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K						
Max. installation torque $T_{inst}$ [Nm]				2		
General installation parameters						
Edge distance $C_{min}$				80		
Spacing $s_{cr \parallel} = s_{min \parallel}$ [mm]				240		
$s_{cr \perp} = s_{min \perp}$				115		
Drilling method						
Hammer drilling with hard metal hammer drill						

Table C16.2: Group factors

Anchor rod	M8	-	M8	M10	-	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x85	20x85	20x85	20x85
Group factors	$\alpha_{g,N \parallel}$ $\alpha_{g,V \parallel}$ $\alpha_{g,N \perp}$ $\alpha_{g,V \perp}$	[ $\cdot$ ]			2	

fischer injection system FIS VL for masonry

## Performance

Vertical perforated brick HLz, 2DF, dimensions, installation parameters

## Annex C 16

# Vertical perforated brick HLz, 2DF, EN 771-1

**Table C17.1:** Characteristic resistance under tensile load

Anchor rod		M8	-	M8	M10	-	M12					
Internal threaded anchor FIS E	-	-	M6	M8	-	M10	M12					
			11x85			15x85						
Perforated sleeve FIS H K		12x85		16x85		20x85						
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>												
compressive strength $f_b$	use category											
$\geq 20\text{N/mm}^2$	w/w	3,5	2,5			3,0						
	d/d	4,0	2,5			3,0						

**Table C17.2:** Characteristic resistance under shear load

Anchor rod		M8	-	M8	M10	-	M12					
Internal threaded anchor FIS E	-	-	M6	M8	-	M10	M12					
			11x85			15x85						
Perforated sleeve FIS H K		12x85		16x85		20x85						
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>												
compressive strength $f_b$	use category											
$\geq 20\text{N/mm}^2$	w/w	7,5	4,0	4,5		8,5						
	d/d											

Factor for job site tests and displacements see annex C27


fischer injection system FIS VL for masonry

## Performance

Vertical perforated brick HLz, 2DF,  
Characteristic resistance under tensile and shear load

## Annex C 17

# Vertical perforated brick HLz, EN 771-1

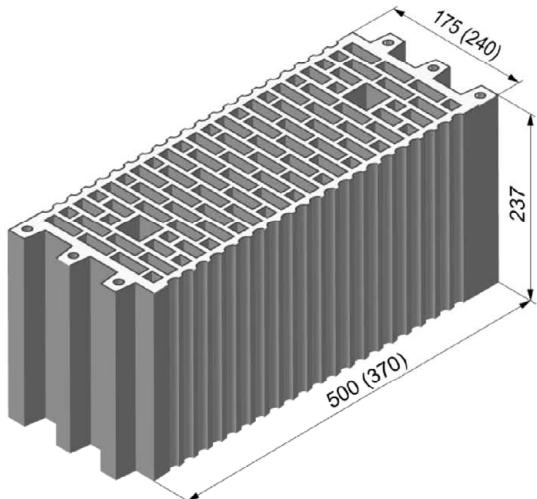

Vertical perforated brick HLz, EN 771-1		
Producer	e.g. Wienerberger, Poroton	
Nominal dimensions [mm]	length L	width W
	500	175
	370	240
Density $\rho$ [kg/dm <sup>3</sup> ]	$\geq 1,0$	
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	$\geq 10$	
Standard or annex	EN 771-1	

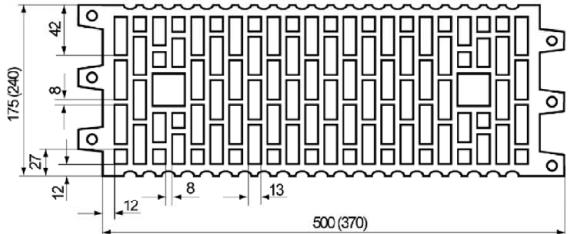


Table C18.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	20x85	20x130				

## Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

Max. installation torque	$T_{inst}$ [Nm]	2
--------------------------	-----------------	---

## General installation parameters

Edge distance	$c_{min}$	100
	$s_{min \parallel}$	100
Spacing	$s_{cr \parallel}$ [mm]	500 (370)
	$s_{min \perp}$	100
	$s_{cr \perp}$	240

## Drilling method

Hammer drilling with hard metal hammer drill

Table C18.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	20x85	20x130				

Group factors	$\alpha_{g,N \parallel} = \alpha_{g,V \parallel}$ $\alpha_{g,N \perp} = \alpha_{g,V \perp}$	[ $\cdot$ ]	1
---------------	--	-------------	---

fischer injection system FIS VL for masonry

**Performance**  
Vertical perforated brick HLz, dimensions, installation parameters

**Annex C 18**

# Vertical perforated brick HLz, EN 771-1

**Table C19.1:** Characteristic resistance under tensile load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E		-	M6	M8	-	-	-	M10	M12	-
			11x85					15x85		
Perforated sleeve FIS H K		12x85		16x85		16x130		20x85		20x130
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>										
compressive strength $f_b$	use category									
$\geq 10\text{N/mm}^2$	w/w	w/d	0,9					2,5		3,0
	d/d		0,9					2,5		3,5

**Table C19.2:** Characteristic resistance under shear load

Anchor rod		M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E		-	M6	M8	-	-	-	M10	M12	-
			11x85					15x85		
Perforated sleeve FIS H K		12x85		16x85		16x130		20x85		20x130
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>										
compressive strength $f_b$	use category									
$\geq 10\text{N/mm}^2$	w/w	w/d						1,2		1,5
	d/d								1,2	1,5

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


**Performance**

Vertical perforated brick HLz, Characteristic resistance under tensile and shear load

**Annex C 19**

Appendix 36/ 44

# Vertical perforated brick HLz, filled with mineral wool, EN 771-1

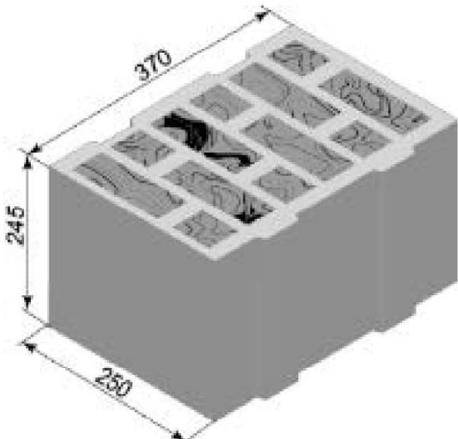

Vertical perforated brick HLz, filled with mineral wool, EN 771-1			
Producer		-	
Nominal dimensions [mm]		length L	width W
		370	250
Density $\rho$ [kg/dm <sup>3</sup> ]		$\geq 0,6$	
Compressive strength $f_b$ [N/mm <sup>2</sup> ]		$\geq 8$	
Standard or annex		EN 771-1	

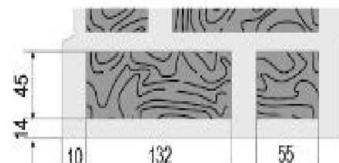


Table C20.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85					M10 M12 15x85			
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130	20x200
Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K										
Max. installation torque	$T_{inst}$ [Nm]						2			
General installation parameters										
Edge distance $c_{min}$							250			
Spacing $s_{min \parallel}$							250			
							250			
Spacing $s_{cr \parallel}$		[mm]					245			
							245			
Drilling method										
Hammer drilling with hard metal hammer drill										

Table C20.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85					M10 M12 15x85			
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130	20x200
Group factors										
	$\alpha_{g,N \parallel}$							2,0		
	$\alpha_{g,V \parallel}$									
	$\alpha_{g,N \perp}$									
	$\alpha_{g,V \perp}$									

fischer injection system FIS VL for masonry

## Performance

Vertical perforated brick HLz, filled with mineral wool;  
dimensions, installation parameters

## Annex C 20

# Vertical perforated brick HLz, filled with mineral wool, EN 771-1

**Table C21.1:** Characteristic resistance under tensile load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12	M12
Internal threaded anchor FIS E	-	M6   M8 11x85	-	-	M10   M12 15x85	-	-	-	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	20x85	20x130	20x200				
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>										
compressive strength $f_b$	use category									
$\geq 8\text{N/mm}^2$	w/w	w/d	2,0	1,5	2,5		2,0		3,0	
	d/d		2,0	2,0	3,0		2,0		3,0	

**Table C21.2:** Characteristic resistance under shear load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12	M12
Internal threaded anchor FIS E	-	M6   M8 11x85	-	-	M10   M12 15x85	-	-	-	-	-
Perforated sleeve FIS H K	12x85	16x85	16x130	20x85	20x130	20x200				
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>										
compressive strength $f_b$	use category									
$\geq 8\text{N/mm}^2$	w/w	w/d								
	d/d		2,5		3,0				1,5	

Factor for job site tests and displacements see annex C27


fischer injection system FIS VL for masonry

## Performance

Vertical perforated brick HLz, filled with mineral wool;  
Characteristic resistance under tensile and shear load

## Annex C 21

# Light-weight concrete hollow block Hbl, EN 771-3

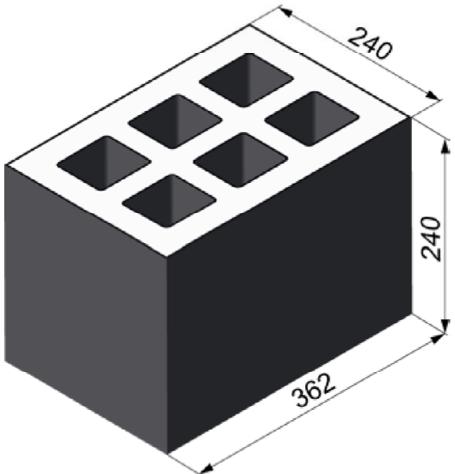

Light-weight concrete hollow block Hbl, EN 771-3			
Producer	-		
Nominal dimensions [mm]	length L		width W
	362		240
Density $\rho$ [kg/dm <sup>3</sup> ]	$\geq 1,0$		
Compressive strength $f_b$ [N/mm <sup>2</sup> ]	$\geq 4$		
Standard or annex	EN 771-3		

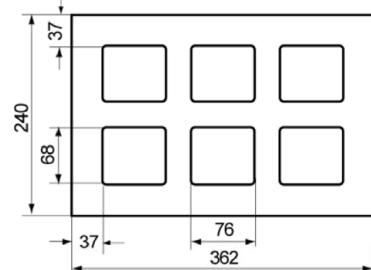


Table C22.1: Installation parameters

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130

## Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

Max. installation torque	$T_{inst}$ [Nm]	2
--------------------------	-----------------	---

## General installation parameters

Edge distance	$C_{min}$	[mm]	60
Spacing	$S_{min \parallel}$		100
	$S_{cr \parallel}$		362
	$S_{min \perp} = S_{cr \perp}$		240

## Drilling method

Hammer drilling with hard metal hammer drill

Table C22.2: Group factors

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6 M8 11x85	-	-	-	-	M10 M12 15x85	-	-
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
Group factors	$\alpha_{g,N \parallel}$ $\alpha_{g,V \parallel}$ $\alpha_{g,N \perp}$ $\alpha_{g,V \perp}$	[-]	1,2						
			1,1						
			2,0						

fischer injection system FIS VL for masonry

## Performance

Light-weight concrete hollow block Hbl, dimensions, installation parameters

## Annex C 22

# Light-weight concrete hollow block Hbl, EN 771-3

**Table C23.1:** Characteristic resistance under tensile load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85					15x85		
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>									
compressive strength $f_b$	use category								
$\geq 4\text{ N/mm}^2$	w/w	w/d					3,0		
	d/d						3,0		

**Table C23.2:** Characteristic resistance under shear load

Anchor rod	M8	-	M8	M10	M8	M10	-	M12	M12
Internal threaded anchor FIS E	-	M6	M8	-	-	-	M10	M12	-
		11x85					15x85		
Perforated sleeve FIS H K	12x85		16x85		16x130		20x85		20x130
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>									
compressive strength $f_b$	use category								
$\geq 4\text{ N/mm}^2$	w/w	w/d					2,0		
	d/d								

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry


## Performance

Light-weight concrete hollow block Hbl,  
Characteristic resistance under tensile and shear load

## Annex C 23

Appendix 40/ 44

# Autoclaved aerated concrete, EN 771-4



Autoclaved aerated concrete, EN 771-4				
Producer		e.g. Ytong		
Density $\rho$	[kg/dm <sup>3</sup> ]	$\geq 0,35$	$\geq 0,5$	$\geq 0,65$
Compressive strength $f_b$	[N/mm <sup>2</sup> ]	$\geq 2$	$\geq 4$	$\geq 6$
Standard or annex		EN 771-4		

**Table C24.1:** Installation parameters

Anchor rod		M8	M10		M12		-	-								
<b>Internal threaded anchor FIS E</b>		-	-		-		M6	M8								
			<b>11x85</b>		<b>15x85</b>		M10	M12								
<b>Anchor rod and internal threaded anchor FIS E without perforated sleeve</b>																
Effective anchorage depth $h_{ef}$	[mm]	100	200	100	200	100	200	85								
Max. installation torque	$T_{inst}$	1	8	2	12	2	16	1								
<b>General installation parameters</b>																
Edge distance $C_{min}$	[mm]	100														
$s_{cr \parallel} = s_{min \parallel}$		250														
$h_{ef}=200\text{mm}$		80														
$s_{min \parallel}$		3x $h_{ef}$														
$h_{ef}=200\text{mm}$		250														
$s_{cr \perp} = s_{min \perp}$		80														
$h_{ef}=200\text{mm}$		3x $h_{ef}$														
$s_{min \perp}$																
<b>Drilling method</b>																
Hammer drilling with hard metal hammer drill																

fischer injection system FIS VL for masonry

## Performance

Autoclaved aerated concrete, dimensions, installation parameters

## Annex C 24

Appendix 41/ 44

**Table C25.1:** Group factors for autoclaved aerated concrete  
(Compressive strength  $f_b \geq 2 \text{ N/mm}^2$ )

Anchor rod	M8	M10	M12	-	-	
Internal threaded anchor FIS E	-	-	-	M6	M8	
				11x85		
Group factors	$h_{ef}=200 \alpha_{g,N} \parallel$	1,6		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \parallel$	1,1		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \parallel, \alpha_{g,v} \parallel$	2				
	$h_{ef}=200 \alpha_{g,N} \perp$	1,6		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \perp$	0,8		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \perp, \alpha_{g,v} \perp$	2				

<sup>1)</sup> No performance assessed

**Table C25.2:** Group factors for autoclaved aerated concrete  
(Compressive strength  $f_b \geq 4 \text{ N/mm}^2$ )

Anchor rod	M8	M10	M12	-	-	
Internal threaded anchor FIS E	-	-	-	M6	M8	
				11x85		
Group factors	$h_{ef}=200 \alpha_{g,N} \parallel$	0,7		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \parallel$	2,0		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \parallel, \alpha_{g,v} \parallel$	2				
	$h_{ef}=200 \alpha_{g,N} \perp$	0,7		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \perp$	1,2		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \perp, \alpha_{g,v} \perp$	2				

<sup>1)</sup> No performance assessed

**Table C25.3:** Group factors for autoclaved aerated concrete  
(Compressive strength  $f_b \geq 6 \text{ N/mm}^2$ )

Anchor rod	M8	M10	M12	-	-	
Internal threaded anchor FIS E	-	-	-	M6	M8	
				11x85		
Group factors	$h_{ef}=200 \alpha_{g,N} \parallel$	0,7		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \parallel$	2,0		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \parallel, \alpha_{g,v} \parallel$	2				
	$h_{ef}=200 \alpha_{g,N} \perp$	0,7		- <sup>1)</sup>	- <sup>1)</sup>	
	$h_{ef}=200 \alpha_{g,v} \perp$	1,2		- <sup>1)</sup>	- <sup>1)</sup>	
	$\alpha_{g,N} \perp, \alpha_{g,v} \perp$	2				

<sup>1)</sup> No performance assessed

fischer injection system FIS VL for masonry

**Performance**  
Autoclaved aerated concrete, Group factors

**Annex C 25**

Appendix 42/ 44

# Autoclaved aerated concrete, EN 771-4

**Table C26.1:** Characteristic resistance under tensile load

Anchor rod		M8		M10		M12		-	-		
Internal threaded anchor FIS E								M6	M8	M10	M12
								11x85		15x85	
<b>Tensile load <math>N_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>											
compressive strength $f_b$	use category	100	200	100	200	100	200	Effective anchorage depth $h_{ef}$ [mm]			
$\geq 2 \text{ N/mm}^2$	w/w	1,5	2,0	1,5	3,0	1,5	3,0	85		1,5	
	d/d	1,5	3,0	1,5	3,5	2,0	4,0	1,5		1,5	
$\geq 4 \text{ N/mm}^2$	w/w	2,0	1,5	2,5	3,5	2,5	3,5	2,0		1,5	
	d/d	2,0	3,0	3,0	5,0	2,5	5,0	2,0		1,5	
$\geq 6 \text{ N/mm}^2$	w/w	3,0	2,5	4,5	5,0	4,5	7,0	3,5		2,5	
	d/d	3,5	4,0	5,0	7,0	5,0	9,0	3,5		2,5	

**Table C26.2:** Characteristic resistance under shear load

Anchor rod		M8		M10		M12		-	-		
Internal threaded anchor FIS E								M6	M8	M10	M12
								11x85		15x85	
<b>Shear load <math>V_{Rk}</math> [kN] depending on the compressive strength <math>f_b</math> (temperature range 50/80°C)</b>											
compressive strength $f_b$	use category	100	200	100	200	100	200	Effective anchorage depth $h_{ef}$ [mm]			
$\geq 2 \text{ N/mm}^2$	w/w	1,2	1,2	1,2	1,2	1,5	1,2	1,2		1,5	
	d/d										
$\geq 4 \text{ N/mm}^2$	w/w	2,5	2,0	2,0	2,0	2,5	2,0	2,0		2,5	
	d/d										
$\geq 6 \text{ N/mm}^2$	w/w	3,0	2,5	3,0	3,0	3,5	4,0	2,5		3,5	
	d/d										

Factor for job site tests and displacements see annex C27

fischer injection system FIS VL for masonry

**Performance**

Autoclaved aerated concrete, Characteristic resistance under tensile and shear load

**Annex C 26**

Appendix 43/ 44

## **β-factors for job site tests; displacements**

**Table C27.1:** β-factors for job site tests

use category	w/w and w/d	d/d
temperature range	50/80	50/80
Material	Size	
solid units	M8	0,57
	M10	0,59
	M12 FIS E 11x85	0,6
	FIS E 15x85	0,62
	FIS H 16x85 K	0,55
hollow units	all sizes	0,86
Autoclaved aerated concrete (AAC)	all sizes	0,73

**Table C27.2:** Displacements

Material	N [kN]	$\delta N_0$ [mm]	$\delta N_\infty$ [mm]	V [kN]	$\delta V_0$ [mm]	$\delta V_\infty$ [mm]
solid units and autoclaved aerated concrete $h_{ef}=100\text{mm}$	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,03	0,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	0,82	0,88
hollow units	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,48	0,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,71	2,56
solid brick Mz NF annex C 4 - C 7	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,74	1,48	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,23	1,85
solid brick KS NF annex C 8 / C 9	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	0,2	0,4	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	0,91	1,37
Autoclaved aerated concrete (AAC) $h_{ef}=200\text{ mm}$ annex C 24 - C 26	$\frac{N_{Rk}}{1,4 * \gamma_{Mm}}$	1,03	2,06	$\frac{V_{Rk}}{1,4 * \gamma_{Mm}}$	1,25	1,88

For anchorage in autoclaved aerated concrete, the partial factor  $\gamma_{MAAC}$  shall be used instead of  $\gamma_{Mm}$ .

fischer injection system FIS VL for masonry

**Performance**  
β-factors for job site tests; displacements

**Annex C 27**

Appendix 44/ 44