

## PRESTANDEDEKLARATION

### DoP 0296

för fischer injektionssystem FIS EB II (Mortel för efterinstallerade armeringsjärnanslutningar)

SV

1. Produkttypens unika identifikationskod: DoP 0296
2. Avsedd användning/avsedda användningar: System för efterinstallerad armeringsförbindelse med murbruk för användning i betong, Se bilaga, särskilt bilagor B1-B12.
3. Tillverkare: fischerwerke GmbH & Co. KG, Otto-Hahn-Straße 15, 79211 Denzlingen, Tyskland
4. Tillverkarens representant: –
5. System för bedömning och fortlöpande kontroll av prestanda: 1
6. Europeiskt bedömningsdokument: EAD 330087-01-0601 Edition 06/2021  
Europeisk teknisk bedömning: ETA-21/0470; 2022-03-03  
Tekniskt bedömningsorgan: DIBt- Deutsches Institut für Bautechnik  
Anmält/anmälda organ: 2873 TU Darmstadt
7. Angiven prestanda:  
**Mekanisk hållfasthet och stabilitet (BWR 1)**  
**Karaktäristiskt motstånd under statisk och kvasistatisk last:**  
Bindkraft hos efterinstallerade armeringsjärn: Bilaga C2  
Minskningfaktor: Bilaga C1  
Förstärkningsfaktor för minsta förankringslängd: Bilaga C1  
Karaktäristiskt motstånd mot stålbrott hos armeringsjärn: Bilaga C1  
  
**Karaktäristiskt motstånd under seismisk last:**  
Vidhäftning vid seismisk last, Seismisk vidhäftningsfaktor: NPD  
Minsta betongskikt vid seismisk last: NPD  
  
**Säkerhet vid brand (BWR 2)**  
Reaktion vid brand: Klass (A1)  
  
**Motståndskraft mot eld:**  
Vidhäftning vid ökad temperatur vid efter-injekterad armering bedömd till 50 år: Bilaga C3  
Vidhäftning vid ökad temperatur vid efter-injekterad armering bedömd till 100 år: NPD  
Karaktäristiskt motstånd mot stålbrott hos armeringsjärn under brandexponering: Bilaga C2
8. Lämplig teknisk dokumentation och/eller särskild teknisk dokumentation: –

$f_{bd,PIR,100y}$  = NPD

$k_{b,100y}$  = NPD

$\alpha_{lb,100y}$  = NPD

Prestandan för ovanstående produkt överensstämmer med den angivna prestandan. Denna prestandadeklaration har utfärdats i enlighet med förordning (EU) nr 305/2011 på eget ansvar av den tillverkare som anges ovan.

Undertecknad på tillverkarens vägnar av:



Dr.-Ing. Oliver Geibig, Verkställande direktör affärsenheter och teknik  
Tumlingen, 2022-03-17



Jürgen Grün, Verkställande direktör kemi och kvalitet

Denna DoP har förberetts på olika språk. I händelse av tvist om tolkningen ska den engelska versionen alltid råda.

Bilagan innehåller frivilliga och kompletterande information på engelska som överskrider (det specifika språkets) lagkrav.

## Specific Part

### 1 Technical description of the product

The subject of this European Technical Assessment is the post-installed connection, by anchoring or overlap connection joint, of reinforcing bars (rebars) in existing structures made of normal weight concrete, using the "Rebar connection with fischer Injection system FIS EB II" in accordance with the regulations for reinforced concrete construction.

Reinforcing bars made of steel with a diameter  $\phi$  from 8 to 32 mm or the fischer rebar anchor FRA of sizes M12 to M24 according to Annex A and injection mortar FIS EB II are used for rebar connections. The steel element is placed into a drilled hole filled with injection mortar FIS EB II and is anchored via the bond between rebar, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the rebar connection is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the rebar connections of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic                                        | Performance             |
|-----------------------------------------------------------------|-------------------------|
| Characteristic resistance under static and quasi-static loading | See Annex C 1           |
| Characteristic resistance under seismic loading                 | No performance assessed |

#### 3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance          |
|--------------------------|----------------------|
| Reaction to fire         | Class A1             |
| Resistance to fire       | See Annex C 2 to C 3 |

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330087-01-0601, the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

Installation conditions and application examples reinforcing bars, part 1

Figure A1.1:

Overlap joint with existing reinforcement for rebar connections of slabs and beams

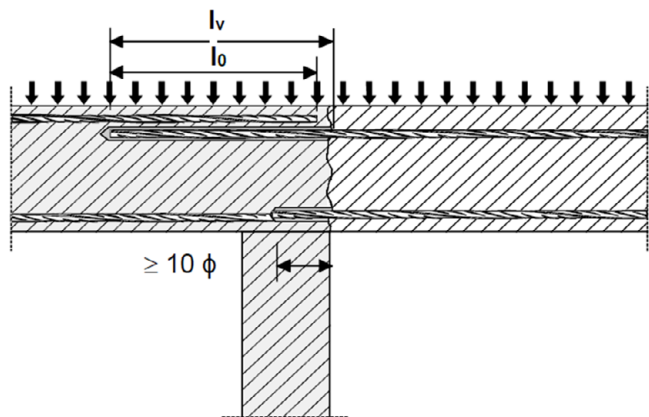


Figure A1.2:

Overlap joint with existing reinforcement at a foundation of a column or wall where the rebars are stressed


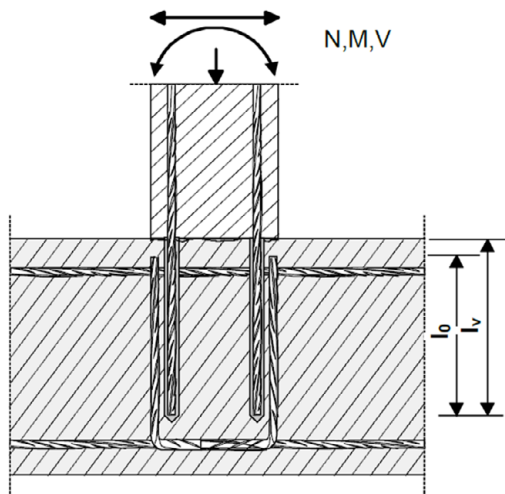


Figure A1.3:

End anchoring of slabs or beams (e.g. designed as simply supported)

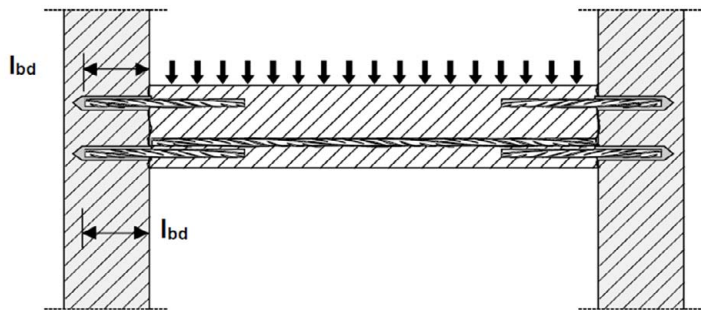

Figures not to scale

Rebar connection with fischer injection system FIS EB II

Product description  
Installation conditions and application examples reinforcing bars, part 1

Annex A 1  
Appendix 2/22

Installation conditions and application examples reinforcing bars, part 2

Figure A2.1:

Rebar connection for components stressed primarily in compression


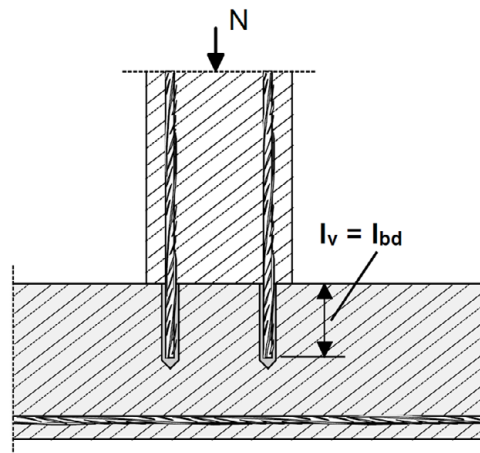


Figure A2.2:

Anchoring of reinforcement to cover the line of acting tensile force in the bending member

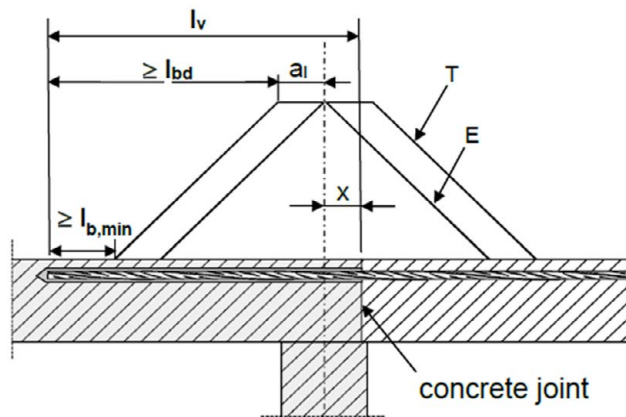

(only post-installed rebar is plotted)

Key to Figure

- T Acting tensile force
- E Envelope of  $M_{ed} / z + N_{ed}$  (see EN 1992-1-1:2004+AC:2010)
- x Distance between the theoretical point of support and concrete joint

Note to **figure A1.1 to A1.3** and **figure A2.1 to A2.2**

In the figures no traverse reinforcement is plotted, the transverse reinforcement as required by EN 1992-1-1:2004+AC:2010 shall be present.

The shear transfer between old and new concrete shall be designed according to EN 1992-1-1:2004+AC:2010  
Preparation of joints according to **Annex B 3** of this document.

Figures not to scale

Rebar connection with fischer injection system FIS EB II

Product description

Installation conditions and application examples reinforcing bars, part 2

Annex A 2


Appendix 3/22

## Installation conditions and application examples fischer rebar anchor

**Figure A3.1:**

Lap to a foundation of a column under bending.

1. Shear lug (or fastener loaded in shear)
2. fischer rebar anchor (tension only)
3. Existing stirrup / reinforcement for overlap (lap splice)
4. Slotted hole

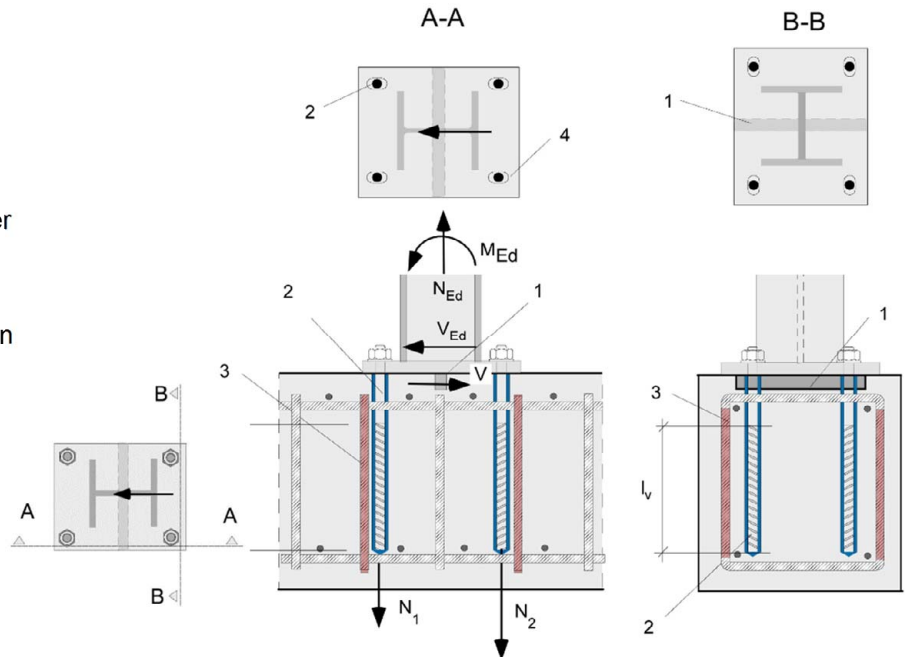


**Figure A3.2:**

Lap of the anchoring of guardrail posts or anchoring of cantilevered building components.

In the anchor plate, the drill holes for the fischer rebar anchors have to be designed as slotted holes with axial direction to the shear force.

1. Fastener for shear load transfer
2. fischer rebar anchor (tension only)
3. Existing stirrup / reinforcement for overlap (lap splice)
4. Slotted hole

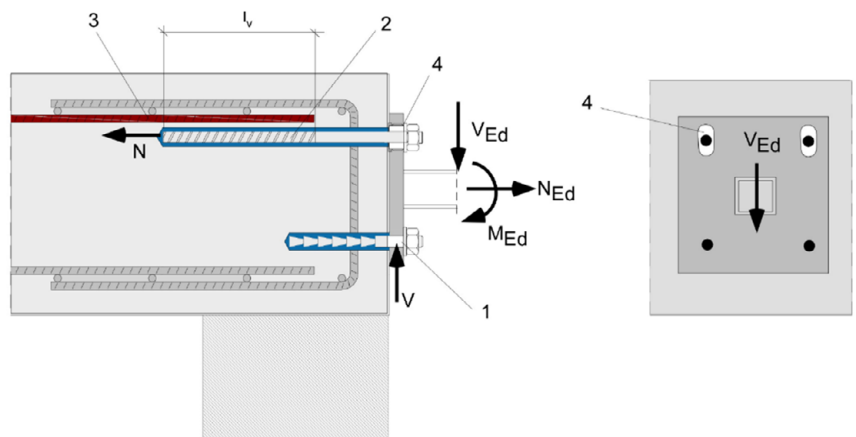

The required transverse reinforcement acc. to EN 1992-1-1:2004+AC:2010 is not shown in the figures. **The fischer rebar anchor may be only used for axial tensile force.** The tensile force must be transferred by lap to the existing reinforcement of the building. The transfer of the shear force has to be ensured by suitable measures, e.g. by means of shear force or anchors with European Technical Assessment (ETA).

Figures not to scale

### Rebar connection with fischer injection system FIS EB II

#### Product description


Installation conditions and application examples fischer rebar anchors FRA / FRA HCR

#### Annex A 3


Appendix 4/22

## Overview system components


**Injection cartridge (shuttle cartridge) FIS EB II with sealing cap; Sizes: 390 ml, 585 ml, 1100 ml, 1500 ml**

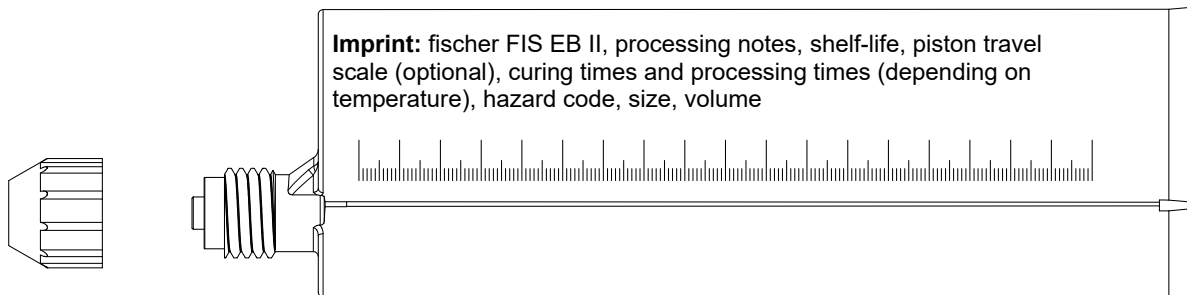


**Static mixer FIS MR Plus for injection cartridges 390 ml**



**Static mixer FIS UMR for injection cartridges  $\geq 585$  ml**




**Injection adapter and extension tube  $\varnothing 9$  for static mixer FIS MR Plus;  
Injection adapter and extension tube  $\varnothing 9$  or  $\varnothing 15$  for static mixer FIS UMR**



**Reinforcing bar (rebar) Sizes:  $\varnothing 8$ ,  $\varnothing 10$ ,  $\varnothing 12$ ,  $\varnothing 14$ ,  $\varnothing 16$ ,  $\varnothing 20$ ,  $\varnothing 25$ ,  $\varnothing 26$ ,  $\varnothing 28$ ,  $\varnothing 30$ ,  $\varnothing 32$**




**fischer rebar anchor FRA, FRA HCR Sizes: M12, M16, M20, M24**



**Blow out pump AB G**



**Compressed-air cleaning tool ABP with compressed-air nozzle**

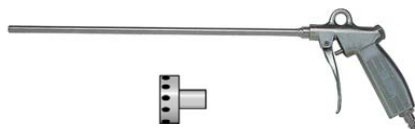

Figures not to scale

### Rebar connection with fischer injection system FIS EB II

#### Product description


Overview system components: injection mortar, static mixer, injection adapter, reinforcing bar, fischer rebar anchor, blow out pump

**Annex A 4**

Appendix 5/22

## Properties of reinforcing bars (rebar)

Figure A5.1:



- The minimum value of related rib area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- The maximum outer rebar diameter over the ribs shall be:
  - The nominal diameter of the bar with rib  $\phi + 2 \cdot h$  ( $h \leq 0,07 \cdot \phi$ )
  - ( $\phi$ : Nominal diameter of the bar;  $h_{rib}$  = rib height of the bar)

**Table A5.1: Installation conditions for rebars**

| Nominal diameter of the bar          |           | $\phi$ | 8 <sup>1)</sup>              |    | 10 <sup>1)</sup> |    | 12 <sup>1)</sup> |              | 14 | 16 | 20 | 25 | 26 | 28 | 30 | 32 |
|--------------------------------------|-----------|--------|------------------------------|----|------------------|----|------------------|--------------|----|----|----|----|----|----|----|----|
| Nominal drill hole diameter          | $d_0$     | [mm]   | 10                           | 12 | 12               | 14 | 14               | 16           | 18 | 20 | 25 | 30 | 35 | 35 | 40 | 40 |
| Drill hole depth                     | $h_0$     |        | $h_0 = l_v$                  |    |                  |    |                  |              |    |    |    |    |    |    |    |    |
| Effective embedment depth            | $l_v$     |        | acc. to static calculation   |    |                  |    |                  |              |    |    |    |    |    |    |    |    |
| Minimum thickness of concrete member | $h_{min}$ |        | $l_v + 30$<br>( $\geq 100$ ) |    |                  |    |                  | $l_v + 2d_0$ |    |    |    |    |    |    |    |    |

<sup>1)</sup> Both drill hole diameters can be used

**Table A5.2: Materials of rebars**

| Designation                                          | Reinforcing bar (rebar)                                                                                                                       |
|------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------|
| Reinforcing bar<br>EN 1992-1-1:2004+AC:2010, Annex C | Bars and de-coiled rods class B or C with<br>$f_{yk}$ and $k$ according to NDP or NCI of EN 1992-1-1/NA<br>$f_{uk} = f_{tk} = k \cdot f_{yk}$ |

### Rebar connection with fischer injection system FIS EB II

#### Product description


Properties and materials of reinforcing bars (rebar)

#### Annex A 5

Appendix 6/22

## Properties of fischer rebar anchors

Figure A6.1:

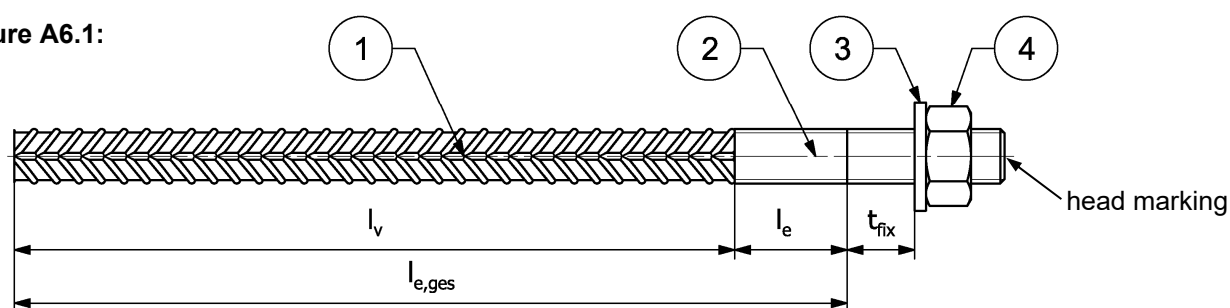

Head marking e.g.:  FRA (for stainless steel)

 FRA HCR (for high corrosion-resistant steel)

Table A6.1: Installation conditions for fischer rebar anchors

| Thread diameter                                         |                                | M12 <sup>2)</sup>            |    | M16          | M20 | M24 |
|---------------------------------------------------------|--------------------------------|------------------------------|----|--------------|-----|-----|
| Nominal diameter                                        | $\phi$ [mm]                    | 12                           |    | 16           | 20  | 25  |
| Nominal drill bit diameter                              | $d_0$ [mm]                     | 14                           | 16 | 20           | 25  | 30  |
| Drill hole depth ( $h_0 = l_{e,ges}$ )                  | $l_{e,ges}$ [mm]               | $l_v + l_e$                  |    |              |     |     |
| Effective embedment depth                               | $l_v$ [mm]                     | acc. to static calculation   |    |              |     |     |
| Distance concrete surface to welded joint               | $l_e$ [mm]                     | 100                          |    |              |     |     |
| Diameter of clearance hole in the fixture <sup>1)</sup> | Pre-positioned $\leq d_f$ [mm] | 14                           |    | 18           | 22  | 26  |
|                                                         | Push through $\leq d_f$ [mm]   | 16                           | 18 | 22           | 26  | 32  |
| Minimum thickness of concrete member                    | $h_{min}$ [mm]                 | $h_0 + 30$<br>( $\geq 100$ ) |    | $h_0 + 2d_0$ |     |     |
| Maximum torque moment for attachment of the fixture     | $\max T_{inst}$ [Nm]           | 50                           |    | 100          | 150 | 150 |

<sup>1)</sup> For bigger clearance holes in the fixture see EN 1992-4:2018

<sup>2)</sup> Both drill bit diameters can be used

Table A6.2: Materials of fischer rebar anchors

| Part | Description                           | Materials                                                                                                                                                                    |                                                                                              |
|------|---------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------|
|      |                                       | FRA<br>Corrosion resistance class CRC III<br>acc. to EN 1993-1-4:2006+A1:2015                                                                                                | FRA HCR<br>Corrosion resistance class CRC V<br>acc. to EN 1993-1-4:2006+A1:2015              |
| 1    | Reinforcing bar                       | Bars and de-coiled rods class B or C with $f_{yk}$ and $k$ according to NDP or NCI of EN 1992-1-1:NA; $f_{uk} = f_{tk} = k \cdot f_{yk}$ ; ( $f_{yk} = 500 \text{ N/mm}^2$ ) |                                                                                              |
| 2    | Round bar with partial or full thread | Stainless steel, strength class 80, according to EN 10088-1:2014                                                                                                             | Stainless steel, strength class 80, according to EN 10088-1:2014                             |
| 3    | Washer<br>ISO 7089:2000               | Stainless steel, according to EN 10088-1:2014                                                                                                                                | Stainless steel, according to EN 10088-1:2014                                                |
| 4    | Hexagon nut                           | Stainless steel, strength class 80, acc. to EN ISO 3506-2:2020, according to EN 10088-1:2014                                                                                 | Stainless steel, strength class 80, acc. to EN ISO 3506-2:2020, according to EN 10088-1:2014 |

### Rebar connection with fischer injection system FIS EB II

#### Product description

Properties and materials of fischer rebar anchors

#### Annex A 6

Appendix 7/22

## Specifications of intended use part 1

**Table B1.1:** Overview use and performance categories

| Fastenings subject to                                                                                                                                   |                        | FIS EB II with ...                                                                                   |                                 |                                                                                                             |                                                         |
|---------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------|------------------------------------------------------------------------------------------------------|---------------------------------|-------------------------------------------------------------------------------------------------------------|---------------------------------------------------------|
|                                                                                                                                                         |                        | Reinforcing bar<br> |                                 | fischer rebar anchor<br> |                                                         |
| Hammer drilling with standard drill bit or compressed air drilling<br> |                        | all sizes                                                                                            |                                 |                                                                                                             |                                                         |
| Use category                                                                                                                                            | I1 dry or wet concrete | all sizes                                                                                            |                                 |                                                                                                             |                                                         |
| Characteristic resistance under static and quasi static loading,                                                                                        | in cracked concrete    | all sizes                                                                                            | Tables:<br>C1.1<br>C1.2<br>C2.1 | all sizes                                                                                                   | Tables:<br>C1.1<br>C1.2<br>C1.3<br>C1.4<br>C2.1<br>C2.2 |
|                                                                                                                                                         | in uncracked concrete  |                                                                                                      |                                 |                                                                                                             |                                                         |
| Characteristic resistance under seismic loading                                                                                                         |                        | _1)                                                                                                  |                                 | _1)                                                                                                         |                                                         |
| Installation direction                                                                                                                                  |                        | D3 (downward and horizontal and upwards (e.g. overhead))                                             |                                 |                                                                                                             |                                                         |
| Installation temperature                                                                                                                                |                        | T <sub>i,min</sub> = +5 °C to T <sub>i,max</sub> = +40 °C                                            |                                 |                                                                                                             |                                                         |
| Service temperature                                                                                                                                     | Temperature range      | -40°C to +80°C                                                                                       |                                 | (max. short term temperature +80°C; max long term temperature +50°C)                                        |                                                         |
| Resistance to fire                                                                                                                                      |                        | all sizes                                                                                            | Annex C 3                       | all sizes                                                                                                   | Table C2.2                                              |

<sup>1)</sup> No performance assessed

### Rebar connection with fischer injection system FIS EB II

**Intended Use**  
Specifications part 1

**Annex B 1**  
Appendix 8/22

## Specifications of intended use part 2

### Anchorage subject to:

- Static and quasi-static loading: reinforcing bar (rebar) size 8 mm to 32 mm
- Resistance to fire

### Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013+A1:2016.
- Concrete strength classes C12/15 to C50/60 according to EN 206:2013+A1:2016
- Maximum chloride content of 0,40 % (CL 0.40) related to the cement content according to EN 206:2013+A1:2016
- Non-carbonated concrete

Note: In case of a carbonated surface of the existing concrete structure, the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of  $\phi + 60$  mm prior to the installation of the new rebar. The depth of concrete to be removed shall correspond to at least the minimum concrete cover in accordance with EN 1992-1-1 :2004+AC:2010. The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions.

### Use conditions (Environmental conditions) for fischer rebar anchors:

- For all conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance classes to Annex A 6 table A6.2

### Design:

- Fastenings are designed under the responsibility of an engineer experienced in fastenings and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the forces to be transmitted.
- Design according to EN 1992-1-1:2004+AC:2010, EN 1992-1-2:2004+AC:2008 and Annex B 3 and B 4.
- The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing.

### Installation:

- The installation of post-installed rebar respectively fischer rebar anchor shall be done only by suitable trained installer and under supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for Supervision on site are up to the member states in which the installation is done.
- Check the position of the existing rebars (if the position of existing rebars is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint).

**Rebar connection with fischer injection system FIS EB II**

**Intended Use**  
Specifications part 2


**Annex B 2**

Appendix 9/22

## General construction rules for post-installed rebars

**Figure B3.1:**

- Only tension forces in the axis of the rebar may be transmitted.
- The transfer of shear forces between new concrete and existing structure shall be designed additionally according to EN 1992-1-1:2004+AC:2010.
- The joints for concreting must be roughened to at least such an extent that aggregate protrude.

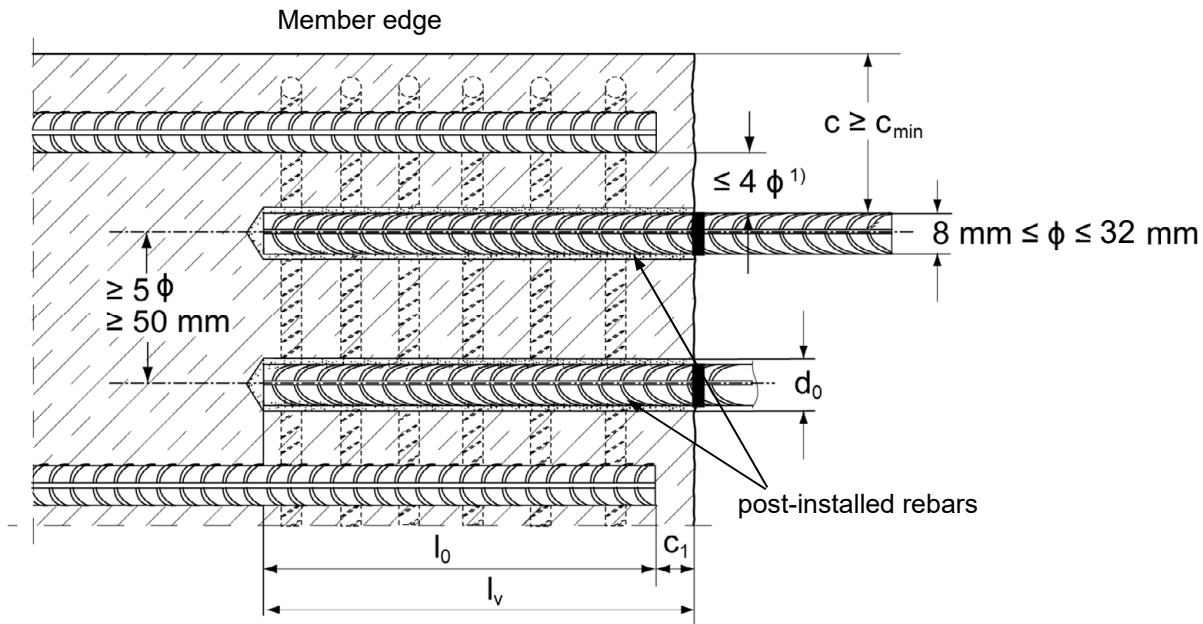

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4 \phi$  then the lap length shall be increased by the difference between the clear bar distance and  $4 \phi$

|           |                                                                                                 |
|-----------|-------------------------------------------------------------------------------------------------|
| $c$       | concrete cover of post-installed rebar                                                          |
| $c_1$     | concrete cover at end-face of existing rebar                                                    |
| $c_{min}$ | minimum concrete cover according to table B5.1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2 |
| $\phi$    | nominal diameter of reinforcing bar                                                             |
| $l_0$     | lap length, according to EN 1992-1-1:2004+AC:2010                                               |
| $l_v$     | effective embedment depth, $\geq l_0 + c_1$                                                     |
| $d_0$     | nominal drill bit diameter, see Annex B 6                                                       |

Figures not to scale

### Rebar connection with fischer injection system FIS EB II

#### Intended Use

General construction rules for post-installed rebars


#### Annex B 3

Appendix 10/22

## General construction rules for post-installed fischer rebar anchors

**Figure B4.1:**

- Only tension forces in the axis of the fischer rebar anchor may be transmitted.
- The tension force must be transferred via an overlap joint to the reinforcement in the building part.
- The transmission of the shear loading shall be ensured by appropriate additional measures, e.g. by shear lugs or by anchors with a European Technical Assessment (ETA).
- In the anchor plate, the holes for the tension anchor shall be executed as slotted holes with the axis in the direction of the shear force.

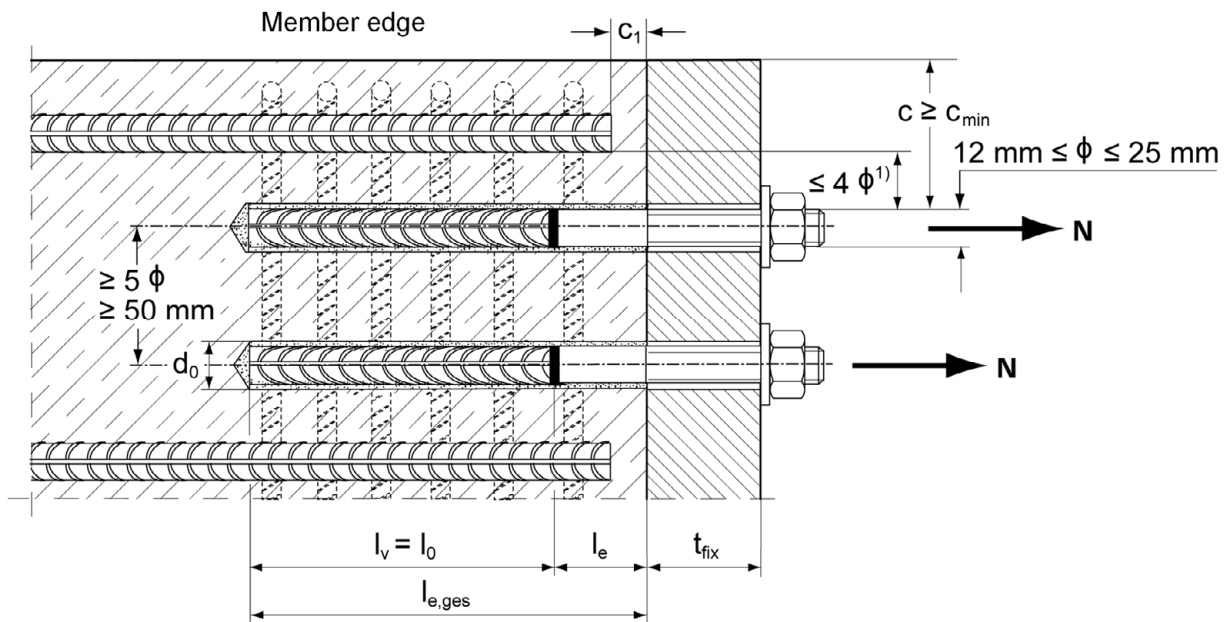

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4 \phi$  then the lap length shall be increased by the difference between the clear bar distance and  $4 \phi$ .

|              |                                                                                                 |
|--------------|-------------------------------------------------------------------------------------------------|
| $c$          | concrete cover of post-installed fischer rebar anchor                                           |
| $c_1$        | concrete cover at end-face of existing rebar                                                    |
| $c_{min}$    | minimum concrete cover according to table B5.1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2 |
| $\phi$       | nominal diameter of reinforcing bar                                                             |
| $l_0$        | lap length, according to EN 1992-1-1:2004+AC:2010, Section 8.7.3                                |
| $l_{e, ges}$ | overall embedment depth, $\geq l_0 + l_e$                                                       |
| $d_0$        | nominal drill bit diameter, see Annex B 6                                                       |
| $l_e$        | length of the bonded in threaded part                                                           |
| $t_{fix}$    | thickness of the fixture                                                                        |
| $l_v$        | effective embedment depth                                                                       |

Figures not to scale

### Rebar connection with fischer injection system FIS EB II


#### Intended Use

General construction rules for post-installed fischer rebar anchors

#### Annex B 4

Appendix 11/22

**Table B5.1: Minimum concrete cover  $c_{min}^{1)}$  depending on the drilling method and the drilling tolerance**

| Drilling method                         | nominal diameter of reinforcing bar $\phi$ [mm] | Minimum concrete cover $c_{min}$ |                                |                                                                                                     |
|-----------------------------------------|-------------------------------------------------|----------------------------------|--------------------------------|-----------------------------------------------------------------------------------------------------|
|                                         |                                                 | Without drilling aid [mm]        | With drilling aid [mm]         |                                                                                                     |
| Hammer drilling with standard drill bit | < 25                                            | 30 mm + 0,06 $l_v \geq 2 \phi$   | 30 mm + 0,02 $l_v \geq 2 \phi$ | <br>Drilling aid |
|                                         | $\geq 25$                                       | 40 mm + 0,06 $l_v \geq 2 \phi$   | 40 mm + 0,02 $l_v \geq 2 \phi$ |                                                                                                     |
| Compressed air drilling                 | < 25                                            | 50 mm + 0,08 $l_v$               | 50 mm + 0,02 $l_v$             |                                                                                                     |
|                                         | $\geq 25$                                       | 60 mm + 0,08 $l_v \geq 2 \phi$   | 60 mm + 0,02 $l_v \geq 2 \phi$ |                                                                                                     |

<sup>1)</sup> See Annex B 3, figure B3.1 and Annex B 4, figure B4.1

Note: The minimum concrete cover as specified in EN 1992-1-1:2004+AC:2010 must be observed.

**Table B5.2: Dispensers and cartridge sizes corresponding to maximum embedment depth  $l_{v,max}$  resp.  $l_{e,ges,max}$**

| reinforcing bars (rebar) | fischer rebar anchor   | Manual dispenser                                                        | Pneumatic or cordless dispenser (small) | Pneumatic or cordless dispenser (large) |
|--------------------------|------------------------|-------------------------------------------------------------------------|-----------------------------------------|-----------------------------------------|
|                          |                        | Cartridge size<br>$\geq 390$ ml (e.g. 390 ml, 585 ml, 1100 ml, 1500 ml) |                                         |                                         |
| $\phi$ [mm]              | Designation            | $l_{v,max} / l_{e,ges,max}$ [mm]                                        |                                         |                                         |
| 8 to 10                  | ---                    | 2000                                                                    |                                         |                                         |
| 12                       | FRA M12<br>FRA HCR M12 |                                                                         |                                         |                                         |
| 14                       | ---                    |                                                                         |                                         |                                         |
| 16                       | FRA M16<br>FRA HCR M16 |                                                                         |                                         |                                         |
| 20                       | FRA M20<br>FRA HCR M20 |                                                                         |                                         |                                         |
| 25                       | FRA M24<br>FRA HCR M24 |                                                                         |                                         |                                         |
| 26 to 32                 | ---                    |                                                                         |                                         |                                         |

**Table B5.3: Conditions for use static mixer without an extension tube**

| Nominal drill hole diameter $d_0$                   |  | [mm] | 10        | 12 | 14         | 16         | 18         | 20         | 24         | 25         | 28 | 30 | 35 | 40 |
|-----------------------------------------------------|--|------|-----------|----|------------|------------|------------|------------|------------|------------|----|----|----|----|
|                                                     |  |      | $\leq 90$ |    | $\leq 120$ | $\leq 140$ | $\leq 150$ | $\leq 160$ | $\leq 190$ | $\leq 210$ |    |    |    |    |
| Drill hole depth $h_0$ by FIS MR Plus using FIS UMR |  |      | -         | -  | $\leq 90$  | $\leq 160$ | $\leq 180$ | $\leq 190$ | $\leq 220$ | $\leq 250$ |    |    |    |    |

## Rebar connection with fischer injection system FIS EB II

### Intended Use

Minimum concrete cover;  
dispenser and cartridge sizes corresponding to maximum embedment depth

### Annex B 5

Appendix 12/22

**Table B6.1: Working times  $t_{\text{work}}$  and curing times  $t_{\text{cure}}$** 

| Temperature at anchoring base<br>[°C] <sup>2)</sup> | Maximum processing time <sup>1)</sup><br>$t_{\text{work}}$ | Minimum curing time<br>$t_{\text{cure}}$ |
|-----------------------------------------------------|------------------------------------------------------------|------------------------------------------|
| 5 to 10                                             | 180 min                                                    | 96 h                                     |
| > 10 to 15                                          | 90 min                                                     | 60 h                                     |
| > 15 to 20                                          | 60 min                                                     | 36 h                                     |
| > 20 to 30                                          | 30 min                                                     | 24 h                                     |
| > 30 to 40                                          | 15 min                                                     | 12 h                                     |

<sup>1)</sup> Maximum time from the beginning of the injection to rebar / fischer rebar anchor setting and positioning

<sup>2)</sup> If the temperature in the concrete falls below 10 °C the cartridge has to be warmed up to +20 °C.

**Table B6.2: Installation tools for drilling and cleaning the bore hole and injection of the mortar**

| reinforcing bars (rebar)<br><br>$\phi$ [mm] | fischer rebar anchor<br><br>Designation            | Drilling and cleaning      |                          |                      |                             | Injection                  |                            |
|---------------------------------------------|----------------------------------------------------|----------------------------|--------------------------|----------------------|-----------------------------|----------------------------|----------------------------|
|                                             |                                                    | Nominal drill bit diameter | Diameter of cutting edge | Steel brush diameter | Diameter of cleaning nozzle | extension tube 9 mm        | extension tube 15 mm       |
|                                             |                                                    | $d_0$ [mm]                 | $d_{\text{cut}}$ [mm]    | $d_b$ [mm]           | [mm]                        | Injection adapter [colour] | Injection adapter [colour] |
| 8 <sup>1)</sup>                             | ---                                                | 10 <sup>2)</sup>           | $\leq 10,50$             | 11                   | ---                         | ---                        | ---                        |
|                                             |                                                    | 12                         | $\leq 12,50$             | 14                   |                             | nature                     | ---                        |
| 10 <sup>1)</sup>                            | ---                                                | 12                         | $\leq 12,50$             | 14                   | 11                          | blue                       | ---                        |
|                                             |                                                    | 14                         | $\leq 14,50$             | 16                   |                             | red                        | ---                        |
| 12 <sup>1)</sup>                            | FRA M12 <sup>1)</sup><br>FRA HCR M12 <sup>1)</sup> | 14                         | $\leq 14,50$             | 16                   | 15                          | yellow                     | ---                        |
|                                             |                                                    | 16                         | $\leq 16,50$             | 20                   |                             | green                      | green                      |
| 14                                          | ---                                                | 18                         | $\leq 18,50$             | 20                   | 19                          | black                      | black                      |
| 16                                          | FRA M16<br>FRA HCR M16                             | 20                         | $\leq 20,55$             | 25                   |                             | grey                       | grey                       |
| 20                                          | FRA M20<br>FRA HCR M20                             | 25                         | $\leq 25,55$             | 27                   | 28                          | brown                      | brown                      |
| 25                                          | FRA M24 <sup>1)</sup><br>FRA HCR M24 <sup>1)</sup> | 30                         | $\leq 30,55$             | 32                   | 28                          | brown                      | brown                      |
| 26                                          | ---                                                | 35                         | $\leq 35,70$             | 37                   | 28                          | red                        | red                        |
| 28                                          | ---                                                | 35                         | $\leq 35,70$             | 37                   | 38                          | red                        | red                        |
| 30                                          | ---                                                | 40                         | $\leq 40,70$             | 42                   | 38                          | red                        | red                        |
| 32                                          | ---                                                | 40                         | $\leq 40,70$             | 42                   | 38                          | red                        | red                        |

<sup>1)</sup> Both drill bit diameters can be used

<sup>2)</sup> Only hammer drilling with standard drill bit

**Rebar connection with fischer injection system FIS EB II****Intended Use**

Working times and curing times;  
Installation tools for drilling and cleaning the bore hole and injection of the mortar

**Annex B 6**

Appendix 13/22

## Safety regulations





Review the Safety Data Sheet (SDS) before use for proper and safe handling!  
Wear well-fitting protective goggles and protective gloves when working with mortar FIS EB II.  
Important: Observe the instructions for use provided with each cartridge.

## Installation instruction part 1

### Hole drilling

Note: Before drilling, remove carbonated concrete; clean contact areas (see Annex B 2)  
In case of aborted drill holes the drill hole shall be filled with mortar.
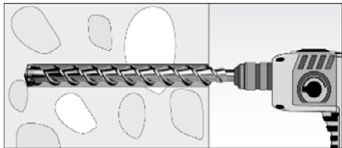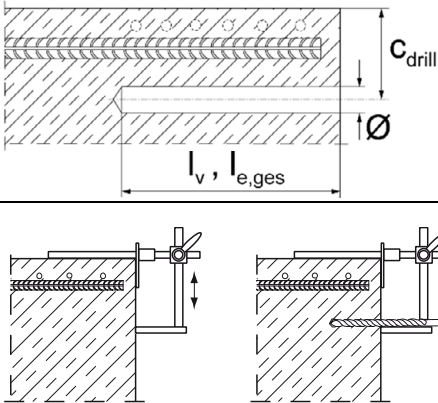
|   |                                                                                                                                            |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
|---|--------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1 | <p><b>Hammer drilling or compressed air drilling</b></p>  | <p>Drill the hole to the required embedment depth using a hammer drill with carbide drill bit set in rotation hammer mode or a pneumatic drill.<br/>Drill bit sizes see <b>table B6.2</b>.</p>                                                                                                                                                                                                                                                                                                                                                            |
| 2 |                                                          | <p>Measure and control concrete cover <math>c</math><br/>(<math>c_{\text{drill}} = c + \varnothing / 2</math>)<br/>Drill parallel to surface edge and to existing rebar.<br/>Where applicable use fischer drilling aid.</p> <p>For holes <math>l_v &gt; 20</math> cm use drilling aid.<br/>Three different options can be considered:</p> <ul style="list-style-type: none"><li>A) fischer drilling aid</li><li>B) Slat or spirit level</li><li>C) Visual check</li></ul> <p>Minimum concrete cover <math>c_{\text{min}}</math> see <b>table B5.1</b></p> |


|  |  |
|--|--|
|  |  |
|--|--|

|                                                                                           |                                        |
|-------------------------------------------------------------------------------------------|----------------------------------------|
| <b>Rebar connection with fischer injection system FIS EB II</b>                           |                                        |
| <b>Intended Use</b><br>Safety regulations; Installation instruction part 1, hole drilling | <b>Annex B 7</b><br><br>Appendix 14/22 |

## Installation instruction part 2

### Drill hole cleaning with oil-free compressed air


3a

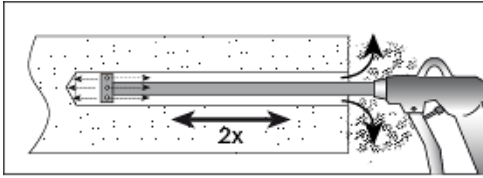

#### Blowing

twice from the back of the hole with the appropriate nozzle (oil-free compressed air  $\geq 6$  bar) until return air stream is free of noticeable dust.


Personal protective equipment must be used (see safety regulations **Annex B 7**).

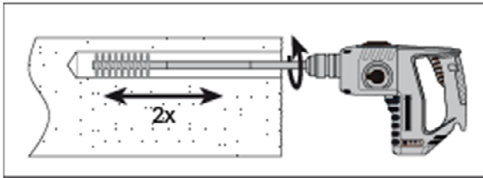

#### Brushing (with power drill)

Check steel brush with brush control template. The brush must produce a noticeable resistance when it is inserted into the drill hole.

Fix an adequate steel brush with an extension into a drilling machine and brush the bore hole twice.

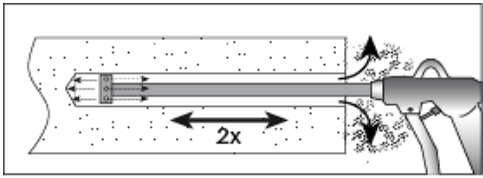

#### Blowing

twice from the back of the hole with the appropriate nozzle (oil-free compressed air  $\geq 6$  bar) until return air stream is free of noticeable dust.

Personal protective equipment must be used (see safety regulations **Annex B 7**).

Go to step 4

Rebar connection with fischer injection system FIS EB II

#### Intended Use




Installation instruction part 2, drill hole cleaning

**Annex B 8**

Appendix 15/22

Installation instruction part 3

Drill hole cleaning: manual cleaning is permitted for hammer drilled boreholes up to hole diameters  $d_0 < 18\text{ mm}$  and depths  $l_v$  resp.  $l_{e,ges} \leq 12 \cdot \phi$


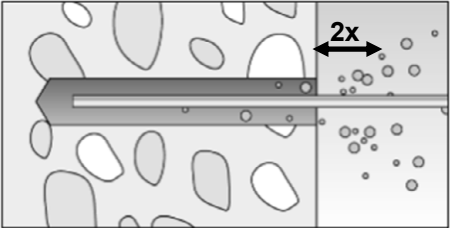
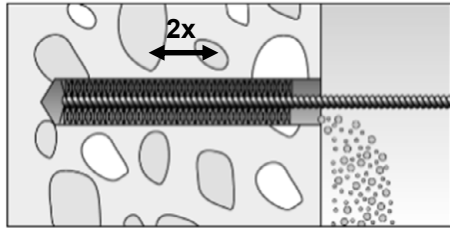
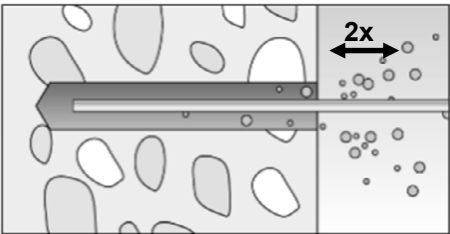
|    |                                                                                   |                                                                                                                                                                                                                                                                                     |
|----|-----------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 3b |  | <p><b>Blowing</b><br/>blow out the hole twice by hand from the back of the hole. Use only the fischer blow out pump AB G.<br/>Personal protective equipment must be used (see safety regulations <b>Annex B 7</b>).</p>                                                             |
|    |  | <p><b>Brushing</b><br/>Twice with the specified brush size by inserting the round steel brush to the back of the hole and twisting motion. The brush must produce a noticeable resistance when it is inserted into the drill hole. Corresponding brushes see <b>table B6.2</b>.</p> |
|    |  | <p><b>Blowing</b><br/>blow out the hole twice by hand from the back of the hole. Use only the fischer blow out pump AB G.<br/>Personal protective equipment must be used (see safety regulations <b>Annex B 7</b>).</p>                                                             |

Go to step 4

|                                                                      |  |                                 |
|----------------------------------------------------------------------|--|---------------------------------|
| Rebar connection with fischer injection system FIS EB II             |  | Annex B 9<br><br>Appendix 16/22 |
| Intended Use<br>Installation instruction part 3, drill hole cleaning |  |                                 |

## Installation instruction part 4

### reinforcing bars (rebar) / fischer rebar anchor and cartridge preparation
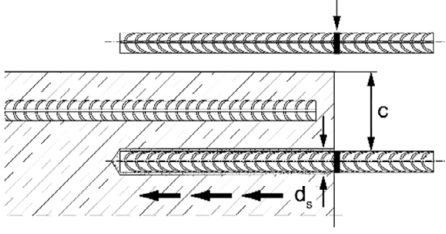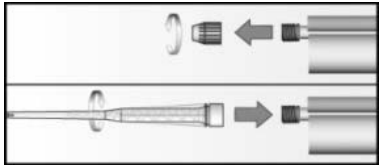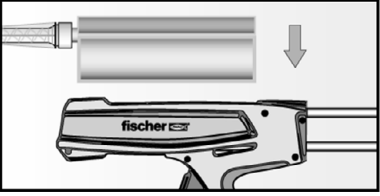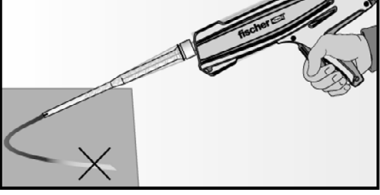
|   |                                                                                    |                                                                                                                                                                                                                                            |
|---|------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 4 |   | <p>Before use, make asure that the rebar or the fischer rebar anchor is dry and free of oil or other residue.<br/>Mark the embedment depth (e.g. with tape)<br/>Insert rebar in borehole, to verify drill hole depth and setting depth</p> |
| 5 |   | <p>Twist off the sealing cap<br/>Twist on the static mixer (the spiral in the static mixer must be clearly visible).</p>                                                                                                                   |
| 6 |   | <p>Place the cartridge into a suitable dispenser.</p>                                                                                                                                                                                      |
| 7 |  | <p>Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed.</p>                                                                       |

Go to step 8

#### Rebar connection with fischer injection system FIS EB II

##### Intended Use

Installation instruction part 4,  
reinforcing bars (rebar) / fischer rebar anchor and cartridge preparation


#### Annex B 10

Appendix 17/22


## Installation instruction part 5; Installation with FIS EB II

### Injection of the mortar without extension tube

8a

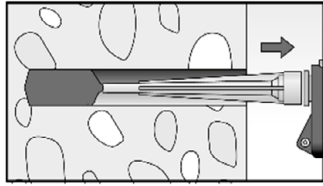


Inject the mortar from the back of the hole towards the front and slowly withdraw the static mixer step by step with each trigger pull. Avoid bubbles.  
Fill holes approximately 2/3 full, to ensure that the annular gap between the rebar and the concrete will be completely filled with adhesive over the entire embedment length.  
The conditions for mortar injection without extension tube can be found in **table B5.3**

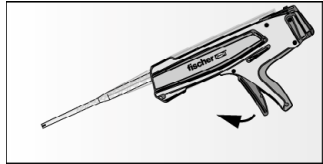

After injecting, release the dispenser. This will prevent further mortar discharge from the static mixer.


### Injection of the mortar with extension tube

8b

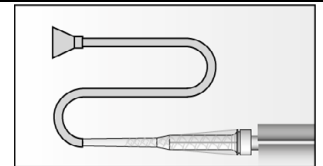

Assemble mixing nozzle FIS MR Plus or FIS UMR, extension tube and appropriate injection adapter (see **table B6.2**)

Mortar level mark

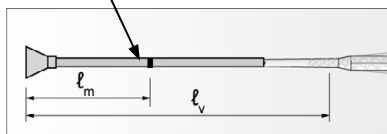


Mark the required mortar level  $l_m$  and embedment depth  $l_v$  resp.  $l_{e,ges}$  with tape or marker on the injection extension tube.

a) Estimation:

$$l_m = \frac{1}{3} \cdot l_v \text{ resp. } l_m = \frac{1}{3} \cdot l_{e,ges} \text{ [mm]}$$


b) Precise equation for optimum mortar volume:

$$l_m = l_v \text{ resp. } l_{e,ges} \left( (1,2 \cdot \frac{d_s^2}{d_0^2} - 0,2) \right) \text{ [mm]}$$

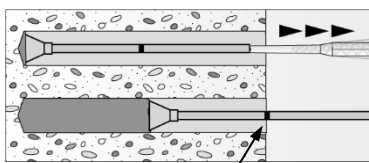

Mortar level mark

Insert injection adapter to back of the hole. Begin injection allowing the pressure of the injected adhesive mortar to push the injection adapter towards the front of the hole. Do not actively pull out!  
Fill holes approximately 2/3 full, to ensure that the annular gap between the rebar and the concrete will be completely filled with adhesive over the embedment length.  
When using an injection adapter continue injection until the mortar level mark  $l_m$  becomes visible.  
Maximum embedment depth, see **table B5.2**

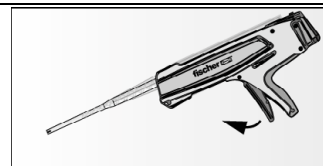

After injecting, release the dispenser. This will prevent further mortar discharge from the static mixer.

Go to step 9

## Rebar connection with fischer injection system FIS EB II

### Intended Use





Installation instruction part 5, mortar injection

### Annex B 11

Appendix 18/22

## Installation instruction part 6; Inatallation with FIS EB II

### Insert rebar / fischer rebar anchor

|    |                                                                                     |                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|----|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 9  |    | <p>Insert the rebar / fischer rebar anchor slowly twisted into the borehole until the embedment mark is reached.</p> <p>Recommendation:<br/>Rotation back and forth of the reinforcement bar or the fischer rebar anchor makes pushing easy</p>                                                                                                                                                                                                                    |
| 10 |    | <p>After installing the rebar or fischer rebar anchor the annular gap must be completely filled with mortar.</p> <p>Proper installation</p> <ul style="list-style-type: none"> <li>Desired embedment depth is reached <math>l_v</math> resp. <math>l_{e,ges}</math>:<br/>embedment mark at concrete surface</li> <li>Excess mortar flows out of the borehole after the rebar or fischer rebar anchor have been fully inserted up to the embedment mark.</li> </ul> |
| 11 |    | <p>For overhead installation, support the rebar / fischer rebar anchor and secure it from falling till mortar started to harden, e.g. using wedges.</p>                                                                                                                                                                                                                                                                                                            |
| 12 |   | <p>Observe the working time "<math>t_{work}</math>" (see <b>table B6.1</b>), which varies according to temperature of base material. Minor adjustments to the rebar / fischer rebar anchor position may be performed during the working time</p> <p>Full load may be applied only after the curing time "<math>t_{cure}</math>" has elapsed (see <b>table B6.1</b>)</p>                                                                                            |
| 13 |  | <p>Mounting the fixture,<br/>max <math>T_{inst}</math> see <b>table A6.1</b></p>                                                                                                                                                                                                                                                                                                                                                                                   |

## Rebar connection with fischer injection system FIS EB II

### Intended Use

Installation instruction part 6, insert rebar / fischer rebar anchor

### Annex B 12

Appendix 19/22

## Minimum anchorage length and minimum lap length

The minimum anchorage length  $l_{b,min}$  and the minimum lap length  $l_{o,min}$  according to EN 1992-1-1:2004+AC:2010 shall be multiplied by the relevant amplification factor  $\alpha_{lb}$  according to **table C1.1**.

**Table C1.1:** Amplification factor  $\alpha_{lb}$  related to concrete strength class and drilling method

### Hammer drilling and compressed air drilling

| Rebar / fischer<br>rebar anchor<br><br>$\phi$ [mm] | Amplification factor $\alpha_{lb}$ |        |        |        |        |        |        |        |        |
|----------------------------------------------------|------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
|                                                    | Concrete strength class            |        |        |        |        |        |        |        |        |
|                                                    | C12/15                             | C16/20 | C20/25 | C25/30 | C30/37 | C35/45 | C40/50 | C45/55 | C50/60 |
| 8 to 32                                            | 1,0                                |        |        |        |        |        |        |        |        |

**Table C1.2:** Bond efficiency factor  $k_b$  for hammer drilling and compressed air drilling

### Hammer drilling and compressed air drilling

| Rebar / fischer<br>rebar anchor<br><br>$\phi$ [mm] | Bond efficiency factor $k_b$ |        |        |        |        |        |        |        |        |
|----------------------------------------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
|                                                    | Concrete strength class      |        |        |        |        |        |        |        |        |
|                                                    | C12/15                       | C16/20 | C20/25 | C25/30 | C30/37 | C35/45 | C40/50 | C45/55 | C50/60 |
| 8 to 32                                            | 1,0                          |        |        |        |        |        |        |        |        |

**Table C1.3:** Characteristic tensile yield strength for rebar part of fischer rebar anchors

| fischer rebar anchor FRA / FRA HCR                   |                      |                      | M12  | M16 | M20 | M24 |
|------------------------------------------------------|----------------------|----------------------|------|-----|-----|-----|
| Characteristic tensile yield strength for rebar part |                      |                      |      |     |     |     |
| Rebar diameter                                       | $\phi$               | [mm]                 | 12   | 16  | 20  | 25  |
| Characteristic tensile yield strength                | $f_{yk}$             | [N/mm <sup>2</sup> ] | 500  | 500 | 500 | 500 |
| Partial factor for rebar part                        | $\gamma_{Ms,N}^{1)}$ | [-]                  | 1,15 |     |     |     |

<sup>1)</sup> In absence of national regulations

**Table C1.4:** Characteristic resistance to steel failure under tension loading of fischer rebar anchors

| fischer rebar anchor FRA / FRA HCR                               |                      |      | M12 | M16 | M20 | M24 |
|------------------------------------------------------------------|----------------------|------|-----|-----|-----|-----|
| Characteristic resistance to steel failure under tension loading |                      |      |     |     |     |     |
| Characteristic resistance                                        | $N_{Rk,s}$           | [kN] | 62  | 111 | 173 | 263 |
| Partial factor                                                   |                      |      |     |     |     |     |
| Partial factor                                                   | $\gamma_{Ms,N}^{1)}$ | [-]  | 1,4 |     |     |     |

<sup>1)</sup> In absence of national regulations

### Rebar connection with fischer injection system FIS EB II

#### Performances

Amplification factor  $\alpha_{lb}$ , bond efficiency factor  $k_b$ , characteristic resistance to steel failure of fischer rebar anchors; characteristic tensile yield strength for rebar part

#### Annex C 1

Appendix 20/22

**Table C2.1:** Design values of the bond strength  $f_{bd,PIR}$  in N/mm<sup>2</sup> for hammer drilling, compressed air drilling

$$f_{bd,PIR} = k_b \cdot f_{bd}$$

$f_{bd}$ : Design value of the bond strength in N/mm<sup>2</sup> considering the concrete strength classes and the rebar diameter for good bond condition (for all other bond conditions multiply the values by  $\eta_1 = 0,7$ ) and recommended partial factor  $\gamma_c = 1,5$  according to EN 1992-1-1: 2004+AC:2010

$k_b$ : Bond efficiency factor according to **table C1.2**

**Hammer drilling and compressed air drilling**

| Rebar /<br>fischer rebar<br>anchor<br><br>$\phi$ [mm] | bond strength $f_{bd,PIR}$ [N/mm <sup>2</sup> ] |        |        |        |        |        |        |        |        |
|-------------------------------------------------------|-------------------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
|                                                       | Concrete strength class                         |        |        |        |        |        |        |        |        |
|                                                       | C12/15                                          | C16/20 | C20/25 | C25/30 | C30/37 | C35/45 | C40/50 | C45/55 | C50/60 |
| 8 to 32                                               | 1,7                                             | 2,0    | 2,3    | 2,7    | 3,0    | 3,4    | 3,7    | 4,0    | 4,3    |

**Table C2.2:** Characteristics resistance to **steel failure** for **fischer rebar anchors** under tension loading and fire exposure R30 to R120

| fischer rebar anchor FRA / FRA HCR                                                 |      |               |      | M12 | M16 | M20 | M24  |
|------------------------------------------------------------------------------------|------|---------------|------|-----|-----|-----|------|
| Characteristic resistance to steel failure under tension loading and fire exposure | R30  | $N_{Rk,s,fi}$ | [kN] | 2,5 | 4,7 | 7,4 | 10,6 |
|                                                                                    | R60  |               |      | 2,1 | 3,9 | 6,1 | 8,8  |
|                                                                                    | R90  |               |      | 1,7 | 3,1 | 4,9 | 7,1  |
|                                                                                    | R120 |               |      | 1,3 | 2,5 | 3,9 | 5,6  |

**Rebar connection with fischer injection system FIS EB II**

**Performances**

Design values of the bond strength  $f_{bd,PIR}$ ; characteristic resistance to steel failure for fischer rebar anchor  $N_{Rk,s,fi}$  under tension loading and fire exposure

**Annex C 2**

Appendix 21/22

**The bond strength  $f_{bd,fi}$  at increased temperature for concrete strength classes C12/15 to C50/60 (all drilling methods)**

The bond strength  $f_{bd,fi}$  at increased temperature has to be calculated by the following equation:

$$f_{bd,fi} = k_{fi}(\theta) \cdot f_{bd,PIR} \cdot \frac{\gamma_c}{\gamma_{m,fi}}$$


If:  $\theta > 49\text{ }^{\circ}\text{C}$        $k_{fi}(\theta) = \frac{39924 \cdot \theta^{-2,134}}{f_{bd,PIR} \cdot 4,3} \leq 1.0$

If:  $\theta > \theta_{max} (200\text{ }^{\circ}\text{C})$        $k_{fi}(\theta) = 0$

- $f_{bd,fi}$  = The bond strength at increased temperature in  $\text{N/mm}^2$
- $(\theta)$  = Temperature in  $^{\circ}\text{C}$  in the mortar layer
- $k_{fi}(\theta)$  = Reduction factor at increased temperature
- $f_{bd,PIR}$  = Design value of the bond strength in  $\text{N/mm}^2$  in cold condition according to table C2.1 considering the concrete strength classes, the rebar diameter, the drilling method and the bond conditions according to EN 1992-1-1:2004+AC:2010
- $\gamma_c$  = 1,5 recommended partial factor according to EN 1992-1-1:2004+AC:2010
- $\gamma_{m,fi}$  = 1,0 recommended partial factor

For evidence at increased temperature the anchorage length shall be calculated according to EN 1992-1-1:2004+AC:2010 Equation 8.3 using the temperature-dependent ultimate bond strength  $f_{bd,fi}$ .

**Figure C3.1:** Example of the graph of reduction factor  $k_{fi}(\theta)$  for concrete strength class C20/25 for good bond conditions

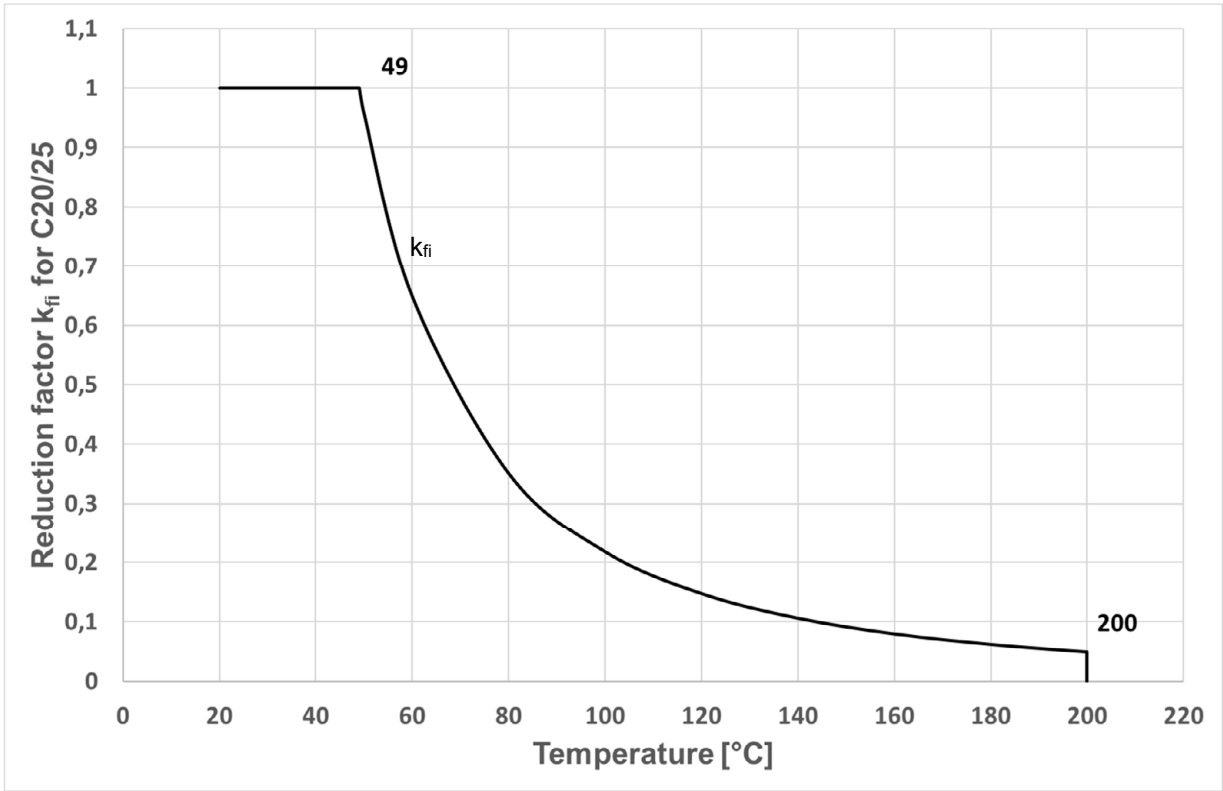

**Rebar connection with fischer injection system FIS EB II**

**Performances**

Design values of bond strength  $f_{bd,fi}$  at increased temperature

**Annex C 3**

Appendix 22/22