

Public-law institution jointly founded by the
federal states and the Federation

**European Technical Assessment Body
for construction products**



European Technical Assessment

**ETA-17/0737
of 10 April 2025**

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer Ceiling Anchor FDZ

Product family
to which the construction product belongs

Anchor for fastening redundant non-structural systems in
concrete

Manufacturer

fischerwerke GmbH & Co. KG
Klaus-Fischer-Straße 1
72178 Waldachtal
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment
contains

9 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330747-00-0601, Edition 06/2018

This version replaces

ETA-17/0737 issued on 30 January 2018

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The fischer Ceiling Anchor FDZ is an anchor made of galvanized steel which is placed into a drilled hole and anchored by deformation-controlled expansion.

Product and product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 1

3.2 Safety in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance for all load directions and modes of failure for simplified design	See Annex C 1
Durability	See Annex B 1

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330747-00-0601, the applicable European legal act is: [97/161/EC].

The system to be applied is: 2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 10 April 2025 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Ziegler

Product installation conditions, product marking and product dimensions


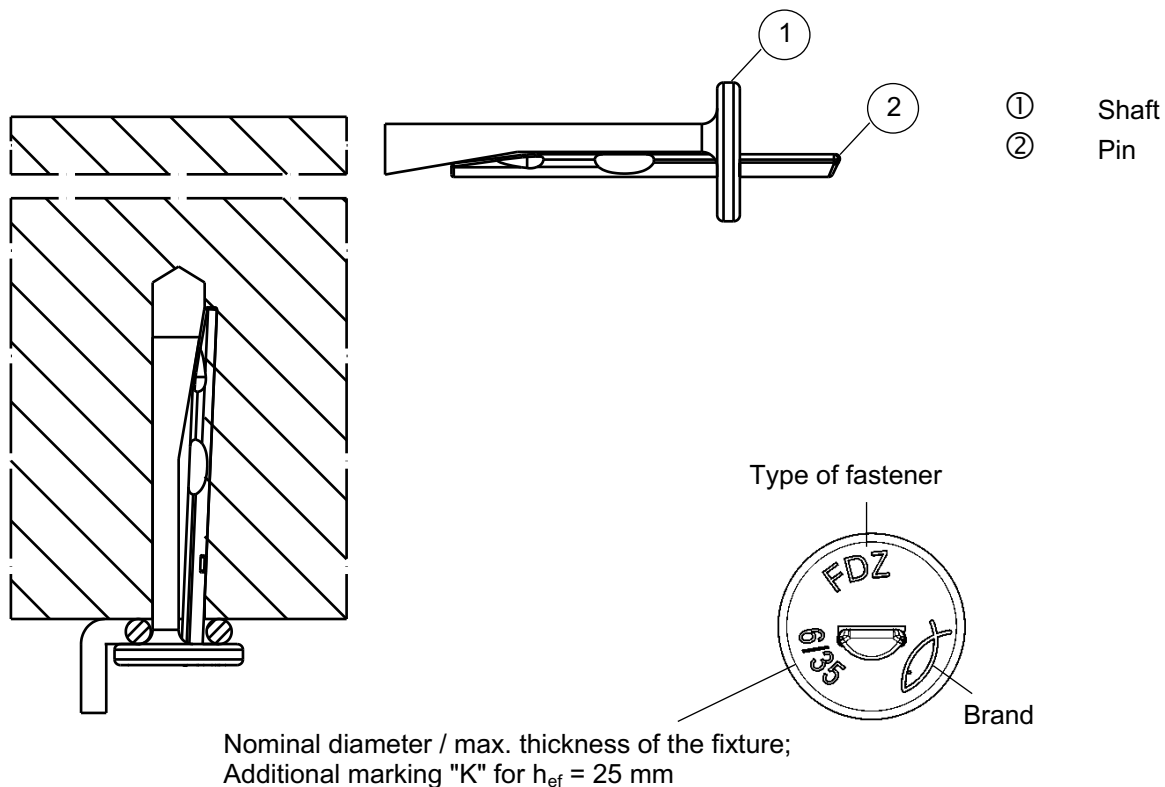


Tabelle A1.1: Materials

Part	Description	Material
1	Shaft	Steel, galvanised $\geq 5\mu\text{m}$ according to EN ISO 4042:2022
2	Pin	Steel, galvanised $\geq 5\mu\text{m}$ according to EN ISO 4042:2022

Table A1.2: Dimensions

		FDZ			
		6/5 K	6/5	6/35 K	6/35
Length of the	pin L_1	36	43	66	73
	shaft L_2 [mm]	30,5	37,5	60,5	67,5
Diameter of the head $D \geq$		13			

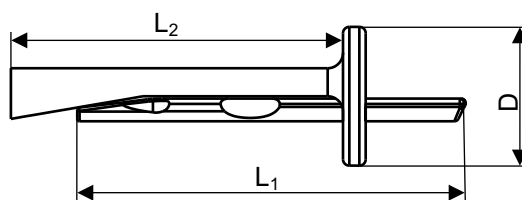

(Figures not to scale)

fischer Ceiling Anchor FDZ

Intended use

Product installation conditions, product marking and product dimensions

Annex A 1

Specifications of intended use

Anchorage subject to:

Size	FDZ 6
Static and quasi-static loads	✓
Only for redundant non-structural systems according to EN 1992-4:2018	
Fire exposure	

Base materials:

- Compacted reinforced and unreinforced normal weight concrete without fibres according to EN 206:2013+A2:2021.
- Strength classes C12/15 to C50/60 according to EN 206:2013+A2:2021.
- Cracked and uncracked concrete.

Use conditions (Environmental conditions):

- Anchorage subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings have to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loading are designed in accordance with EN 1992-4:2018, Design Method C or Technical Report CEN/TR 17079.
- In case of requirements to resistance to fire local spalling of the concrete cover must be avoided.

Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the fastener only as supplied by the manufacturer without exchanging the components of the fastener.
- Anchor installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Check of concrete being well compacted, e.g. without significant voids.
- Positioning of the drill holes without damaging the reinforcement.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of aborted hole or smaller distance if the aborted hole is filled with high strength mortar (e.g. FIS HB, FIS SB, FIS EM Plus, FIS V Plus) and if under shear or oblique tension load it is not on the direction of the load application.


fischer Ceiling Anchor FDZ

Intended use
Specifications

Annex B 1

Table B2.1: Installation parameters

Size			FDZ			
			6/5 K	6/5	6/35 K	6/35
Thickness of the fixture	t_{fix}	\leq	5		35	
Nominal drill hole diameter	d_0		6			
Diameter of clearance hole in the fixture	d_f	\leq	7			
Maximum drill bit diameter	$d_{\text{cut,max}}$		6,40			
Effective embedment depth	h_{ef}		25	32	25	32
Depth of drill hole to deepest point	with hole cleaning	h_1	30	37	30	37
	without hole cleaning		35	42	35	42
Minimum thickness of concrete member	h_{min}		80			

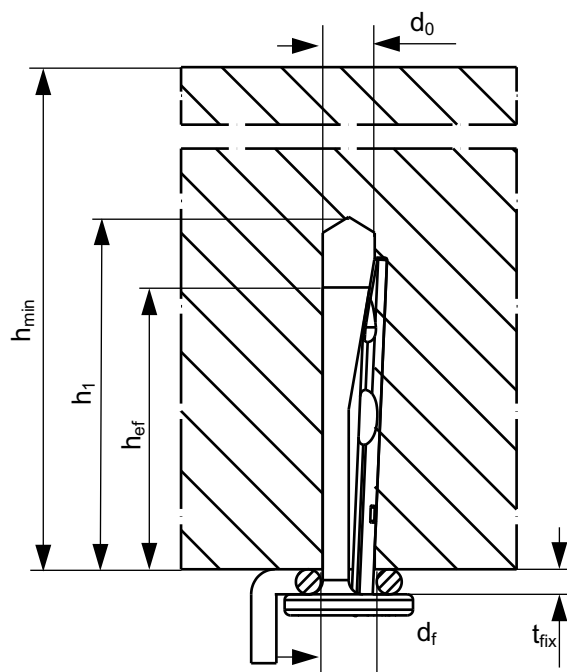

(Figure not to scale)

fischer Ceiling Anchor FDZ

Intended use

Installation parameters

Annex B 2







Installation instructions	
	1. Drill the hole: hammer or hollow drilling only.
	2. Clean the drill hole (only relates to hammer drilling).
	3. Cleaning of the drill hole not necessary, if the drill hole is 5 mm deeper (only relates to hammer drilling).
	4. Set the fastener: Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
	5. Set the pin, until flush to the surface: Positioning of the drill holes without damaging the reinforcement.
	6. Installed fastener: In case of aborted hole: New drilling at a minimum distance twice the depth of aborted hole away of or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of the load application.
(Figures not to scale)	
fischer Ceiling Anchor FDZ	
Intended use Installation instructions	Annex B 3

Table C1.1: Characteristic resistance for design method C

Size				FDZ 6	
For all load directions and for all failures modes					
Effective embedment depth		h_{ef}	[mm]	25	32
Characteristic resistance in cracked and uncracked concrete	C12/15	F_{Rk}	[kN]	1,0	1,5
	C20/25 to C50/60			1,5	2,0
Characteristic	edge distance	$c_{cr,N} = c_{min}$	[mm]	70	60
	spacing	$s_{cr,N} = s_{min}$		60	50
Partial safety factor			$\gamma_M^{2)}$	[-] 1,5	
Shear load with lever arm					
Characteristic bending resistance			$M_{Rk,s}^0$	[Nm]	4,4
Partial safety factor for steel failure			$\gamma_{Ms}^{1)}$	[-] 1,25	

¹⁾ In absence of other national regulations.

²⁾ The installation safety factor $\gamma_2 = \gamma_{inst} = 1,0$ is included.

Table C1.2: Characteristic resistance under fire exposure for all effective embedment depths

Size		FDZ 6	
For all load directions			
R30	$F_{Rk,fi30}$	[kN]	1,00
R60	$F_{Rk,fi60}$		0,50
R90	$F_{Rk,fi90}$		0,34
R120	$F_{Rk,fi120}$		0,26
R180	$F_{Rk,fi180}$		0,17
Spacing and edge distance			
R30 – R180	$s_{cr,fi}$	[mm]	200
	$c_{cr,fi}$		150
Shear load with lever arm			
R30	$M^0_{Rk,s,fi30}$	[Nm]	0,67
R60	$M^0_{Rk,s,fi60}$		0,33
R90	$M^0_{Rk,s,fi90}$		0,22
R120	$M^0_{Rk,s,fi120}$		0,16
R180	$M^0_{Rk,s,fi180}$		0,11

For fire exposure from one side c_{min} and s_{min} see Table C1.1.

For fire exposure from more than one side $c_{min} \geq 300$ mm.

fischer Ceiling Anchor FDZ

Performances

Characteristic resistance and
characteristic resistance under fire exposure

Annex C 1