



Technical and Test Institute for Construction Prague
 Prosecká 811/76a
 190 00 Prague
 Czech Republic
 tel.: +420 286 019 400
 www.tzus.cz



European Technical Assessment

**ETA-21/0857
 of 29/05/2026**

General Part

Technical Assessment Body issuing the ETA:

Technical and Test Institute for Construction Prague

Trade name of the construction product

fischer hollow ceiling anchor FHY

Product family to which the construction product belongs

Torque-controlled expansion anchor for use in concrete for redundant non-structural systems

Manufacturer

fischerwerke GmbH & Co. KG
 Klaus-Fischer-Straße 1, 72178 Waldachtal
 Germany

Manufacturing plant

fischerwerke

This European Technical Assessment contains

12 pages including 9 Annexes which form an integral part of this assessment

This European Technical Assessment is issued in accordance with Article 95(4) of Regulation (EU) 2024/3110, on the basis of

EAD 330747-00-0601
 Fasteners for use in concrete for redundant non-structural systems

This version replaces

ETA-21/0857 issued on 06/02/2022

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific parts

1. Technical description of the product

The Fischer hollow ceiling anchor FHY is a torque-controlled expansion anchor made of galvanised or stainless steel. It consists of an expansion sleeve and a cone with an internal thread and is anchored by torque-controlled expansion with a hexagon head bolt or threaded rod with nut and washer.

By tightening the screw/nut, the cone is pulled into the expansion sleeve and expanding it. The product description is given in Annex 1.

2. Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1 according to EN 13501-1
Resistance to fire	See Annex C2 and Annex C3

3.2 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance for all load directions and modes of failure for simplified design	See Annex C1
Durability	See Annex B1

4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the Decision 97/161/EC of the European Commission, the system of assessment verification of constancy of performance (see Annex IX to Regulation (EU) 2024/3110) is system 2+.

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Technical and Test Institute for Construction Prague.

Following standards will be referred to in this European Technical Assessment:

EN 1993-1-4:2025	Eurocode 3 - Design of steel structures - Part 1-4: Stainless steel structures
EN 1993-1-4/NA:2020	National Annex - Nationally determined parameters - Eurocode 3: Design of steel structures - Part 1-4: General rules - Supplementary rules for stainless steels
EN ISO 4042:2022	Fasteners - Electroplated coating systems
EN ISO 898-1:2013	Mechanical properties of fasteners made of carbon steel and alloy steel - Part 1: Bolts, screws and studs with specified property classes - Coarse thread and fine pitch thread
EN ISO 898-2:2022	Fasteners - Mechanical properties of fasteners made of carbon steel and alloy steel - Part 2: Nuts with specified property classes
EN 13501-1:2018	Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests
EN ISO 3506-1:2020	Fasteners - Mechanical properties of corrosion-resistant stainless steel fasteners - Part 1: Bolts, screws and studs with specified grades and property classes
EN ISO 3506-2:2020	Fasteners - Mechanical properties of corrosion-resistant stainless steel fasteners - Part 2: Nuts with specified grades and property classes
EN 10139:2016+A1:2020	Cold rolled uncoated low carbon steel narrow strip for cold forming - Technical delivery conditions
EN ISO 683-7:2024	Heat-treatable steels, alloy steels and free-cutting steels - Part 7: Bright products of non-alloy and alloy steels
EN 10088-1:2023	Stainless steels - Part 1: List of stainless steels;
EN 10088-2:2024	Stainless steels - Part 2: Technical delivery conditions for sheet/plate and strip of corrosion resistant steels for general purposes
EN ISO 4017:2022	Fasteners - Hexagon head screws - Product grades A and B
EN 206:2013+A2:2021	Concrete - Specification, performance, production and conformity


Issued in Prague on 29.05.2026

By

Ing. Jiří Studnička, Ph.D.



Head of the Technical Assessment Body



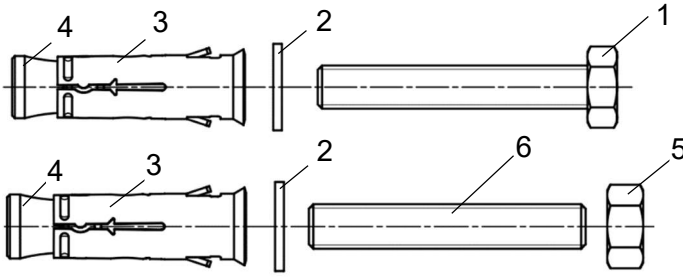

- 1 Hexagon screw
- 2 Washer
- 3 Expansion sleeve
- 4 Cone nut
- 5 Hexagon nut
- 6 Threaded rod

Installed conditions:

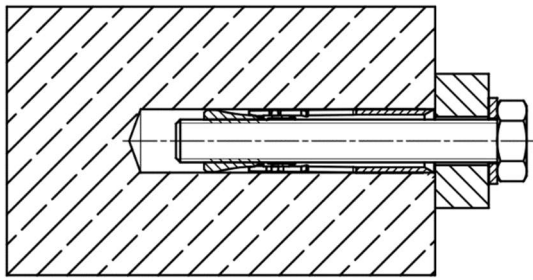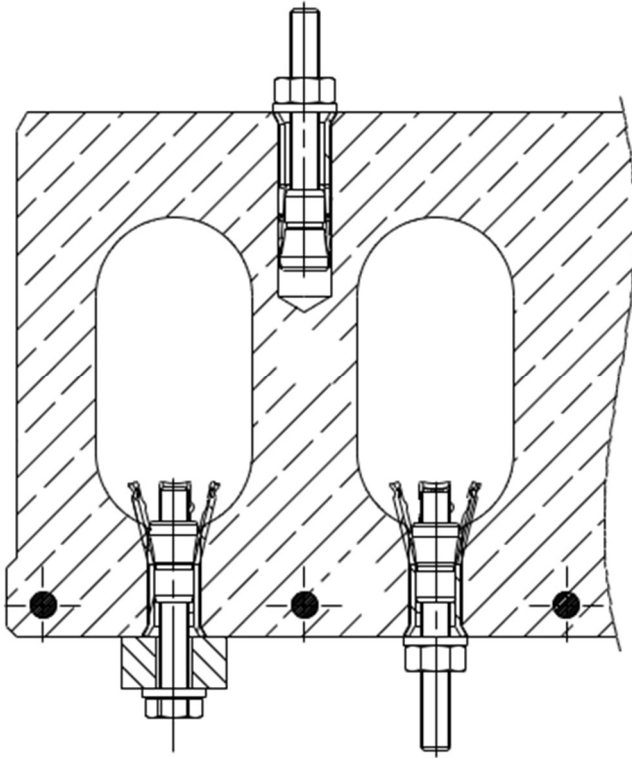


Figures not to scale

fischer hollow ceiling anchor FHY

Product description
Installed conditions

Annex A1

Product marking and dimensions:

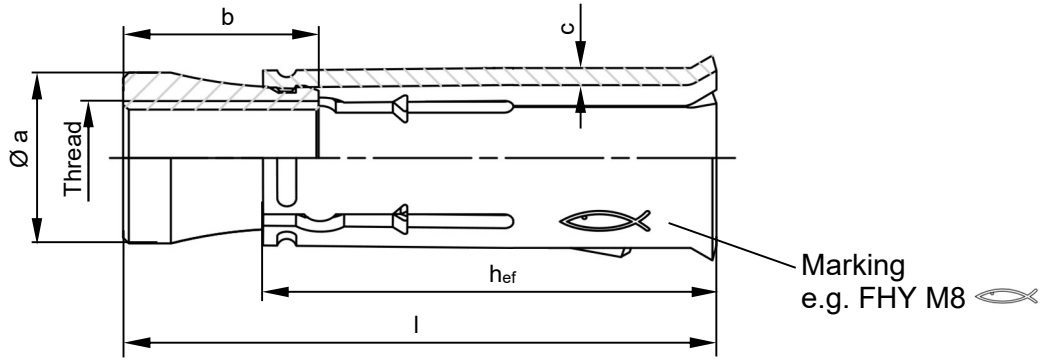

FHY: Carbon steel, galvanised
 FHY R: Stainless steel

Table A2.1: Dimensions [mm]

Typ	h_{ef}	Thread	$\varnothing a$	b	c	l
FHY M6	30	M6	9,6	12,0	1,0	37
FHY M8	35	M8	11,5	13,1	1,0	43
FHY M10	40	M10	15,0	17,2	1,5	52
FHY M12	40	M12	17,0	20,85	1,5	55

Table A2.2: Designations and materials FHY

Part	Designation	Material	
		FHY	FHY R
	Type of steel	Steel Zinc plated $\geq 5 \mu\text{m}$, EN ISO 4042	Stainless steel R Acc. to EN 10088 Corrosion resistance class CRC III acc. to EN 1993-1-4 and with EN 1993-1-4/NA
1	Hexagon screw ¹⁾	Steel, EN ISO 898-1 property class 8.8 (M6); property class 4.6, 5.8 or 8.8 (M8, M10 and M12)	EN ISO 3506-1 property class ≥ 70
2	Washer ¹⁾	Cold strip, EN 10139	Stainless steel EN 10088
3	Expansion sleeve	Cold strip, EN 10139	
4	Cone nut	Steel EN ISO 683-7	
5	Hexagon nut ¹⁾	Steel EN ISO 898-2 property class 8 (M6); 4 or 5 or 8 (M8, M10 and M12)	Stainless steel EN ISO 3506-2 property class ≥ 70
6	Threaded rod ¹⁾	Steel EN ISO 898-1, property class 8.8 (M6); 4.8, 5.8 or 8.8 (M8); 4.6, 5.8 or 8.8 (M10 and M12)	Stainless steel EN ISO 3506-1; property class ≥ 70

¹⁾ Commercial threaded rods, washers, hexagon nuts and hexagon screws may also be used if the requirements in Table A2.2 are fulfilled. The strength of threaded parts in accordance with EN ISO 898-1 must be specified by the design engineer according to Table C1.1.

Figure not to scale



fischer hollow ceiling anchor FHY

Product description
 Product label and dimensions

Annex A2

Specifications of intended use

Fastenings subject to:

Size	FHY, FHY R			
	M6	M8	M10	M12
Hammer drilling with standard drill bit 			✓	
Hammer drilling with hollow drill bit with automatic cleaning 			✓	
Static and quasi-static loads				
Cracked and uncracked concrete			✓	
Fire exposure				

Base materials:

- Compacted reinforced and unreinforced normal weight concrete without fibres (cracked and uncracked) according to EN 206.
- Strength classes \geq C20/25 according to EN 206.
- Pre-stressed hollow core slabs, where the cavity width does not exceed 4,2 times the web width ($b_H \leq 4,2 \times b_{St}$) with strength classes \geq C45/55.

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (FHY, FHY R)
- For all other conditions according to EN 1993-1-4 corresponding to corrosion resistance class
 - CRC III: FHY R

Design:

- Fastenings are to be designed under the responsibility of an engineer experienced in fastenings and concrete work
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e.g. position of the fastener relative to reinforcement or to supports, etc.).
- Design under static or quasi-static actions shall be performed in accordance with EN 1992-4, design method B.

Figures not to scale

fischer hollow ceiling anchor FHY

Intended use
Specifications

Annex B1



Table B2.1: Installation parameters

Size	FHY, FHY R			
	M6	M8	M10	M12
Nominal drill hole diameter $d_0 =$	10	12	16	18
Effective embedment depth $h_{ef} \geq$	30	35	40	40
Depth of drill hole to deepest point $h_1 \geq$	50	60	65	70
Diameter of clearance hole in the fixture $d_f \leq$	7	9	12	14
Length of screw ¹⁾ $l_s \geq$	37 + t_{washer} + t_{fix}	43 + t_{washer} + t_{fix}	52 + t_{washer} + t_{fix}	55 + t_{washer} + t_{fix}
Length of the threaded bolt $l_b \geq$	42 + t_{washer} + t_{fix}	50 + t_{washer} + t_{fix}	60 + t_{washer} + t_{fix}	65 + t_{washer} + t_{fix}
Required setting torque $T_{inst} =$	8	10	20	30
	15	20	40	50

¹⁾ For screws with shaft according to EN ISO 4017 the shaft length must be $\leq t_{fix}$

Pre-stressed hollow core slab \geq C45/55 web thickness \geq 25mm				
Minimum spacing $s_{min} \geq$		70	70	80
Minimum edge distance $c_{min} \geq$		100	100	150
Solid concrete \geq C20/25				
Minimum spacing $s_{min} \geq$		70	70	80
Minimum edge distance $c_{min} \geq$		100		
Minimum thickness of concrete member $h_{min} \geq$		100		

Anchoring in pre-stressed hollow core slabs and in solid material

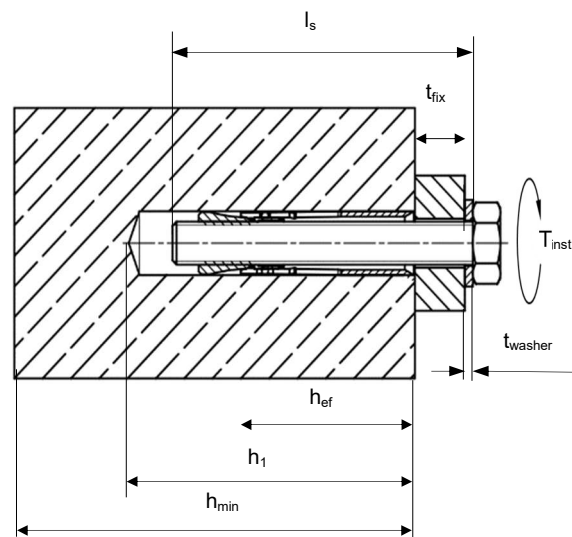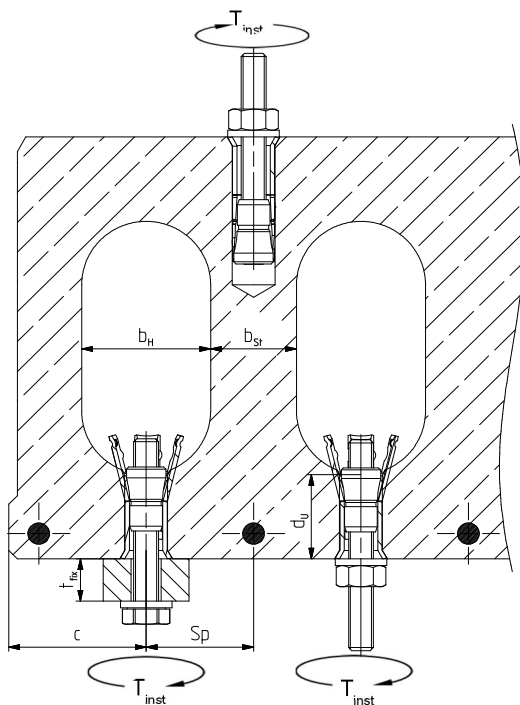


- s_p = Distance to the tensioning strands
- t_{fix} = Thickness of fixture
- d_u = Thickness of the slab web
- c = Edge distance
- T_{inst} = Installation moment
- b_H = Cavity width
- b_{st} = Web thickness

Figures not to scale


fischer hollow ceiling anchor FHY	Annex B2
Intended use Installation parameters	

Picture B3.1: Anchoring in pre-stressed hollow core slab – Anchoring condition: $b_H \leq 4,2 \times b_{St}$

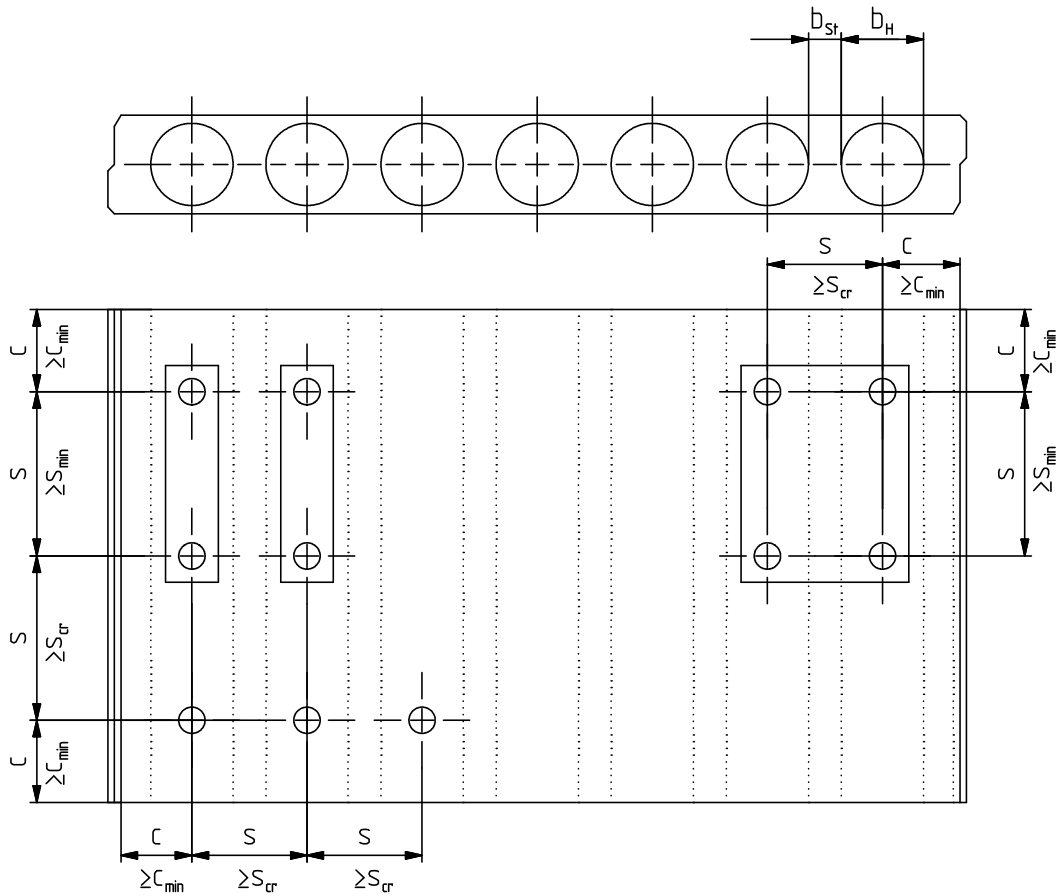

s_{min} and c_{min} see Annex B2 – s_{cr} see Annex C1.

Picture B3.2: Minimum distance S_p to the tensioning strand

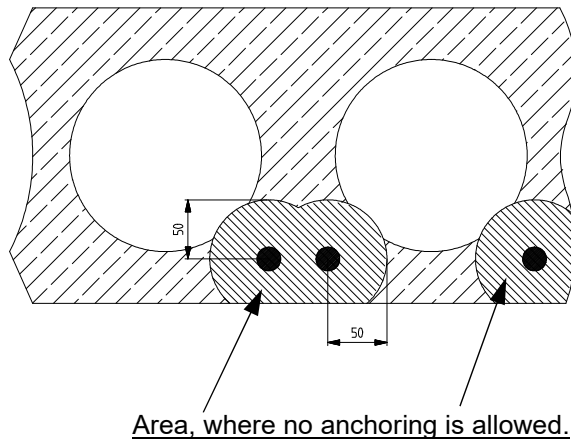

The anchor must have a distance from the anchor axis to the tensioning strands of at least 50 mm.

Figures not to scale


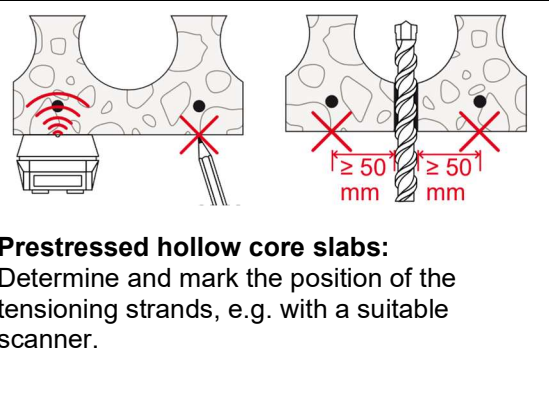
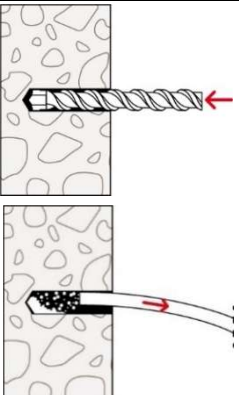

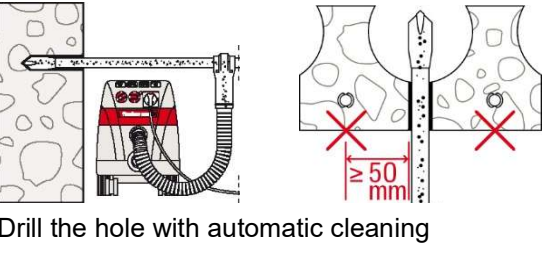
fischer hollow ceiling anchor FH Y

Intended use
Installation parameters





Annex B3

Installation instructions:

- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on the site.
- Hammer or hollow drilling.
- Drill hole created perpendicular +/- 5° to concrete surface, positioning without damaging the reinforcement.
- In case of aborted hole: new drilling at a minimum distance twice the depth of the aborted drill hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.
- In Precast pre-stressed hollow core slabs the anchor FHY may be installed from all directions, if the web thicknesses is $\geq 25\text{mm}$ and the spacing to the tensioning strands of $\geq 50\text{mm}$ is observed (also in the area of solid material).

<p>1a) Hammer drill (e.g. fischer Quattric II)</p>		 <p>Prestressed hollow core slabs: Determine and mark the position of the tensioning strands, e.g. with a suitable scanner.</p>	<p>Solid material/solid areas of hollow core slabs</p> 
<p>1b) Hollow drill (e.g. fischer FHD)</p>		 <p>Drill the hole with automatic cleaning</p>	<p>-</p>

Installation of the fastener (exemplary in a pre-stressed hollow core slabs)

			
<p>Set the fastener</p>	<p>Fixation of fixture</p>	<p>Apply T_{inst}</p>	<p>Installed fastener</p>

Figures not to scale

fischer hollow ceiling anchor FHY

Intended use
Installation instructions

Annex B4

Table C1.1: Characteristic resistance for all load directions						
Size		FHY, FHY R				
		M6	M8	M10	M12	
Concrete solid material						
Characteristic resistance in C20/25	F^{0}_{Rk} [kN]	3,0	6,5	8,5	8,5	
Partial factor	γ_{Mc} [-]	1,5	1,5	1,5	1,5	
Characteristic spacing	S_{cr}	200	200	200	200	
Characteristic edge distance	C_{cr} [mm]	100	105	120	120	
Pre-stressed hollow core slab \geq C45/55						
Characteristic resistance	$d_u \geq 25 \text{ mm} < 30 \text{ mm}$	F^{0}_{Rk} [kN]	5,0	7,0	8,0	9,0
	$d_u \geq 30 \text{ mm} < 40 \text{ mm}$		5,0	7,0	10,0	9,0
	$d_u \geq 40 \text{ mm}$		5,0	7,0	10,0	10,0
Partial factor	γ_{Mc} [-]	1,5	1,5	1,5	1,5	
Characteristic spacing	$d_u \geq 25 \text{ mm} < 30 \text{ mm}$	S_{cr}	200	200	200	200
	$d_u \geq 30 \text{ mm} < 40 \text{ mm}$		200	200	200	200
	$d_u \geq 40 \text{ mm}$		200	200	200	200
Characteristic edge distance	$d_u \geq 25 \text{ mm} < 30 \text{ mm}$	C_{cr}	100	100	100	150
	$d_u \geq 30 \text{ mm} < 40 \text{ mm}$		100	100	100	150
	$d_u \geq 40 \text{ mm}$		100	105	120	150
Characteristic bending moment (screw)						
FHY	Property class	4.6	-2)	15,0	29,9	52,4
		4.8	-2)	-2)	-2)	-2)
		5.8	-2)	18,7	37,4	65,5
		8.8	12,2	30,0	62,3	109,2
FHY R	\geq A4-70	10,7	26,4	52,3	91,7	
FHY	Partial factor for property class	4.6	-2)	1,67		
		4.8 / 5.8	-2)	1,25		
		8.8	1,25			
FHY R	\geq A4-70	1,56				
Characteristic bending moment (threaded rod)						
FHY	Property class	4.6	-2)	-2)	29,9	52,4
		4.8	-2)	15,0	-2)	-2)
		5.8	-2)	18,7	37,4	65,5
		8.8	12,2	30,0	62,3	109,2
FHY R	\geq A4-70	10,7	26,4	52,3	91,7	
FHY	Partial factor for property class	4.6	-2)	1,67		
		4.8 / 5.8	-2)	1,25		
		8.8	1,25			
FHY R	\geq A4-70	1,56				
1) In absence of other national regulations. 2) No Performance assessed.						
fischer hollow ceiling anchor FHY				Annex C1		
Performances Characteristic resistance for all load directions						

Table C2.1: Characteristic resistance under fire exposure for concrete solid material for all load directions

Size			FHY			
			M6	M8	M10	M12
Characteristic resistance for all load directions Concrete solid material	$F_{Rk,fi}$ [kN]	R30	0,75	1,25	1,74	1,74
		R60	0,58	1,25	1,74	1,74
		R90	0,38	0,80	1,30	1,74
		R120	0,28	0,57	0,96	1,39
Characteristic resistance for shear load with lever arm Concrete solid material	$M^0_{Rk,fi}$ [Nm]	R30	0,60	1,80	3,40	6,00
		R60	0,40	1,30	2,50	4,50
		R90	0,30	0,80	1,70	2,90
		R120	0,20	0,60	1,20	2,20
Size			FHY R			
			M6	M8	M10	M12
Characteristic resistance for all load directions Concrete solid material	$F_{Rk,fi}$ [kN]	R30	0,75	1,25	1,74	1,74
		R60	0,75	1,25	1,74	1,74
		R90	0,75	0,96	1,06	1,54
		R120	0,60	0,48	0,69	1,00
Characteristic resistance for shear load with lever arm Concrete solid material	$M^0_{Rk,fi}$ [Nm]	R30	1,90	2,90	3,30	5,70
		R60	1,30	2,00	2,30	4,10
		R90	0,80	1,00	1,40	2,40
		R120	0,50	0,50	0,90	1,60
fischer hollow ceiling anchor FHY			Annex C2			
Performances Characteristic values of resistance under fire exposure for concrete solid material						

Table C3.1: Characteristic resistance under fire exposure for pre-stressed hollow core slabs for all load directions

Size		FHY				
		M6	M8	M10	M12	
Characteristic resistance for all load directions Pre-stressed hollow core slabs	$d_u \geq 25 \text{ mm} < 30 \text{ mm}$	R30	0,78	1,15	1,15	1,15
		R60	0,58	1,15	1,15	1,15
		R90	0,38	0,80	1,15	1,15
		R120	0,28	0,57	0,92	0,92
	$d_u \geq 30 \text{ mm} < 40 \text{ mm}$	R30	0,78	1,52	1,52	1,52
		R60	0,58	1,26	1,52	1,52
		R90	0,38	0,80	1,30	1,52
		R120	0,28	0,57	0,96	1,21
	$d_u \geq 40 \text{ mm}$	R30	0,78	1,71	2,33	2,33
		R60	0,58	1,26	1,98	2,33
		R90	0,38	0,80	1,30	1,89
		R120	0,28	0,57	0,96	1,39
Characteristic resistance for shear load with lever arm Pre-stressed hollow core slabs $d_u \geq 25 \text{ mm}$	R30	0,60	1,80	3,40	6,00	
	R60	0,40	1,30	2,50	4,50	
	R90	0,30	0,80	1,70	2,90	
	R120	0,20	0,60	1,20	2,20	
Size		FHY-R				
		M6	M8	M10	M12	
Characteristic resistance for all load directions Pre-stressed hollow core slabs	$d_u \geq 25 \text{ mm} < 30 \text{ mm}$	R30	1,15	1,15	1,15	1,15
		R60	1,15	1,15	1,15	1,15
		R90	1,04	0,96	1,06	1,15
		R120	0,68	0,48	0,69	0,92
	$d_u \geq 30 \text{ mm} < 40 \text{ mm}$	R30	1,52	1,52	1,52	1,52
		R60	1,52	1,52	1,52	1,52
		R90	1,04	0,96	1,06	1,52
		R120	0,68	0,48	0,69	1,00
	$d_u \geq 40 \text{ mm}$	R30	1,52	1,91	2,33	2,33
		R60	1,52	1,91	1,80	2,33
		R90	1,04	0,96	1,06	1,54
		R120	0,68	0,48	0,69	1,00
Characteristic resistance for shear load with lever arm Pre-stressed hollow core slabs $d_u \geq 25 \text{ mm}$	R30	1,90	2,90	3,30	5,70	
	R60	1,30	2,00	2,30	4,10	
	R90	0,80	1,00	1,40	2,40	
	R120	0,50	0,50	0,90	1,60	
fischer hollow ceiling anchor FHY					Annex C3	
Performances Characteristic resistance under fire exposure for pre-stressed hollow core slabs						