



ETA-Danmark A/S
Göteborg Plads 1
DK-2150 Nordhavn
Tel. +45 72 24 59 00
Internet www.etadanmark.dk

Authorized and notified according
to Article 29 of the Regulation (EU)
No 305/2011 of the European
Parliament and of the Council of
9 March 2011

MEMBER OF EOTA



European Technical Assessment ETA-26/0168 of 2026/06/23

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:

fischer HybridPower

Product family to which the above construction product belongs:

Plastic anchors for redundant non-structural systems in concrete and masonry

Manufacturer:

fischerwerke GmbH & Co. KG,
Klaus Fischer Strasse 1
DE-72178 Waldachtal

Manufacturing plant:

fischerwerke

This European Technical Assessment contains:

29 pages including 23 annexes which form an integral part of the document

This European Technical Assessment is issued in accordance with Article 95(4) of Regulation (EU) 2024/3110, on the basis of:

EAD 330284-00-0604-v01, Plastic anchors for redundant non-structural systems for use in concrete and masonry under fire exposure

This version replaces:

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of product

The fischer HybridPower is a plastic anchor consisting of a plug sleeve made of polyamide combined with a metal skeleton (power wedge), and a special screw made of either galvanized steel with an additional organic coating or stainless steel according to Annex A3. The anchor is available with two different head types; a hexagon head (type FUS) and a countersunk head (type T).

The anchors are intended for use in several base materials; cracked and uncracked concrete of strength classes ranging from C12/15 to C50/60, masonry units (solid and hollow or perforated) and unreinforced or reinforced auto aerated concrete.

The following service temperature ranges are applied for:

- T1: -20°C/50°C
- T2: -20°C/80°C

The anchor is screwed into a predrilled cylindrical drill hole, and the power wedges interlock with the base material ensuring a secure anchorage.

The product description is given in Annex A and the intended use specifications of the product are detailed in Annex B.

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the anchor of 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

Characteristic	Assessment of characteristic
----------------	------------------------------

3.1 Safety in case of fire (BWR2)

Reaction to fire	Class A1
Resistance to fire (base material group a)	Annex C14
Resistance to fire (base material group b, c and d)	Annex C15

3.2 Mechanical resistance and stability (BWR4)

Resistance to steel failure under tension loading	Annex C1
Resistance to steel failure under shear loading	Annex C1
Resistance to pull-out or concrete failure or polymer failure under tension loading (base material group a)	Annex C1
Resistance in any load direction without lever arm (base material group b, c and d)	Annex C7 to C13
Edge distance and spacing (base material group a)	Annex B2
Edge distance and spacing (base material group b, c and d)	Annex B3 and B4
Displacements under short-term and long-term loading	Annex C1

3.3 Aspects of durability

Durability	Annex B1
------------	----------

See additional information in section 3.4

3.4 General aspects related to the performance of the product

The European Technical Assessment is issued for the product on the basis of agreed data/information, deposited with ETA-Danmark, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, should be notified to ETA-Danmark before the changes are introduced. ETA-Danmark will decide whether or not such changes affect the ETA and consequently the validity of the CE marking on the basis of the ETA and if so whether further assessment or alterations to the ETA, shall be necessary.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base.

4.1 AVCP system

According to the decision 1997/463/EC of the European Commission, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No. 305/2011) is 2+.

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking.

The following standards and documents are referred to in this European Technical Assessment:


- EOTA European Assessment Document EAD 330284-00-0604-v01: Plastic anchors for redundant non-structural systems for use in concrete and masonry under fire exposure
- EOTA Technical Report TR 051, 2018-04: Recommendations for job site tests of plastic anchors and screws
- EOTA Technical Report TR 064, 2018-05, amended 01/2023: Design of plastic anchors in concrete and masonry
- EN 206:2013+A1:2016: Concrete – Specification, performance, production and conformity
- EN 771-1:2011+A1:2015: Specification for masonry units – Part 1: Clay masonry units
- EN 771-2:2011+A1:2015: Specification for masonry units – Part 2: Calcium silicate
- EN 771-3:2011+A1:2015: Specification for masonry units – Part 3: Aggregate concrete masonry units (dense and lightweight aggregates)
- EN 771-4:2011+A1:2015: Specification for masonry units – Part 4: autoclaved aerated concrete masonry units
- EN 998-2:2010: Specification for mortar for masonry - Part 2: Masonry mortar
- EN 12602:2016: Prefabricated reinforced components of autoclaved aerated concrete
- EN 1993-1-4:2025: Design of steel structures - Part 1-4: General rules -
- EN ISO 4042:2022: Fasteners – Electroplated coating systems

Issued in Copenhagen on 2026-06-23 by



Thomas Bruun
Managing Director, ETA-Danmark

fischer HybridPower

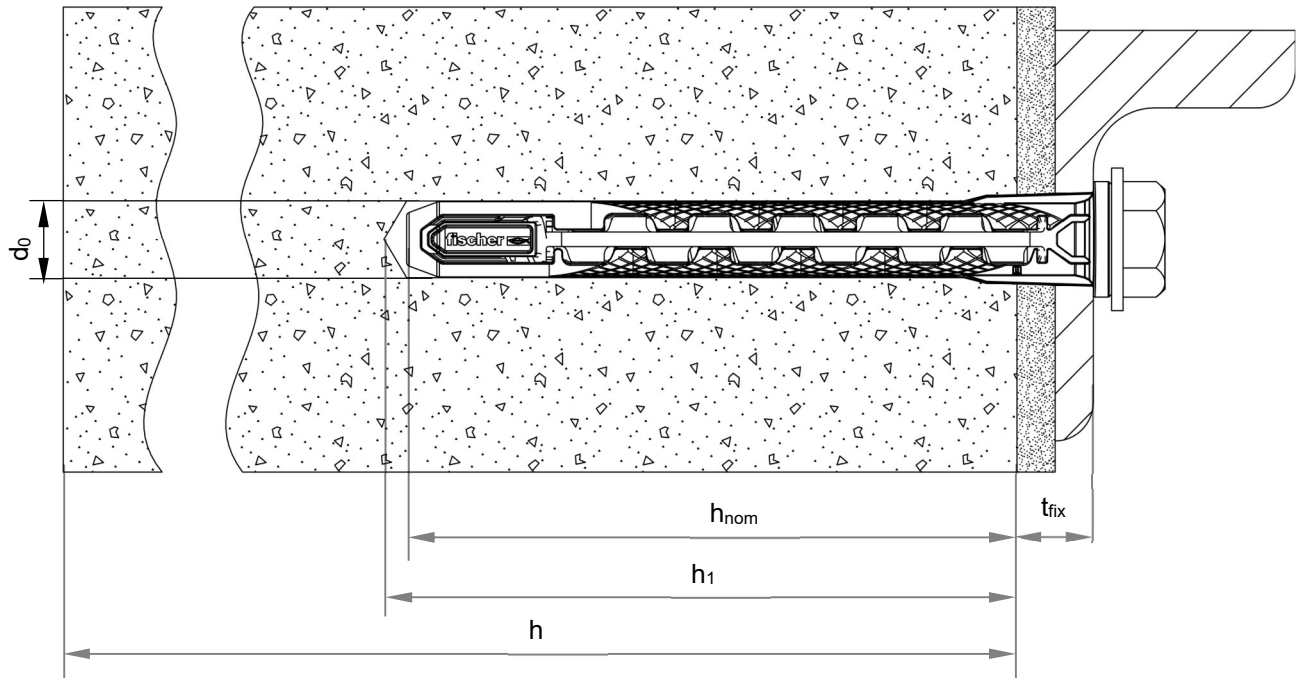

Legend

- d_0 = Nominal drill hole diameter
- h_{nom} = Overall plastic anchor embedment depth in the base material
- h_1 = Depth of drill hole to deepest point
- h = Thickness of member (wall)
- t_{fix} = Thickness of fixture and / or non-load bearing layer


Figure not to scale

fischer HybridPower

Product description
Installed anchor


Annex A1

Anchor sleeve – HybridPower

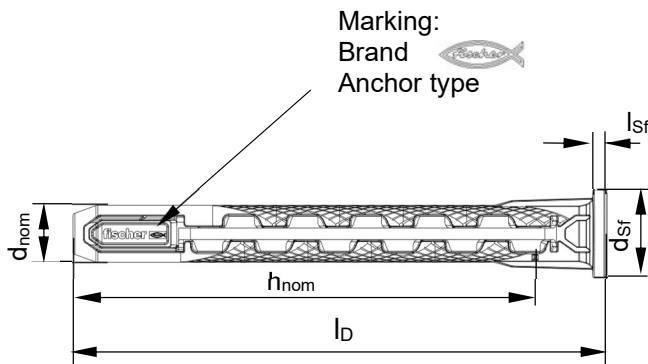


Special screws

Countersunk screw

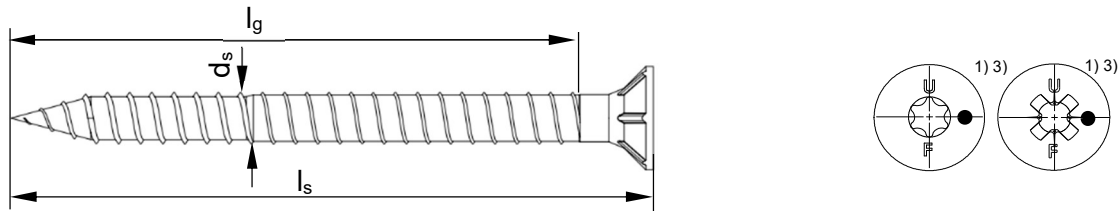

Hexagonal screw with washer

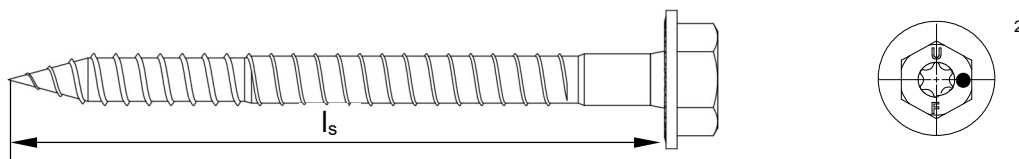

- 1) Additional marking for the special screw, stainless steel version: e.g. "A4" resp. "R" or "A2".
- 2) Internal driving feature for Torx bit is optional for hexagonal head.
- 3) Optional additional version with underhead ribs.

Table A2.1: Dimensions

Anchor type	Anchor sleeve						Special screw		
	h_{nom} [mm]	d_{nom} [mm]	t_{fix} [mm]	l_D [mm]	l_{sf} [mm]	d_{sf} [mm]	d_s [mm]	l_G [mm]	l_s [mm]
HybridPower FUS	80	10	≥ 1	90-230	2,5	15	7,0	77	l_D
HybridPower T	80	10	≥ 1	90-230	2,5	15	7,0	77	l_D

Legend

- h_{nom} = Overall plastic anchor embedment depth in the base material
- d_{nom} = Nominal diameter of the anchor sleeve
- t_{fix} = Thickness of fixture and / or non-load bearing layer
- l_D = Length of the anchor sleeve
- l_{sf} = Thickness of the anchor sleeve collar
- d_{sf} = Diameter of the anchor sleeve collar
- d_s = Diameter of the screw
- l_G = Thread length of the screw
- l_s = Length of the screw

Figures not to scale

fischer HybridPower

Product description
Anchor type, special screws
Marking and dimensions

Annex A2

Table A3.1: Materials	
Name	Material
Hybrid anchor sleeve	- Polyamide, PA6, colour: red
Skeleton	- Ferritic stainless steel
Special screw	- Galvanised steel gvz with Zn5/Ag or Zn5/An in accordance with EN ISO 4042 with additional organic layer (Zn5/Ag/T7 or Zn5/An/T7, resp. total layer thickness $\geq 6 \mu\text{m}$) or - Stainless steel "A2" of corrosion resistance class CRC II in accordance with EN 1993-1-4 or - Stainless steel "A4" or "R" of corrosion resistance class CRC III in accordance with EN 1993-1-4
fischer HybridPower	Annex A3
Product description Materials	

Specifications of intended use

Anchorage subject to:

- Static and quasi-static loads.
- Redundant non-structural systems.
- Fire exposure in reinforced or unreinforced compacted normal weight concrete without fibres, strength classes $\geq C20/25$ as per EN 206 and solid brick masonry with mean compressive strength $\geq 5 \text{ N/mm}^2$ as per EN 771, see Annex C14 and Annex C15.

Base materials:

- Reinforced or unreinforced compacted normal weight concrete without fibres, strength classes $\geq C12/15$ (base material group “a”), in accordance with EN 206-1, see Annex C1 and C2.
- Solid brick masonry (base material group “b”) as per EN 771-1, EN 771-2 or EN 771-3, see Annex C2, C7 and C8.
Note: The characteristic resistance is also valid for larger brick sizes and higher compressive strength of the masonry unit.
- Hollow or perforated brick masonry (base material group “c”), as per EN 771-1, EN 771-2 or EN 771-3, see Annex C3 – C6 and C8 – C12.
- Unreinforced autoclaved aerated concrete (base material group “d”) as per EN 771-4 and reinforced autoclaved aerated concrete (base material group “d”) as per EN 12602, see Annex C2 and C13.
- Mortar strength class of the masonry $\geq M2,5$ in accordance with EN 998-2.
- For other comparable base materials of the base material group “a”, “b”, “c” and “d” the characteristic resistance of the anchor may be determined by job site tests in accordance with TR 051.

Temperature Range:

- c: - 20 °C to 50 °C (max. short term temperature + 50 °C and max. long term temperature + 30 °C)
- b: - 20 °C to 80 °C (max. short term temperature + 80 °C and max. long term temperature + 50 °C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions: Special screw made of zinc coated steel or stainless steel.
- The specific screw made of galvanised steel or galvanised steel with an additional organic layer may also be used in structures subject to external atmospheric exposure, if the area of the head of the screw is protected against moisture and driving rain after mounting of the fixing unit in this way, that intrusion of moisture into the anchor shaft is prevented. Therefore, there shall be an external cladding or a ventilated rainscreen mounted in front of the head of the screw and the head of the screw itself shall be coated with a soft plastic, permanently elastic bitumen-oil-combination coating (e.g. undercoating or body cavity protection for cars).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist: Special screw made of stainless steel of corrosion resistance class CRC III.
Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Design:

- The anchorages are to be designed in accordance with TR 064 under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials and the dimensions of the anchorage members as well as of the relevant tolerances. The position of the anchor is indicated on the design drawings.

Installation:

- Hole drilling by the drilling method in accordance with Annex C1 for base material group “a”, and in accordance with Annexes C7 – C13 for base material group “b”, “c” and “d”.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature: - 20 °C to + 40 °C.
- Exposure to UV due to solar radiation of the anchor not protected by rendering ≤ 6 weeks.
- No ingress of water in the borehole at temperatures $< 0 \text{ }^\circ\text{C}$.

fischer HybridPower

**Intended use
Specifications**

Annex B1

Table B2.1: Installation parameters

Anchor type		HybridPower, HybridPower A2, HybridPower A4, HybridPower R
Nominal drill hole diameter	$d_0 =$ [mm]	10
Cutting diameter of drill bit	$d_{cut} \leq$ [mm]	10,45
Overall plastic anchor embedment depth in the base material	$h_{nom} \geq$ [mm]	80
Depth of drill hole to deepest point	$h_1 \geq$ [mm]	90
Diameter of clearance hole in the fixture	$d_f \leq$ [mm]	10,50 ¹⁾

¹⁾ In combination of hexagon screw with washer and anchor sleeve, use in elongated hole under tensile load is allowed.

Table B2.2: Minimum thickness of member, spacing and edge distances in concrete – base material group “a”

Anchor Type [-]	Embedment depth h_{nom} [mm]	Strength class [-]	Minimum thickness of member h_{min} [mm]	Charac- teristic edge distance	Charac- teristic spacing	Minimum spacing and edge distances ¹⁾ s_{min}, c_{min} [mm]
				$c_{cr, N}$ [mm]	$s_{cr, N}$ [mm]	
HybridPower, HybridPower A2, HybridPower A4, HybridPower R	80	C12/15	100	70	105	$s_{min} = 70$ for $c \geq 70$ $c_{min} = 70$ for $s \geq 70$
		$\geq C16/20$		50	75	$s_{min} = 50$ for $c \geq 50$ $c_{min} = 50$ for $s \geq 50$

¹⁾ Intermediate values by linear interpolation.

Fixing points with spacing $a \leq s_{cr,N}$ are considered as a group with a maximum characteristic resistance $N_{Rk,p}$ as per Table C1.2. For a spacing $a > s_{cr,N}$ the anchors are considered as single anchors, each with characteristic resistance $N_{Rk,p}$ as per Table C1.2.

Scheme of spacing and edge distances in concrete, base material group “a”

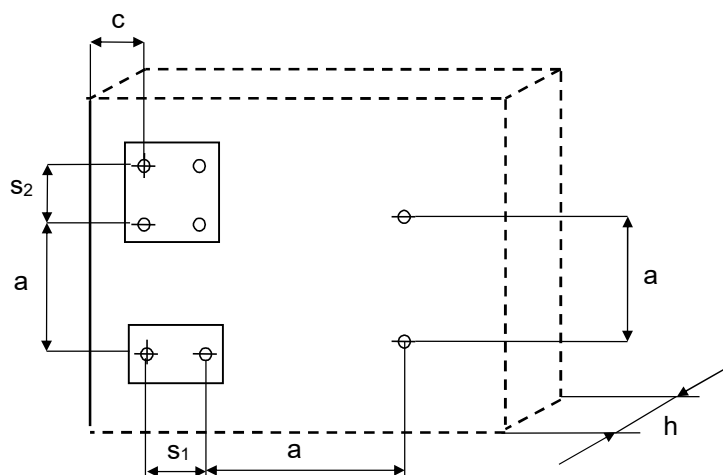


Figure not to scale

fischer HybridPower	Annex B2
Intended use Installation parameters Minimum thickness of member, spacing and edge distances for use in concrete	

Table B3.1: Minimum thickness of member, spacing and edge distances in solid and hollow or perforated masonry – base material group “b” and “c”

Anchor Type		HybridPower, HybridPower A2, HybridPower A4, HybridPower R
Minimum thickness of member ¹⁾	h_{min} [mm]	115
Minimum spacing between anchor groups and / or single anchors	a_{min} [mm]	250
Single anchor		
Minimum edge distance	c_{min} [mm]	100
Anchor group		
Minimum spacing perpendicular to free edge	$s_{1,min}$ [mm]	100
Minimum spacing parallel to free edge	$s_{2,min}$ [mm]	100
Minimum edge distance	c_{min} [mm]	100

¹⁾ Member thickness according to Annex C2 – C6.

Scheme of spacing and edge distances in solid and hollow or perforated masonry – base material group “b” and “c”

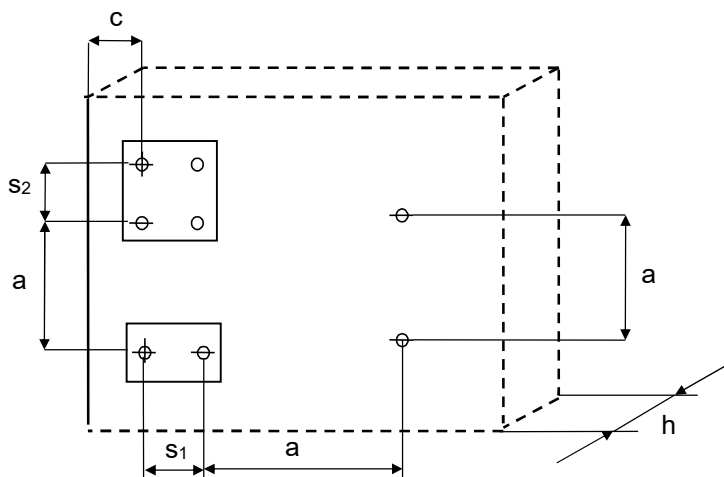


Figure not to scale

fischer HybridPower

Intended use

Minimum thickness of member, spacing and edge distances for use in solid, hollow or perforated masonry

Annex B3

Table B4.1: Minimum thickness of member, spacing and edge distances in unreinforced and reinforced autoclaved aerated concrete – base material group “d”

Anchor type			HybridPower, HybridPower A2, HybridPower A4, HybridPower R	
Compressive strength ¹⁾	$f_{cm,decl}$ f_{ck}	[N/mm ²]	≥ 2	> 3
Minimum thickness of member	h_{min}	[mm]	115	175
Minimum spacing between anchor groups and / or single anchors	a_{min}	[mm]	250	250
Single anchor				
Minimum edge distance	c_{min}	[mm]	100	100
Anchor group				
Minimum spacing perpendicular to free edge	$s_{1,min}$	[mm]	100	100
Minimum spacing parallel to free edge	$s_{2,min}$	[mm]	100	100
Minimum edge distance	c_{min}	[mm]	100	100

¹⁾ See Table C13.1 and C13.2.

Scheme of spacing and edge distances in unreinforced and reinforced autoclaved aerated concrete – base material group “d”

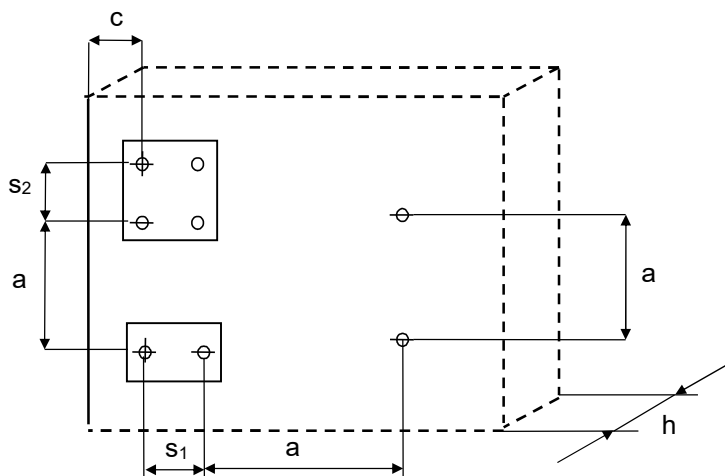


Figure not to scale

fischer HybridPower


Intended use

Minimum thickness of member, spacing and edge distances for use in autoclaved aerated concrete


Annex B4

Installation instructions


The following pictures show fixing through timber in concrete.
Summary of all kind of masonry bricks see Annex C2 – C6.

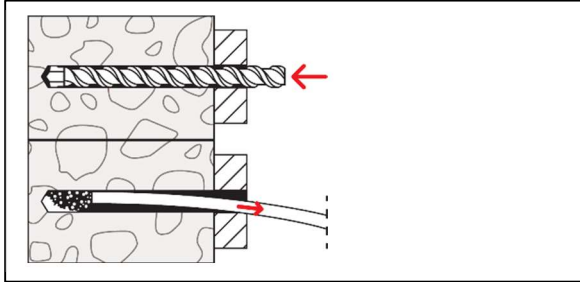


1. Drill the bore hole as per Table B2.1 using the drilling method described in the corresponding Annex C1 and C7 to C13.
2. For use in base material group "a" (concrete), "b" (solid bricks), "d" (autoclaved aerated concrete): Remove dust from borehole. Not necessary for base material group "c".

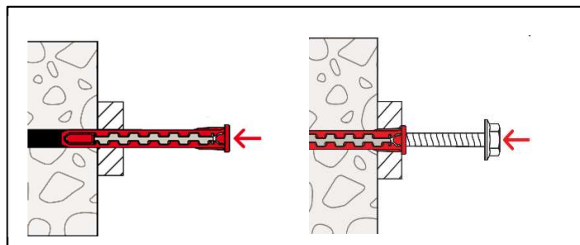

3. Insert anchor (screw and sleeve) by using a hammer until the collar of the plastic sleeve is flush with the surface of the fixture.

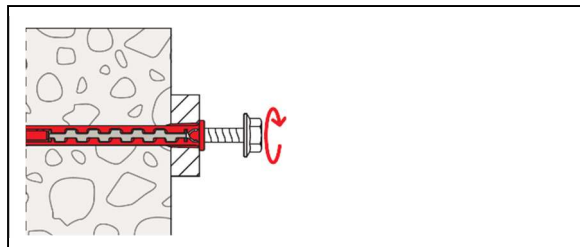

4. The screw is screwed-in until the head of the screw touches the sleeve. The anchor is correctly installed, if the head of the screw fits tight on the surface and nor the anchor sleeve neither the screw cannot be turned-in any further.

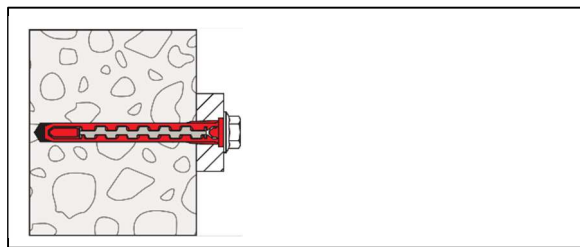

5. Correctly installed anchor, shown in concrete.

Figures not to scale

fischer HybridPower

Intended use
Installation instructions

Annex B5

Table C1.1: Characteristic resistance of the screws

Failure of expansion element (special screw)			HybridPower, HybridPower A2, HybridPower A4, HybridPower R	
			galvanised steel	stainless steel
Characteristic tension resistance	$N_{Rk,s}$	[kN]	21,70	21,70
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,55	1,55
Characteristic shear resistance	$V_{Rk,s}$	[kN]	10,80	10,80
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,29	1,29
Characteristic bending resistance of the screw				
Characteristic bending resistance	$M_{Rk,s}$	[Nm]	20,60	20,60
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,29	1,29

¹⁾ In absence of other national regulations.

Table C1.2: Characteristic resistance due to pullout-failure for use in cracked and uncracked concrete base material group "a"¹⁾

Pull-out failure (plastic sleeve)			HybridPower, HybridPower A2, HybridPower A4, HybridPower R	
Embedment depth h_{nom}	\geq	[mm]	80	
Concrete \geq C16/20				
Characteristic tension resistance (30/50 °C)	$N_{Rk,p}$	[kN]	4,50 / 3,00 ²⁾	
Characteristic tension resistance (50/80 °C)	$N_{Rk,p}$	[kN]	4,00 / 3,00 ²⁾	
Partial safety factor	$\gamma_{Mc}^{3)}$	[-]	1,80	

¹⁾ Drilling method: hammer drilling.

²⁾ Valid for concrete C12/15.

³⁾ In absence of other national regulations.

Table C1.3: Displacements¹⁾ under tension and shear loading in cracked and uncracked concrete, base material group "a" and in masonry, base material group "b" and "c"

Displacements under			Tension load ²⁾		Shear load ²⁾	
Anchor type	h_{nom} [mm]	F [kN]	δ_{NO} [mm]	$\delta_{N\infty}$ [mm]	δ_{vo} [mm]	$\delta_{v\infty}$ [mm]
HybridPower, HybridPower A2, HybridPower A4, HybridPower R	80	2,50	0,90	0,90	4,90	1,35

¹⁾ Valid for all ranges of temperatures.

²⁾ Intermediate values by linear interpolation.

Table C1.4 Displacements¹⁾ under tension and shear loading in unreinforced and reinforced autoclaved aerated concrete, base material group "d"

Displacements under				Tension load ²⁾		Shear load ²⁾	
Anchor type	$f_{cm,decl} / f_{ck}$ [N/mm ²]	h_{nom} [mm]	F [kN]	δ_{NO} [mm]	$\delta_{N\infty}$ [mm]	δ_{vo} [mm]	$\delta_{v\infty}$ [mm]
HybridPower, HybridPower A2, HybridPower A4, HybridPower R	≥ 2	80	0,14	0,20	0,39	0,29	0,43
	≥ 6	80	0,57	0,11	0,21	1,14	1,71

¹⁾ Valid for all ranges of temperatures.

²⁾ Intermediate values by linear interpolation.

fischer HybridPower

Performances

Characteristic resistance and bending resistance of the screw

Characteristic resistance for use in concrete, displacements under tension and shear load

Annex C1

Table C2.1: Summary of concrete - base material group “a”, solid bricks – base material group “b”¹⁾ and autoclaved aerated concrete – base material group “d”					
Base material	Format	Dimensions [mm]	Mean compressive strength as per EN 771 [N/mm ²]	Bulk density ρ [kg/dm ³]	See Annex
Concrete \geq C12/15 as per EN 206					C1
Autoclaved aerated concrete, AAC as per EN 771-4					C13
Reinforced autoclaved aerated concrete, AAC as per EN 12602					C13
Clay brick Mz , as per EN 771-1 <i>e.g. Ziegelwerk Nordhausen, DE</i>	\geq NF	\geq 240x115x71	\geq 7,5	\geq 2,0	C7
Clay brick Mz , as per EN 771-1 <i>e.g. Wienerberger DE</i>	\geq 2 DF	\geq 240x115x113	\geq 10,0	\geq 1,8	C7
Calcium silicate solid brick KS , as per EN 771-2 <i>e.g. KS Wemding, DE</i>	\geq NF	\geq 240x115x71	\geq 7,5	\geq 2,0	C7
Calcium silicate solid brick KS , as per EN 771-2 <i>e.g. Hermann Peter, DE</i>	\geq 2 DF	\geq 240x115x113	\geq 7,5	\geq 2,0	C7
Calcium silicate solid brick KS , as per EN 771-2 <i>e.g. Hermann Peter, DE</i>	\geq 12 DF	\geq 498x175x248	\geq 7,5	\geq 2,0	C8
Lightweight solid brick Vbl , as per EN 771-3 <i>e.g. KLB, DE</i>	\geq 2 DF	\geq 240x115x113	\geq 2,5	\geq 1,2	C8
¹⁾ Vertically perforation \leq 15%; cross section reduced by perforation vertically to the resting area.					
fischer HybridPower				Annex C2	
Performances Summary of concrete, solid bricks and autoclaved aerated concrete					

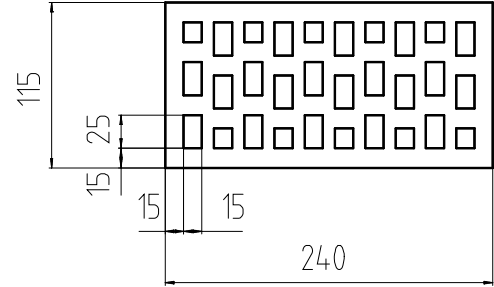
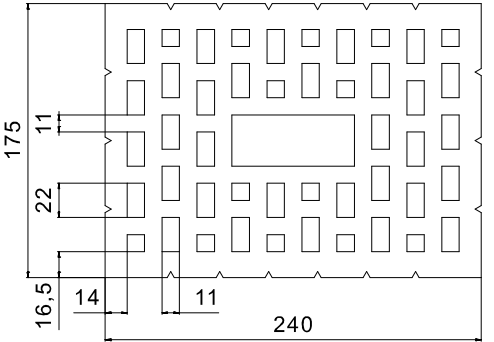
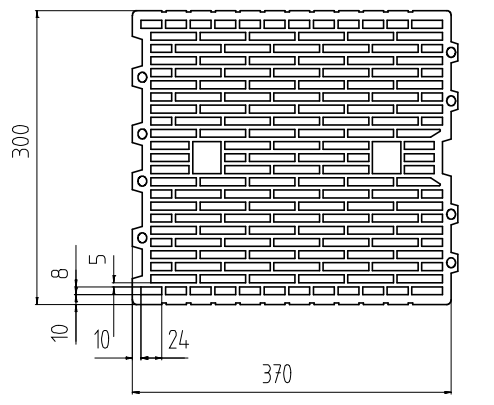
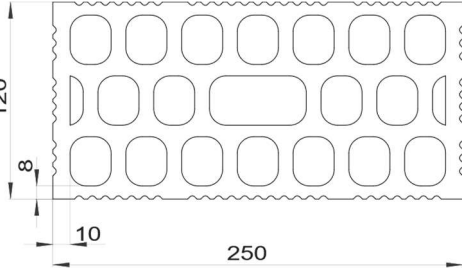
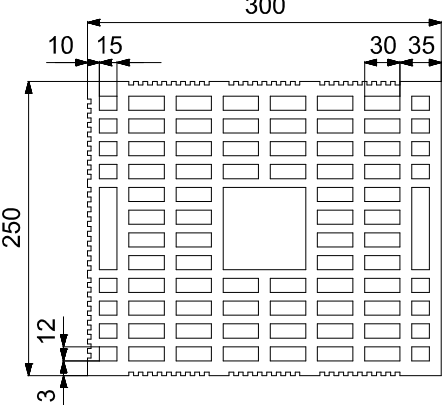
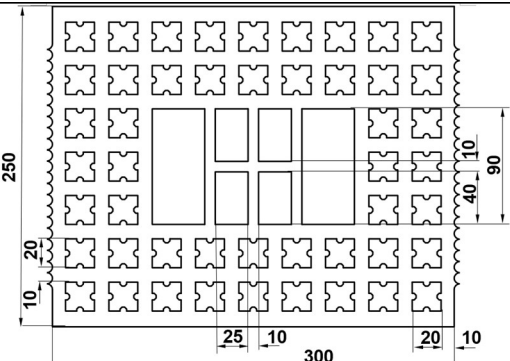
Table C3.1: Summary of hollow or perforated bricks – base material group “c”⁽¹⁾				
Base material	Format/ Dimensions [mm]	Brick drawing [mm]	Mean compressive strength as per EN 771 [N/mm²] / bulk density ρ [kg/dm³]	See Annex
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Wienerberger, DE</i>	2 DF 240x115x113		≥ 7,5 / ≥ 0,9	C8
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Schlagmann, DE</i>	3 DF 240x175x113		≥ 7,5 / ≥ 1,2	C9
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Wienerberger Porotherm 30 R, FR</i>	370x300x250		≥ 5,0 / ≥ 0,8	C9
<p>¹⁾Vertically perforation > 15% and ≤ 50%; cross section reduced by perforation vertically to the resting area.</p> <p style="text-align: right;"><i>Figures not to scale</i></p>				
fischer HybridPower			Annex C3	
Performances Summary of hollow or perforated bricks				

Table C4.1: Summary of hollow or perforated bricks – base material group “c”⁽¹⁾

Base material	Format/ Dimensions [mm]	Brick drawing [mm]	Mean compressive strength as per EN 771 [N/mm ²] / bulk density ρ [kg/dm ³]	See Annex
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Doppio Uni Wienerberger, IT</i>	250x120x190		≥ 7,5 / ≥ 0,8	C9
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Wienerberger Pth Bio Modulare, IT</i>	300x250x190		≥ 7,5 / ≥ 1,0	C10
Perforated clay brick Hz, as per EN 771-1 e.g. <i>Danesi Poroton P700, IT</i>	300x250x190		≥ 5,0 / ≥ 0,9	C10

¹⁾ Vertically perforation > 15% and ≤ 50%; cross section reduced by perforation vertically to the resting area.

Figures not to scale

fischer HybridPower

Performances
Summary of hollow or perforated bricks

Annex C4

Table C5.1: Summary of hollow or perforated bricks – base material group “c”¹⁾

Base material	Format/ Dimensions [mm]	Brick drawing [mm]	Mean compressive strength as per EN 771 [N/mm ²] / bulk density ρ [kg/dm ³]	See Annex
Calcium silicate hollow brick KSL, as per EN 771-1 e.g. Bösel, DE	2 DF 240x115x113		$\geq 7,5 / \geq 1,6$	C11
Calcium silicate hollow brick KSL, as per EN 771-1 e.g. KS Wemding, DE	3 DF 240x175x113		$\geq 7,5 / \geq 1,4$	C11
Hollow brick lightweight concrete Hbl, as per EN 771-3 e.g. Knobel, DE	16 DF 495x240x248		$\geq 2,5 / \geq 0,7$	C12

¹⁾ Vertically perforation > 15% and ≤ 50%; cross section reduced by perforation vertically to the resting area.

Figures not to scale

fischer HybridPower

Performances
Summary of hollow or perforated bricks

Annex C5

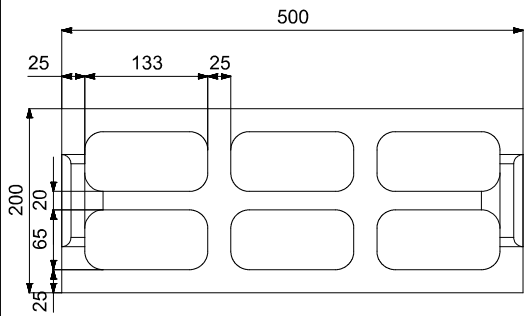
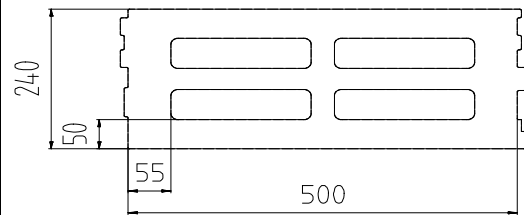
Table C6.1: Summary of hollow or perforated bricks – base material group “c”⁽¹⁾				
Base material	Format/ Dimensions [mm]	Brick drawing [mm]	Mean compressive strength as per EN 771 [N/mm²] / bulk density ρ [kg/dm³]	See Annex
Hollow brick lightweight concrete Hbl, as per EN 771-3 <i>e.g. Indelasa, ES</i>	500x200x200		≥ 2,5 / ≥ 1,0	C12
Hollow brick lightweight concrete Hbl, as per EN 771-3 <i>e.g. Knobel, DE</i>	500x240x240		≥ 2,5 / ≥ 0,9	C12
<p>¹⁾Vertically perforation > 15% and ≤ 50%; cross section reduced by perforation vertically to the resting area.</p> <p style="text-align: right;"><i>Figures not to scale</i></p>				
fischer HybridPower			Annex C6	
Performances Summary of hollow or perforated bricks				

Table C7.1: Characteristic resistance F_{Rk} in [kN] for use in solid masonry – base material group “b”			
Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] \geq 80	
Clay brick Mz; $\rho \geq 2,0$ as per EN 771-1 <i>e.g. Mz Ziegelwerk Nordhausen, DE</i> \geq NF (\geq 240x115x71) Hammer drilling	$\geq 7,5 / 6,0$	1,50	1,50
	$\geq 10,0 / 8,0$	2,00	2,00
	$\geq 12,5 / 10,0$	2,50	2,50
	$\geq 15,0 / 12,0$	3,00	3,00
	$\geq 20,0 / 16,0$	3,50 / 4,00³⁾	3,50 / 4,00³⁾
	$\geq 25,0 / 20,0$	4,00 / 5,00³⁾	4,00 / 4,50³⁾
	$\geq 25,3 / -$	4,00 / 5,00³⁾	4,00 / 5,00³⁾
Clay brick Mz; $\rho \geq 1,8$ as per EN 771-1 <i>e.g. Mz Wienerberger, DE</i> \geq 2DF (\geq 240x115x113) Hammer drilling	$\geq 10,0 / 8,0$	1,50	1,50
	$\geq 12,5 / 10,0$	2,00	1,50
	$\geq 15,0 / 12,0$	2,50	2,00
	$\geq 20,0 / 16,0$	3,00	3,00
	$\geq 25,0 / 20,0$	4,00	3,50
	$\geq 35,0 / 28,0$	4,50 / 5,50³⁾	4,50 / 5,00³⁾
Calcium silicate solid brick KS; $\rho \geq 2,0$ as per EN 771-2 <i>e.g. KS Wemding, DE</i> \geq NF (\geq 240x115x71) Hammer drilling	$\geq 7,5 / 6,0$	0,40	0,40
	$\geq 10,0 / 8,0$	0,60	0,60
	$\geq 12,5 / 10,0$	0,75	0,75
	$\geq 15,0 / 12,0$	0,90	0,90
	$\geq 20,0 / 16,0$	1,20	1,20
	$\geq 25,0 / 20,0$	1,50	1,50
Calcium silicate solid brick KS; $\rho \geq 2,0$ as per EN 771-2 <i>e.g. Hermann Peter, DE</i> \geq 2 DF (\geq 240x115x113) Hammer drilling	$\geq 7,5 / 6,0$	2,00	1,50
	$\geq 10,0 / 8,0$	2,50	2,00
	$\geq 12,5 / 10,0$	2,50 / 3,00³⁾	2,50 / 3,00³⁾
	$\geq 15,0 / 12,0$	3,00 / 3,50³⁾	3,00 / 3,50³⁾
	$\geq 18,8 / -$	3,50 / 4,00³⁾ / 4,50⁴⁾	3,50 / 4,00³⁾
Partial safety factor	γ_{Mm} ²⁾ [-]	2,50	
¹⁾ The compressive strength of the single brick must not be less than 80% of the mean compressive strength. ²⁾ In absence of other national regulations. ³⁾ Only valid for $c \geq 125$ mm. ⁴⁾ Only valid for $c \geq 150$ mm.			
fischer HybridPower			Annex C7
Performances Characteristic resistance for use in solid bricks			

Table C8.1: Characteristic resistance F_{Rk} in [kN] for use in solid and in hollow or perforated masonry – base material group “b” and “c”




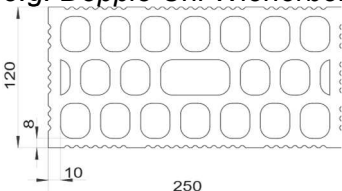
Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] \geq 80 ³⁾	
Calcium silicate solid brick KS; $\rho \geq 2,0$ as per EN 771-2 e.g. <i>KS Wemding, DE</i> ≥ 12 DF ($\geq 498 \times 175 \times 248$) Hammer drilling	$\geq 7,5 / 6,0$	2,50 / 3,00⁴⁾	2,50
	$\geq 10,0 / 8,0$	3,00 / 4,00⁴⁾	3,00 / 3,50⁴⁾
	$\geq 12,5 / 10,0$	3,00 / 5,00⁴⁾	3,00 / 4,50⁴⁾
	$\geq 15,0 / 12,0$	3,50 / 5,50⁴⁾	3,50 / 5,50⁴⁾
	$\geq 20,0 / 16,0$	4,00 / 6,50⁴⁾ / 7,50⁷⁾	4,00 / 6,50⁴⁾ / 7,00⁷⁾
	$\geq 25,0 / 20,0$	4,50 / 7,50⁴⁾ / 9,50⁷⁾	4,50 / 7,50⁴⁾ / 9,00⁷⁾
	$\geq 34,6 / -$	5,00 / 8,50⁴⁾ / 11,00⁷⁾ / 12,50⁸⁾	5,00 / 8,50⁴⁾ / 11,00⁷⁾ / 12,00⁸⁾
Lightweight solid brick Vbl; $\rho \geq 1,2$ as per EN 771-3 e.g. <i>Vbl KLB, DE</i> ≥ 2 DF ($\geq 240 \times 115 \times 113$) Rotary drilling	$\geq 2,5 / 2,0$	1,20 / 1,50⁴⁾	1,20
	$\geq 5,0 / 4,0$	1,50 / 2,50⁴⁾ / 3,00⁵⁾	1,50 / 2,50⁴⁾
	$\geq 6,0 / -$	2,00 / 2,50⁴⁾ / 3,00⁵⁾ / 3,50⁶⁾	2,00 / 2,50⁴⁾ / 3,00⁵⁾
Perforated clay brick Hlz; $\rho \geq 0,9$ as per EN 771-1 e.g. <i>Wienerberger, DE</i>  2 DF (240x115x113) Rotary drilling	$\geq 7,5 / 6,0$	0,30	0,30
	$\geq 10,0 / 8,0$	0,40	0,40
	$\geq 12,5 / 10,0$	0,50	0,50
	$\geq 15,0 / 12,0$	0,60	0,60
	$\geq 16,7 / -$	0,75	0,75
Partial safety factor	γ_{Mm} ²⁾ [-]	2,50	
<p>1) The compressive strength of the single brick must not be less than 80% of the mean compressive strength.</p> <p>2) In absence of other national regulations.</p> <p>3) Exception “Perforated clay brick Hlz; $\rho \geq 0,9$”: only valid $h_{nom} = 80$mm.</p> <p>4) Only valid for $c \geq 150$ mm.</p> <p>5) Only valid for $c \geq 170$ mm.</p> <p>6) Only valid for $c \geq 175$ mm.</p> <p>7) Only valid for $c \geq 200$ mm.</p> <p>8) Only valid for $c \geq 240$ mm.</p>			
fischer HybridPower			Annex C8
Performances Characteristic resistance for use in solid and in hollow or perforated bricks			

Table C9.1: Characteristic resistance F_{Rk} in [kN] for use in hollow or perforated masonry – base material group “c”

Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] = 80	
Perforated clay brick Hz; $\rho \geq 1,2$ as per EN 771-1 e.g. <i>Schlagmann, DE</i>  3 DF (240x175x113) Rotary drilling	$\geq 7,5 / 6,0$	0,50	0,50
	$\geq 10,0 / 8,0$	0,75	0,75
	$\geq 12,5 / 10,0$	0,90	0,90
	$\geq 15,0 / 12,0$	0,90	0,90
	$\geq 19,8 / -$	1,20	1,20
Perforated clay brick Hz; $\rho \geq 0,8$ as per EN 771-1 e.g. <i>Wienerberger Porotherm 30 R, FR</i>  370x300x250 Rotary drilling	$\geq 5,0 / 4,0$	0,40	0,40
	$\geq 7,5 / 6,0$	0,60	0,60
	$\geq 10,0 / 8,0$	0,75	0,75
	$\geq 12,5 / 10,0$	0,90	0,90
	$\geq 15,0 / 12,0$	1,20	1,20
Perforated clay brick Hz; $\rho \geq 0,8$ as per EN 771-1 e.g. <i>Doppio Uni Wienerberger, IT</i>  250x120x190 Rotary drilling	$\geq 7,5 / 6,0$	0,40	0,40
	$\geq 10,0 / 8,0$	0,60	0,50
	$\geq 12,5 / 10,0$	0,75	0,60
	$\geq 15,0 / 12,0$	0,90	0,75
	$\geq 20,0 / 16,0$	1,20	0,90
	$\geq 25,0 / 20,0$	1,50	1,20
	$\geq 26,5 / -$	1,50	1,50

Partial safety factor

 $\gamma_{Mm}^{2)}$ [-]**2,50**

1) The compressive strength of the single brick must not be less than 80% of the mean compressive strength.

2) In absence of other national regulations.

fischer HybridPower**Performances**

Characteristic resistance for use in hollow or perforated bricks

Annex C9

Table C10.1: Characteristic resistance F_{Rk} in [kN] for use in hollow or perforated masonry – base material group “c”


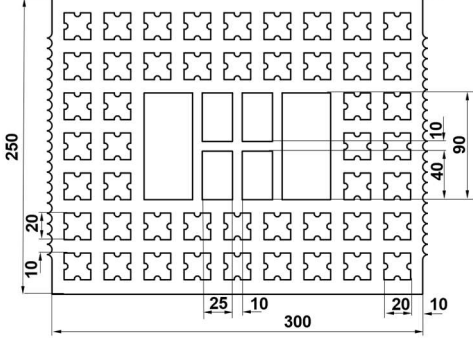
Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] = 80	
Perforated clay brick Hz; $\rho \geq 1,0$ as per EN 771-1 <i>e.g. Wienerberger Pth Bio Modulare, IT</i>  300x250x190 Rotary drilling	$\geq 7,5 / 6,0$	0,30	_)
	$\geq 10,0 / 8,0$	0,50	0,30
	$\geq 12,5 / 10,0$	0,60	0,40
	$\geq 15,0 / 12,0$	0,60	0,50
	$\geq 20,0 / 16,0$	0,90	0,60
	$\geq 25,0 / 20,0$	1,20	0,90
	$\geq 35,0 / 28,0$	1,50	1,20
Perforated clay brick Hz; $\rho \geq 0,9$ as per EN 771-1 <i>e.g. Danesi Poroton P700, IT</i>  300x250x190 Rotary drilling	$\geq 5,0 / 4,0$	0,50	0,50
	$\geq 7,5 / 6,0$	0,75	0,75
	$\geq 10,0 / 8,0$	0,90	0,90
	$\geq 12,5 / 10,0$	1,20	1,20
	$\geq 15,0 / 12,0$	1,50	1,50
Partial safety factor	$\gamma_{Mm}^{2)}$ [-]	2,50	
¹⁾ The compressive strength of the single brick must not be less than 80% of the mean compressive strength. ²⁾ In absence of other national regulations. ³⁾ No performance assessed.			
fischer HybridPower			Annex C10
Performances Characteristic resistance for use in hollow or perforated bricks			

Table C11.1: Characteristic resistance F_{Rk} in [kN] for use in hollow or perforated masonry – base material group “c”

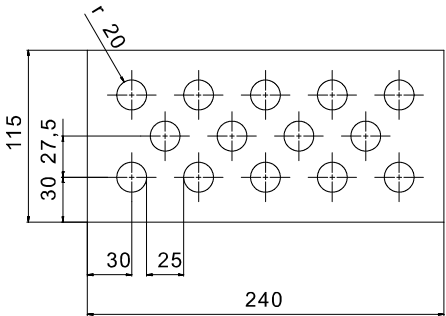
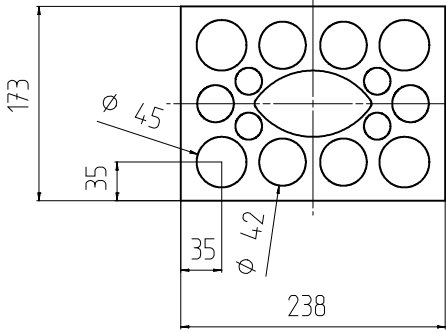
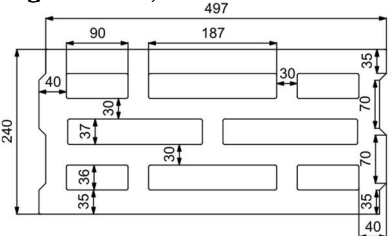
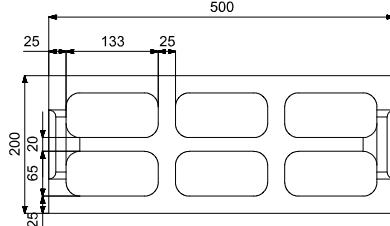
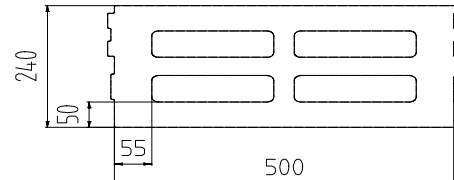
Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] = 80	
Calcium silicate hollow brick KSL; $\rho \geq 1,6$ as per EN 771-1 e.g. Bösel, DE 	$\geq 7,5 / 6,0$	0,90	0,90
	$\geq 10,0 / 8,0$	1,20	1,20
	$\geq 12,5 / 10,0$	1,50	1,50
	$\geq 15,0 / 12,0$	2,00	2,00
	$\geq 20,0 / 16,0$	2,50	2,50
	$\geq 25,0 / 20,0$	3,00	3,00
2 DF (240x115x113) Hammer drilling			
Calcium silicate hollow brick KSL; $\rho \geq 1,4$ as per EN 771-1 e.g. KS Wending, DE 	$\geq 7,5 / 6,0$	0,40	0,40
	$\geq 10,0 / 8,0$	0,60	0,50
	$\geq 12,5 / 10,0$	0,75	0,60
	$\geq 15,0 / 12,0$	0,90	0,75
	$\geq 20,0 / 16,0$	1,20	0,90
	$\geq 20,2 / -$	1,20	1,20
3 DF (240x175x113) Hammer drilling			
Partial safety factor	$\gamma_{Mm}^{2)}$ [-]	2,50	
¹⁾ The compressive strength of the single brick must not be less than 80% of the mean compressive strength. ²⁾ In absence of other national regulations.			
fischer HybridPower			Annex C11
Performances Characteristic resistance for use in hollow or perforated bricks			

Table C12.1: Characteristic resistance F_{Rk} in [kN] for use in hollow or perforated masonry – base material group “c”

Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771 / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN]	
		Temperature range 30/50 °C	Temperature range 50/80 °C
		h_{nom} [mm] = 80	
Hollow brick lightweight concrete Hbl; $\rho \geq 0,7$ as per EN 771-3 e.g. <i>Knobel, DE</i>  16 DF (495x240x248) Rotary drilling	$\geq 2,5 / 2,0$	1,20	0,90
	$\geq 5,0 / 4,0$	2,00	2,00
	$\geq 5,4 / 2,0$	2,50	2,00
Hollow brick lightweight concrete Hbl; $\rho \geq 1,0$ as per EN 771-3 e.g. <i>Indelasa, ES</i>  500x200x200 Rotary drilling	$\geq 2,5 / 2,0$	0,30	0,30
	$\geq 5,0 / 4,0$	0,60	0,60
Hollow brick lightweight concrete Hbl; $\rho \geq 0,9$ as per EN 771-3 e.g. <i>Knobel, DE</i>  500x240x240 Rotary drilling	$\geq 2,5 / 2,0$	0,90	0,90
	$\geq 5,0 / 4,0$	2,00	1,50
Partial safety factor	γ_{Mm} ²⁾ [-]	2,50	

¹⁾ The compressive strength of the single brick must not be less than 80% of the mean compressive strength.

²⁾ In absence of other national regulations.

fischer HybridPower

Performances

Characteristic resistance for use in hollow or perforated bricks

Annex C12

Table C13.1: Characteristic resistance F_{Rk} in [kN] for use in unreinforced autoclaved aerated concrete – base material group “d”

Base material [Supplier Title, country] Geometry, DF or nom. Size (L x W x H) [mm] and drilling method	Mean compressive strength as per EN 771-4 $f_{cm,decl}$ / Minimum compressive strength single brick ¹⁾ [N/mm ²]	Characteristic resistance F_{Rk} [kN] Temperature range 30/50 °C and 50/80 °C
		h_{nom} [mm] \geq 80
Unreinforced autoclaved aerated concrete, AAC as per EN 771-4 e.g. (500x120x300) ²⁾ e.g. (500x250x300) ²⁾ Hammer drilling	$\geq 2,90 / 2,32$	0,50
	$\geq 3,75 / 3,00$	0,90
	$\geq 4,00 / 3,20$	0,90
	$\geq 5,00 / 4,0$	1,20
	$\geq 6,00 / 4,80$	1,50
	$\geq 7,50 / 6,00$	2,00
Partial safety factor	γ_{MAAC} ³⁾ [-]	2,00

¹⁾ The compressive strength of the single brick must not be less than 80% of the mean compressive strength.

²⁾ For $f_{cm,decl} > 3$ N/mm²: $h_{min} = 175$ mm.

³⁾ In absence of other national regulations.

Table C13.2: Characteristic resistance F_{Rk} in [kN] for use in reinforced autoclaved aerated concrete – base material group “d”

Base material [Supplier Title, country] minimum member thickness h_{min} and drilling method	Compressive strength f_{ck} (compressive strength class) as per EN 12602 [N/mm ²]	Characteristic resistance F_{Rk} [kN] Temperature range 30/50 °C and 50/80 °C
		h_{nom} [mm] \geq 80
Reinforced autoclaved aerated concrete, AAC as per EN 12602 $h_{min} = 115$ mm ¹⁾ Hammer drilling	$\geq 2,0$ (AAC2)	0,40
	$\geq 2,5$ (AAC2,5)	0,60
	$\geq 3,0$ (AAC3)	0,75
	$\geq 3,5$ (AAC3,5)	0,90
	$\geq 4,0$ (AAC4)	1,20
	$\geq 4,5$ (AAC4,5)	1,50
	$\geq 5,0$ (AAC5)	1,50
	$\geq 6,0$ (AAC6)	2,00
Partial safety factor	γ_{MAAC} ²⁾ [-]	2,00

¹⁾ For $>$ AAC3: $h_{min} = 175$ mm.

²⁾ In absence of other national regulations.

fischer HybridPower

Performances

Characteristic resistance for use in unreinforced autoclaved aerated concrete and in reinforced autoclaved aerated concrete

Annex C13

Figure C14.1: Characteristic fire resistance under inclined loading, load direction α , in concrete – base material group “a” and solid brick masonry – base material group “b”

The characteristic fire resistance for each fire resistance class shall be interpolated for load direction α between 45° and 90° according to following equation:

Equation C14.1:

$$F_{Rk,fi}(\alpha) = \frac{0,71 \cdot F_{Rk,fi(45^\circ)}}{\cos \alpha} \leq F_{Rk,fi(90^\circ)}$$

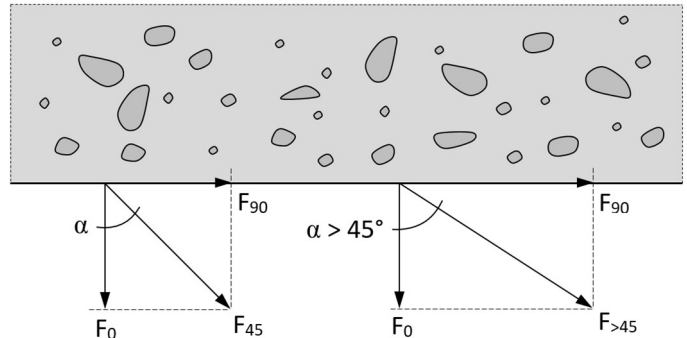


Figure not to scale

Table C14.1: Characteristic fire resistance in concrete – base material group “a”

Anchor type		HybridPower, HybridPower A2, HybridPower A4, HybridPower R			
		R30	R60	R90	R120
Embedment depth	$h_{nom} \geq$ [mm]	80			
Characteristic fire resistance under inclined loading for selected load directions α					
Characteristic resistance under 45°	$F_{Rk,fi(45^\circ)}$ [kN]	1,58	1,10	0,62	0,37
Characteristic resistance under 60°	$F_{Rk,fi(60^\circ)}$ [kN]	1,99	1,54	0,88	0,53
Characteristic resistance under 75°	$F_{Rk,fi(75^\circ)}$ [kN]	1,99	1,54	1,02	0,76
Partial factor	$\gamma_{Mm,fi}^{1)}$ [-]	1,00			
Characteristic fire resistance for shear load without lever arm					
Characteristic shear resistance	$F_{Rk,fi(90^\circ)}$ [kN]	1,99	1,54	1,02	0,76
Partial factor	$\gamma_{Mm,fi}^{1)}$ [-]	1,00			
Characteristic fire resistance for shear load with lever arm					
Characteristic bending resistance	$M_{Rk,s,fi}$ [Nm]	0,47	0,37	0,26	0,21
Partial factor	$\gamma_{Mm,fi}^{1)}$ [-]	1,00			
Minimum edge distances under fire exposure	$c_{min,fi}$ [mm]	$2 \times h_{nom}$			
Minimum spacing under fire exposure	$s_{min,fi}$ [mm]	$4 \times h_{nom}$			

¹⁾ In absence of other national regulations.

**Table C14.2: Values under fire exposure in concrete C20/25 to C50/60 in load direction α (no permanent centric tension load, only for shear load without lever arm)
Fastening of façade systems**

Anchor type	Fire resistance class	Load direction α	$F_{Rk,fi,90}$	$\gamma_{M,fi}^{1)}$
HybridPower, HybridPower A2, HybridPower A4, HybridPower R	R90	$\geq 57^\circ$	0,8 kN	1,00

¹⁾ In absence of other national regulations.

fischer HybridPower

Performances
Characteristic fire resistance for use in concrete

Annex C14

Table C15.1: Characteristic fire resistance in solid brick masonry – base material group “b”								
Anchor type			HybridPower, HybridPower A2, HybridPower A4, HybridPower R					
Base material; bulk density [kg/dm³] / mean compressive strength as per EN 771 [N/mm²] [Supplier Title, country] Geometry, DF or nominal size (L x W x H) [mm] drilling method			R30	R60	R90	R120		
Embedment depth	h_{nom}	≥	[mm]					
80								
Characteristic fire resistance under inclined loading for selected load directions α								
Calcium silicate solid brick KS; ρ ≥ 2,0 / 25 as per EN 771-2 e.g. <i>KS Wemding, DE;</i> NF (≥ 240x115x71) Hammer drilling	Characteristic resistance under 45°		F_{RK,fi(45°)} [kN]	0,62	0,62	0,62	0,37	
	Characteristic resistance under 60°		F_{RK,fi(60°)} [kN]	0,88	0,88	0,88	0,53	
	Characteristic resistance under 75°		F_{RK,fi(75°)} [kN]	1,54	1,54	1,02	0,76	
	Characteristic shear load fire resistance without lever arm		F_{RK,fi(90°)} [kN]	1,54	1,54	1,02	0,76	
Partial factor			γ_{Mm,fi}¹⁾ [-]	1,00				
Characteristic fire resistance under inclined loading for selected load directions α								
Calcium silicate solid brick KS; ρ ≥ 2,0 / 15 as per EN 771-2 e.g. <i>KS Wemding, DE;</i> 2 DF (≥ 240x115x113) Hammer drilling	Lightweight solid brick Vbl; ρ ≥ 1,2 / 5 as per EN 771-3 e.g. <i>Vbl KLB, DE;</i> 2 DF (≥ 240x115x113) Rotary drilling	Characteristic resistance under 45°		F_{RK,fi(45°)} [kN]	1,10	1,10	0,62	0,37
		Characteristic resistance under 60°		F_{RK,fi(60°)} [kN]	1,02	1,02	0,88	0,53
		Characteristic resistance under 75°		F_{RK,fi(75°)} [kN]	1,02	1,02	1,02	0,76
		Characteristic shear load fire resistance without lever arm		F_{RK,fi(90°)} [kN]	1,02	1,02	1,02	0,76
Partial factor			γ_{Mm,fi}¹⁾ [-]	1,00				
Characteristic fire resistance for shear load with lever arm, valid for all above mentioned base materials								
Characteristic bending resistance			M_{RK,s,fi} [Nm]	0,47	0,37	0,26	0,21	
Partial factor			γ_{Mm,fi}¹⁾ [-]	1,00				
Minimum edge distances under fire exposure			c_{min,fi} [mm]	2 x h_{nom}				
Minimum spacing under fire exposure			s_{min,fi} [mm]	4 x h_{nom}				
¹⁾ In absence of other national regulations.								
fischer HybridPower					Annex C15			
Performances Characteristic fire resistance for use in solid brick masonry								