

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-18/0205
of 4 September 2018

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer Injection system FIS VE

Product family
to which the construction product belongs

Bonded fastener for use in concrete

Manufacturer

fischerwerke GmbH & Co. KG
Klaus-Fischer-Straße 1
72178 Waldachtal
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment
contains

22 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330499-00-0601

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The Fischer injection system FIS VE is a bonded anchor consisting of a cartridge with injection mortar Fischer FIS VE and a steel element according to Annex A 4.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex C 1 to C 4
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1 to C 3
Displacements (static and quasi-static loading)	See Annex C 5
Characteristic resistance and displacements for seismic performance categories C1 and C2	No performance assessed

3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 4 September 2018 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow
Head of Department

beglaubigt:
Baderschneider


Installation conditions part 1

fischer anchor rod


Pre positioned installation

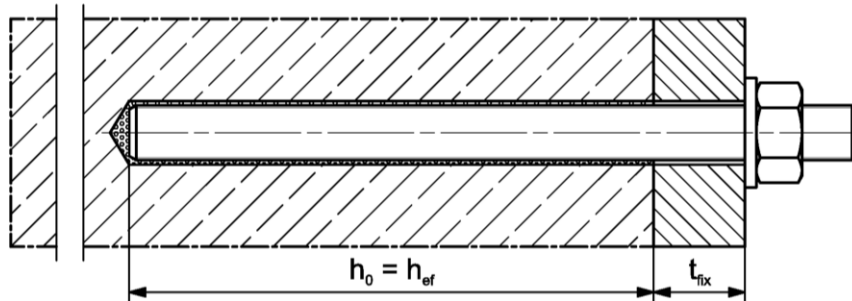

Push through installation (annular gap filled with mortar)

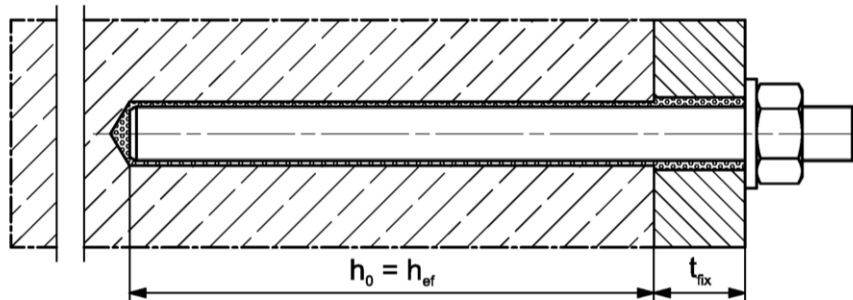

Pre-positioned or push through installation with subsequently pressed filling disk (annular gap filled with mortar)

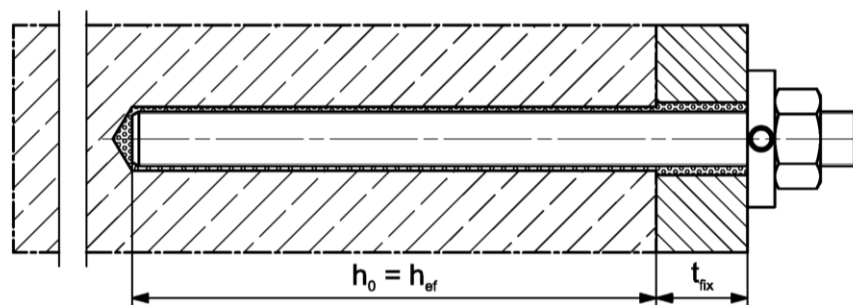

Figures not to scale

h_0 = drill hole depth

h_{ef} = effective embedment depth

t_{fix} = thickness of fixture

fischer injection system FIS VE


Product description
Installation conditions part 1

Annex A 1


Installation conditions part 2

fischer internal threaded anchor RG MI

Pre positioned installation

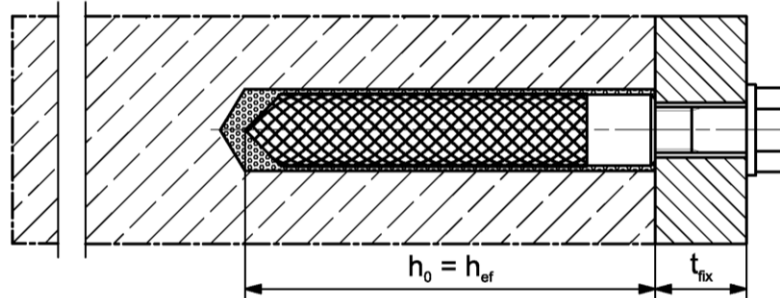

Pre-positioned installation with subsequently pressed filling disk (annular gap filled with mortar)

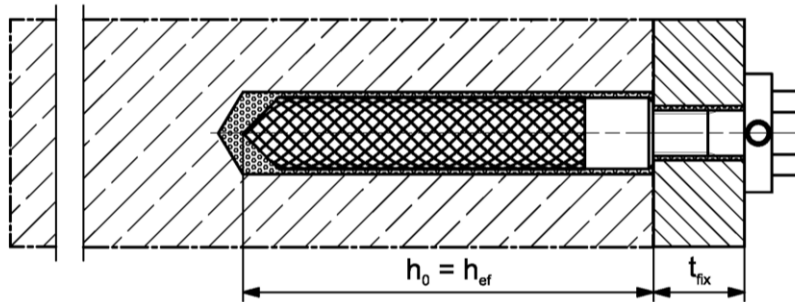

Figures not to scale

h_0 = drill hole depth

h_{ef} = effective embedment depth

t_{fix} = thickness of fixture

fischer injection system FIS VE


Product description

Installation conditions part 2


Annex A 2

Overview system components part 1


Injection cartridge (shuttle cartridge) with sealing cap; Size: 345 ml, 360 ml, 390 ml, 550 ml, 950 ml, 1500 ml

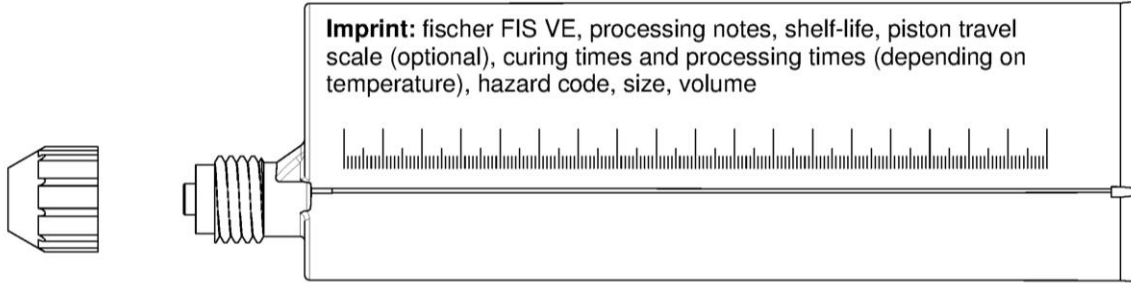

Injection cartridge (coaxial cartridge) with sealing cap; Size: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml

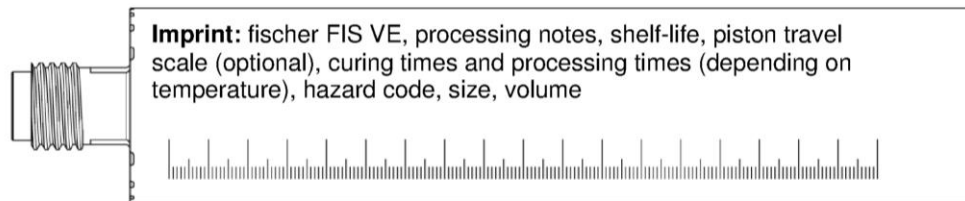

Static mixer FIS MR Plus or UMR

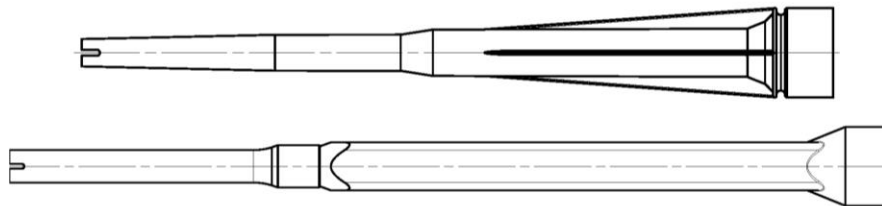

Injection adapter and Extension tube for static mixer



Cleaning brush BS / BSB



Blow-out pump ABG or ABP



Figures not to scale

fischer injection system FIS VE

System description


Overview system components part 1;
cartridges / static mixer / accessories

Annex A 3

Overview system components part 2

fischer anchor rod

Size: M8, M10, M12, M16




fischer internal threaded anchor RG MI


Size: M8, M10, M12



Screw / threaded rod / washer / hexagon nut

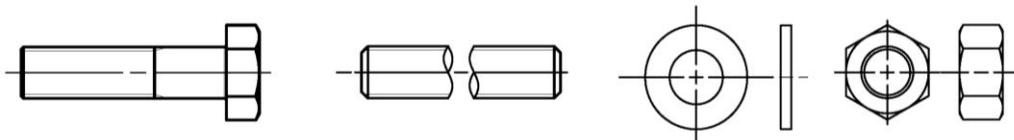

fischer filling disk FFD with injection adapter

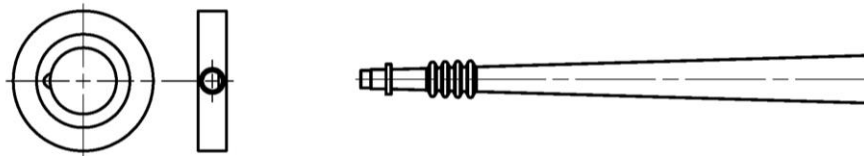

Figures not to scale





fischer injection system FIS VE

System description

Overview system components part 2;
steel components

Annex A 4

Table A5.1: Materials				
Part	Designation	Material		
1	Injection cartridge	Mortar, hardener, filler		
	Steel grade	Steel, zinc plated	Stainless steel A4	High corrosion resistant steel C
2	Anchor rod	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated $\geq 5 \mu\text{m}$, EN ISO 4042:1999 A2K or hot-dip galvanized $\geq 40 \mu\text{m}$ EN ISO 10684:2004 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062, 1.4662, 1.4462; EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation	Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with $f_{yk} = 560 \text{ N/mm}^2$ 1.4565; 1.4529; EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation
3	Washer ISO 7089:2000	zinc plated $\geq 5 \mu\text{m}$, EN ISO 4042:1999 A2K or hot-dip galvanized $\geq 40 \mu\text{m}$ EN ISO 10684:2004	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565; 1.4529; EN 10088-1:2014
4	Hexagon nut	Property class 5 or 8; EN ISO 898-2:2012 zinc plated $\geq 5 \mu\text{m}$, ISO 4042:1999 A2K or hot-dip galvanized $\geq 40 \mu\text{m}$ EN ISO 10684:2004	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
5	fischer internal threaded anchor RG MI	Property class 5.8 ISO 898-1:2013 zinc plated $\geq 5 \mu\text{m}$, ISO 4042:1999 A2K	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014
6	Commercial standard screw or anchor / threaded rod for fischer internal threaded anchor RG MI	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated $\geq 5 \mu\text{m}$, ISO 4042:1999 A2K $A_5 > 8 \%$ fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 $A_5 > 8 \%$ fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014 $A_5 > 8 \%$ fracture elongation
7	fischer filling disk FFD similar to DIN 6319-G	zinc plated $\geq 5 \mu\text{m}$, EN ISO 4042:1999 A2K or hot-dip galvanized $\geq 40 \mu\text{m}$ EN ISO 10684:2004	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565; 1.4529; EN 10088-1:2014
fischer injection system FIS VE				Annex A 5
Product description Materials				

Specifications of intended use (part 1)					
Table B1.1: Overview use and performance categories					
Anchorages subject to		FIS VE with ...			
		Anchor rod 	fischer internal threaded anchor RG MI 		
Hammer drilling with standard drill bit 		all sizes			
Hammer drilling with hollow drill bit (fischer FHD; Heller "Duster Expert"; Bosch „Speed Clean“; Hilti "TE-CD, TE-YD") 		Nominal drill bit diameter (d_0) 12 mm to 20 mm			
Static and quasi static load, in	uncracked concrete	all sizes	Tables: C1.1 C3.1 C4.1 C5.1	all sizes	Tables: C2.1 C3.1 C4.2 C5.2
Use category	I1	dry or wet concrete	all sizes		
Installation direction	D3 (downward and horizontal and upwards (e.g. overhead) installation)				
Installation temperature	$T_{i,min} = 0\text{ °C}$ to $T_{i,max} = +40\text{ °C}$				
In-service temperature	Temperature range I	-40 °C to +80 °C	(max. short term temperature +80 °C ; max. long term temperature +50 °C)		
	Temperature range II	-40 °C to +120 °C	(max. short term temperature +120 °C ; max. long term temperature +72 °C)		
fischer injection system FIS VE		Annex B 1			
Intended use Specifications (part 1)					

Specifications of intended use (part 2)

Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres of strength classes C20/25 to C50/60 according to EN 206:2013

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure, to permanently damp internal conditions or in other particular aggressive conditions (high corrosion resistant steel)

Note: Particular aggressive conditions are e. g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e. g. in desulphurization plants or road tunnels where de-icing materials are used)

Design:

- Anchorages have to be designed by a responsible engineer with experience of concrete anchor design.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.)
- Anchorages are designed in accordance with FprEN 1992-4:2017 and EOTA Technical Report TR 055

Installation:

- Anchor installation is to be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- In case of aborted hole: The hole shall be filled with mortar
- Anchorage depth should be marked and adhered to on installation
- Overhead installation is allowed

fischer injection system FIS VE


Intended use
Specifications (part 2)

Annex B 2

Table B3.1: Installation parameters plus minimum spacing and minimum edge distance for anchor rods

Anchor rods		Thread	M8	M10	M12	M16	
Width across flats	SW	[mm]	13	17	19	24	
Nominal drill hole diameter	d_0		10	12	14	18	
Drill hole depth	h_0		$h_0 = h_{ef}$				
Effective embedment depth	$h_{ef, min}$		60	60	70	80	
	$h_{ef, max}$		160	200	240	320	
Minimum spacing and minimum edge distance	s_{min} = c_{min}		40	45	55	65	
	Diameter of the clearance hole of the fixture						
	pre positioned installation		d_f	9	12	14	18
	push through installation		d_f	11	14	16	20
Minimum thickness of concrete member	h_{min}			$h_{ef} + 30 (\geq 100)$			$h_{ef} + 2d_0$
Maximum torque moment for attachment of the fixture	$\max T_{fix}$	[Nm]	10	20	40	60	


fischer anchor rod

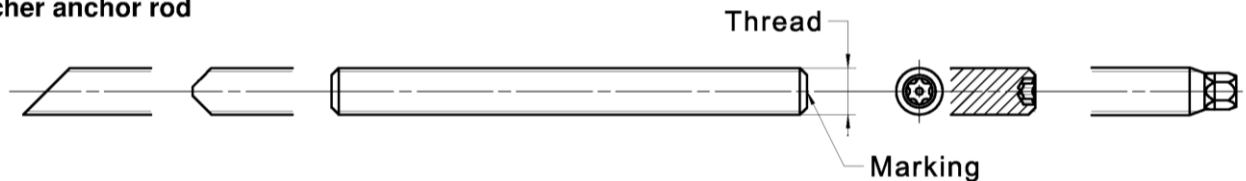

Marking (on random place) fischer anchor rod:

- Property class 8.8, stainless steel, property class 80 and high corrosion resistant steel, property class 80: •
- Stainless steel A4, property class 50 and high corrosion resistant steel, property class 50: ••
- Alternatively: Colour coding according to DIN 976-1

Installation conditions:

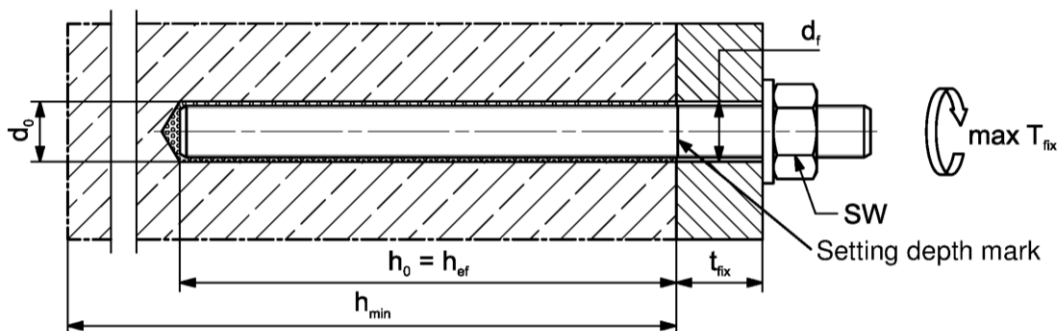

Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled

- Materials, dimensions and mechanical properties according to Annex A 5, Table A5.1
- Inspection certificate 3.1 according to EN 10204:2004, the documents have to be stored
- Setting depth is marked

Figures not to scale

fischer injection system FIS VE



Intended use
Installation parameters anchor rods

Annex B 3

Table B4.1: Installation parameters plus minimum spacing and minimum edge distance for fischer internal threaded anchors RG MI

Internal threaded anchors RG MI		Thread	M8	M10	M12
Diameter of anchor	$d_{nom} = d_H$	[mm]	12	16	18
Nominal drill hole diameter	d_0		14	18	20
Drill hole depth	h_0		$h_0 = h_{ef} = L_H$		
Effective embedment depth ($h_{ef} = L_H$)	h_{ef}		90	90	125
Minimum spacing and minimum edge distance	$s_{min} = c_{min}$		55	65	75
Diameter of clearance hole in the fixture	d_f		9	12	14
Minimum thickness of concrete member	h_{min}		120	125	165
Maximum screw-in depth	$l_{E,max}$		18	23	26
Minimum screw-in depth	$l_{E,min}$		8	10	12
Maximum torque moment for attachment of the fixture	$\max T_{fix}$		[Nm]	10	20


fischer internal threaded anchor RG MI

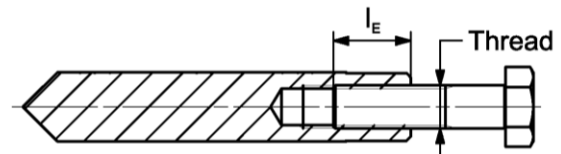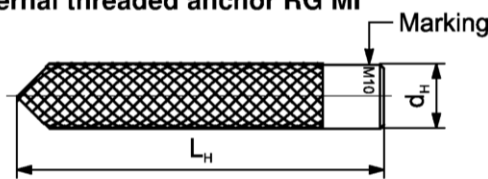

Marking: Anchor size e. g.: **M10**
Stainless steel → additional **A4**; e.g.: **M10 A4**
High corrosion resistant steel → additional **C**; e.g.: **M10 C**

Retaining bolt or threaded rods (including nut and washer) must comply with the appropriate material and strength class of Annex A 5, Table A5.1

Installation conditions:

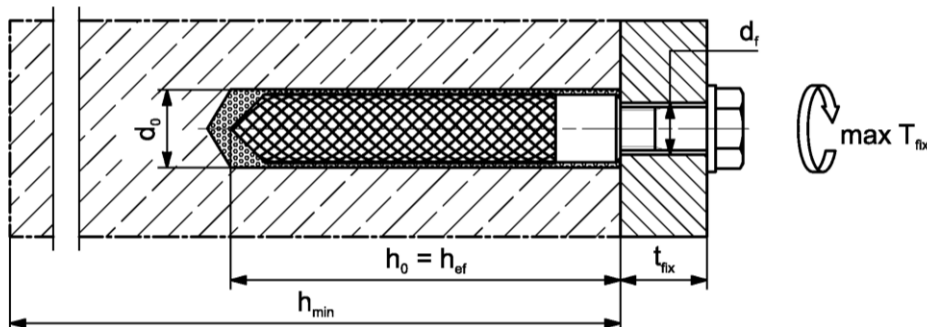

Figures not to scale

fischer injection system FIS VE

Intended use
Installation parameters fischer internal threaded anchor RG MI

Annex B 4

Table B5.1: Parameters of the cleaning brush BS (steel brush)

The size of the cleaning brush refers to the drill hole diameter

Nominal drill hole diameter	d_0	[mm]	10	12	14	16	18
Steel brush diameter	d_b		11	14	16	20	

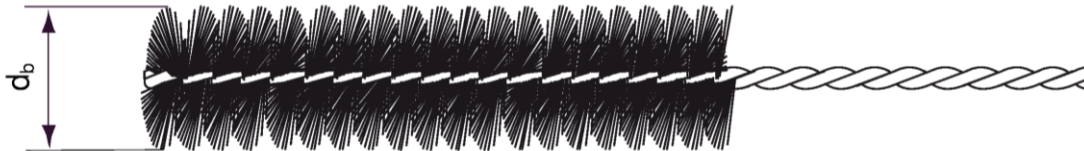


Table B5.2 Maximum processing time of the mortar and minimum curing time
(During the curing time of the mortar the concrete temperature may not fall below the listed minimum temperature)

Temperature at anchoring base [°C]	Maximum processing time t_{work}	Minimum curing time t_{cure}
>±0 to +5	13 min	3 h
>+5 to +10	9 min	90 min
>+10 to +20	5 min	60 min
>+20 to +30	4 min	45 min
>+30 to +40	2 min	35 min

¹⁾ In wet concrete or water filled holes the curing times must be doubled






fischer injection system FIS VE

Intended use
Cleaning brush (steel brush)
Processing time and curing time

Annex B 5


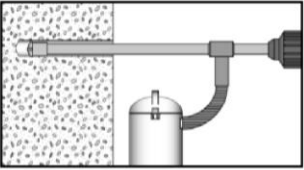
Installation instructions part 1

Drilling and cleaning the hole (hammer drilling with standard drill bit)

1		Drill the hole. Nominal drill hole diameter d_0 and drill hole depth h_0 see tables B3.1, B4.1
2		Clean the drill hole: For $h_{ef} \leq 12d$ and $d_0 < 18$ mm blow out the hole four times by hand
3		Brush the drill hole four times. For deep holes use an extension. Corresponding brushes see table B5.1
4		Clean the drill hole: For $h_{ef} \leq 12d$ and $d_0 < 18$ mm blow out the hole four times by hand
		For $h_{ef} > 12d$ and / or $d_0 \geq 18$ mm blow out the hole four times with oil-free compressed air ($p \geq 6$ bar)

Go to step 6

Drilling and cleaning the hole (hammer drilling with hollow drill bit)

1		Check a suitable hollow drill (see table B1.1) for correct operation of the dust extraction
2		Use a suitable dust extraction system, e. g. Bosch GAS 35 M AFC or a comparable dust extraction system with equivalent performance data Drill the hole with hollow drill bit. The dust extraction system has to extract the drill dust nonstop during the drilling process and must be adjusted to maximum power. Nominal drill hole diameter d_0 and drill hole depth h_0 see tables B3.1, B4.1

Go to step 5






fischer injection system FIS VE

Intended use
Installation instructions part 1




Annex B 6

Installation instructions part 2

Preparing the cartridge

5		<p>Remove the sealing cap Screw on the static mixer (the spiral in the static mixer must be clearly visible)</p>
6		 <p>Place the cartridge into the dispenser</p>
7		 <p>Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey</p>

Injection of the mortar

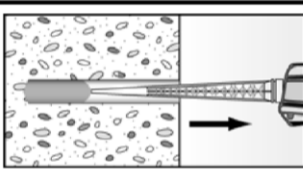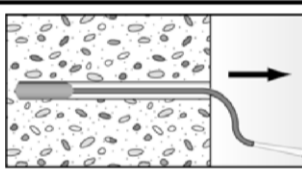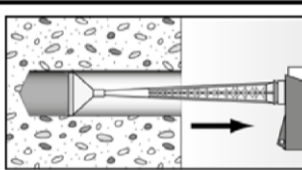8	 <p>Fill approximately 2/3 of the drill hole with mortar. Always begin from the bottom of the hole and avoid bubbles</p>	 <p>For drill hole depth ≥ 150 mm use an extension tube</p>	 <p>For overhead installation, deep holes ($h_0 > 250$ mm) use an injection-adapter</p>
---	--	---	---





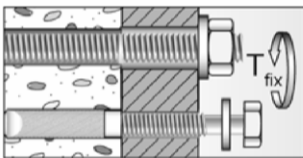
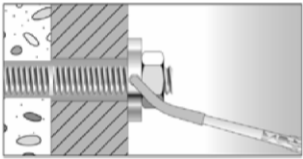
fischer injection system FIS VE

Intended use
Installation instructions part 2

Annex B 7

Installation instructions part 3

Installation of anchor rods or fischer internal threaded anchors RG MI

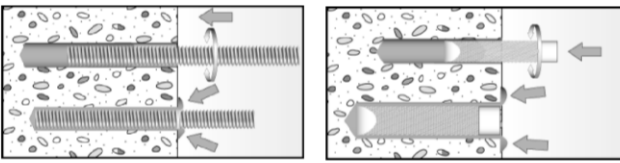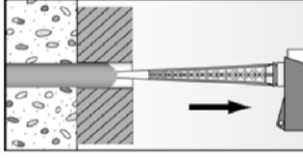9		<p>Only use clean and oil-free anchor elements. Mark the setting depth of the anchor. Push the anchor rod or fischer internal threaded RG MI anchor down to the bottom of the hole, turning it slightly while doing so. After inserting the anchor element, excess mortar must be emerged around the anchor element.</p>
	 <p>For overhead installations support the anchor rod with wedges. (e. g. fischer centering wedges)</p>	 <p>For push through installation fill the annular gap with mortar</p>
10	 <p>Wait for the specified curing time t_{cure} see table B5.2</p>	<p>11</p>  <p>Mounting the fixture max T_{fix} see tables B3.1 and B4.1</p>
Option		<p>After the minimum curing time is reached, the gap between anchor and fixture (annular clearance) may be filled with mortar via the fischer filling disc FFD. Compressive strength $\geq 50 \text{ N/mm}^2$ (e.g. fischer injection mortars FIS HB, FIS SB, FIS V, FIS VE, FIS EM Plus) ATTENTION: Using fischer filling disk FFD reduces t_{fix} (usable length of the anchor)</p>

fischer injection system FIS VE

Intended use
Installation instructions part 3

Annex B 8

Table C1.1: Essential characteristic for the **steel bearing capacity** under tensile / shear load of **fischer anchor rods** and **standard threaded rods**

Anchor rod / standard threaded rod		M8	M10	M12	M16	
Bearing capacity under tensile load, steel failure³⁾						
Characteristic resistance $N_{Rk,s}$	Steel zinc plated	5.8	19 (17)	29 (27)	43	79
		8.8	29 (27)	47 (43)	68	126
	Stainless steel A4 and high corrosion resistant steel C	50 [kN]	19	29	43	79
		70	26	41	59	110
		80	30	47	68	126
Partial factors¹⁾						
Partial factor $\gamma_{Ms,N}$	Steel zinc plated	5.8	1,50			
		8.8	1,50			
	Stainless steel A4 and high corrosion resistant steel C	50 [-]	2,86			
		70	1,50 ²⁾ / 1,87			
		80	1,60			
Bearing capacity under shear load, steel failure						
without lever arm³⁾						
Characteristic resistance $V_{Rk,s}^0$	Steel zinc plated	5.8	9 (8)	15 (13)	21	39
		8.8	15 (13)	23 (21)	34	63
	Stainless steel A4 and high corrosion resistant steel C	50 [kN]	9	15	21	39
		70	13	20	30	55
		80	15	23	34	63
Ductility factor	k_7 [-]	1,0				
with lever arm³⁾						
Charact. resistance $M_{Rk,s}^0$	Steel zinc plated	5.8	19 (16)	37 (33)	65	166
		8.8	30 (26)	60 (53)	105	266
	Stainless steel A4 and high corrosion resistant steel C	50 [Nm]	19	37	65	166
		70	26	52	92	232
		80	30	60	105	266
Partial factors¹⁾						
Partial factor $\gamma_{Ms,V}$	Steel zinc plated	5.8	1,25			
		8.8	1,25			
	Stainless steel A4 and high corrosion resistant steel C	50 [-]	2,38			
		70	1,25 ²⁾ / 1,56			
		80	1,33			
¹⁾ In absence of other national regulations ²⁾ Only admissible for steel C, with $f_{yk} / f_{uk} \geq 0,8$ and $A_5 > 12\%$ (e.g. fischer anchor rods) ³⁾ Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hotdip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009.						
fischer injection system FIS VE					Annex C 1	
Performances Essential characteristics for the steel bearing capacity of fischer anchor rods and standard threaded rods						

Table C2.1: Essential characteristic for the **steel bearing capacity** under tensile / shear load of **fischer internal threaded anchors RG MI**

fischer internal threaded anchors RG MI				M8	M10	M12	
Bearing capacity under tensile load, steel failure							
Charact. resistance with screw	$N_{Rk,s}$	Property class	5.8	[kN]	19	29	43
			8.8		29	47	68
		Property class 70	A4		26	41	59
			C		26	41	59
Partial factors¹⁾							
Partial factors	$\gamma_{Ms,N}$	Property class	5.8	[-]	1,50		
			8.8		1,50		
		Property class 70	A4		1,87		
			C		1,87		
Bearing capacity under shear load, steel failure							
Without lever arm							
Charact. resistance with screw	$V^0_{Rk,s}$	Property class	5.8	[kN]	9,2	14,5	21,1
			8.8		14,6	23,2	33,7
		Property class 70	A4		12,8	20,3	29,5
			C		12,8	20,3	29,5
Ductility factor		k_7	[-]	1,0			
With lever arm							
Charact. resistance with screw	$M^0_{Rk,s}$	Property class	5.8	[Nm]	20	39	68
			8.8		30	60	105
		Property class 70	A4		26	52	92
			C		26	52	92
Partial factors¹⁾							
Partial factors	$\gamma_{Ms,V}$	Property class	5.8	[-]	1,25		
			8.8		1,25		
		Property class 70	A4		1,56		
			C		1,56		
¹⁾ In absence of other national regulations							
fischer injection system FIS VE						Annex C 2	
Performances Essential characteristics for the steel bearing capacity of fischer internal threaded anchor RG MI							

Table C3.1: Essential characteristics under tensile / shear load						
Size		All sizes				
Tensile load						
Uncracked concrete	$k_{ucr,N}$	[-]	11,0			
Factors for the compressive strength of concrete > C20/25						
Increasing factor for τ_{Rk}	C25/30	Ψ_c	[-]	1,05		
	C30/37			1,10		
	C35/45			1,15		
	C40/50			1,19		
	C45/55			1,22		
	C50/60			1,26		
Splitting failure						
Edge distance	$h / h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 h_{ef}$		
	$2,0 > h / h_{ef} > 1,3$			$4,6 h_{ef} - 1,8 h$		
	$h / h_{ef} \leq 1,3$			$2,26 h_{ef}$		
Spacing	$s_{cr,sp}$			$2 c_{cr,sp}$		
Concrete cone failure						
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$			
Spacing	$s_{cr,N}$		$2 c_{cr,N}$			
Installation factor tensile load	γ_{inst}	[-]	1,2			
Shear load						
Installation factor shear load	γ_{inst}	[-]	1,0			
Concrete pry-out failure						
Factor for pry-out failure	k_8	[-]	2,0			
Calculation diameters						
Size			M8	M10	M12	M16
fischer anchor rods and standard threaded rods	d_{nom}	[mm]	8	10	12	16
fischer internal threaded anchors RG MI	d_{nom}		12	16	18	---
fischer injection system FIS VE					Annex C 3	
Performances Essential characteristics under tensile / shear load						

Table C4.1: Essential characteristics of tensile resistance for fischer anchor rods and standard threaded rods in hammer drilled holes; uncracked concrete						
Anchor rod / standard threaded rod		M8	M10	M12	M16	
Combined pullout and concrete cone failure						
Calculation diameter	d	[mm]	8	10	12	16
Uncracked concrete						
Characteristic bond resistance in uncracked concrete C20/25						
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)						
Temperature range	I: 50 °C / 80 °C		$\tau_{Rk,ucr}$ [N/mm ²]	11,0	11,0	11,0
	II: 72 °C / 120 °C			9,5	9,5	9,0
Installation factor						
Dry or wet concrete		γ_{inst}	[-]	1,4		
Table C4.2: Essential characteristics of tensile resistance for fischer internal threaded anchors RG MI in hammer drilled holes; uncracked concrete						
Internal threaded anchor RG MI		M8	M10	M12		
Combined pullout and concrete cone failure						
Calculation diameter	d	[mm]	12	16	18	
Uncracked concrete						
Characteristic bond resistance in uncracked concrete C20/25						
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)						
Temperature range	I: 50 °C / 80 °C		$\tau_{Rk,ucr}$ [N/mm ²]	10,5	10,0	9,5
	II: 72 °C / 120 °C			9,0	8,0	8,0
Installation factor						
Dry or wet concrete		γ_{inst}	[-]	1,4		
fischer injection system FIS VE						Annex C 4
Performances Essential characteristics of tensile resistance for fischer anchor rod, standard threaded rods and fischer internal threaded anchors RG MI (uncracked concrete)						

Table C5.1: Displacements for anchor rods					
Anchor rod		M8	M10	M12	M16
Displacement-Factors for tensile load¹⁾					
Uncracked concrete; Temperature range I, II					
δ_{N0} -Factor	[mm/(N/mm ²)]	0,09	0,09	0,10	0,10
$\delta_{N\infty}$ -Factor		0,10	0,10	0,12	0,12
Displacement-Factors for shear load²⁾					
Uncracked concrete; Temperature range I, II					
δ_{V0} -Factor	[mm/kN]	0,11	0,11	0,10	0,10
$\delta_{V\infty}$ -Factor		0,12	0,12	0,11	0,11
¹⁾ Calculation of effective displacement: $\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$ $\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$ (τ_{Ed} : Design value of the applied tensile stress)			²⁾ Calculation of effective displacement: $\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$ $\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$ (V_{Ed} : Design value of the applied shear force)		
Table C5.2: Displacements for fischer internal threaded anchors RG MI					
Internal threaded anchor RG MI		M8	M10	M12	
Displacement-Factors for tensile load¹⁾					
Uncracked concrete; Temperature range I, II					
δ_{N0} -Factor	[mm/(N/mm ²)]	0,10	0,11	0,12	
$\delta_{N\infty}$ -Factor		0,13	0,14	0,15	
Displacement-Factors for shear load²⁾					
Uncracked concrete; Temperature range I, II					
δ_{V0} -Factor	[mm/kN]	0,12	0,12	0,12	
$\delta_{V\infty}$ -Factor		0,14	0,14	0,14	
¹⁾ Calculation of effective displacement: $\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$ $\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$ (τ_{Ed} : Design value of the applied tensile stress)			²⁾ Calculation of effective displacement: $\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$ $\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$ (V_{Ed} : Design value of the applied shear force)		
fischer injection system FIS VE					Annex C 5
Performances Displacement for anchor rods and fischer internal threaded anchors RG MI					