

Mfpa Leipzig GmbH

Leipzig Institute for Materials
Research and Testing

Testing, Inspection and
Certification Authority for
Construction Products and
Construction Types

Center for Innovation and Calcula-
tion

Head of Division:
Dr.-Ing. Susanne Reichel
Tel.: +49 (0) 341-6582-106
Fax: +49 (0) 341-6582-135
s.reichel@mfp-leipzig.de

Work Group - FEM

Contact Person:
Dr.-Ing. Susanne Reichel
Tel.: +49 (0) 341-6582-106
s.reichel@mfp-leipzig.de

Advisory Opinion No. GS 6.1/22-066-2

09.05.2023

Translation of the original German document GS 6.1/22-066-2

Object: Evaluation of the performance characteristics in case of fire of fischer Sliding Elements FASM-2 and FASH-2 in accordance with EAD 280016-00-0602 - abbreviated version

Client: **fischerwerke GmbH & Co. KG**
Klaus-Fischer-Straße 1
72178 Waldachtal
Germany

Prepared by: Dr.-Ing. Susanne Reichel

This document covers 8 pages, including 0 appendices.

This document may only be reproduced in its unabbreviated form. All publications, even in excerpts, requires the prior written permission of Mfpa Leipzig GmbH. The legal binding form is the written German form with the original signatures and original stamp of the authorized signatory / signatories. General terms and conditions of Mfpa Leipzig GmbH are valid.



Contents

1 Objectives and procedure	3
2 Description of the construction	4
3 References	6
3.1 Utilized guidelines, rules and standards	6
3.2 Assessment and test reports	6
4 Evaluation of the performance characteristics	7
4.1 Design concept	7
4.2 Load bearing capacity in case of fire	7
5 Signatures	8


1 Objectives and procedure

MFPA Leipzig GmbH was commissioned by fischerwerke GmbH & Co. KG to carry out an evaluation of performance characteristics in accordance with EAD 280016-00-0602 [N1] for fischer Sliding Elements FASM-2 and FASH-2. With respect to the thermal loading, the standard temperature time curve (STTC) according to [N2] is considered. The evaluation is carried out on the basis of test results. The present document includes a summary of the design concept for fire design and the associated characteristic load-bearing capacities. For a detailed derivation of the performance properties, please refer to [G1].

2 Description of the construction


Fischer Sliding Elements FASM and FASH are used to fasten pipe clamps in areas where longitudinal movement of the pipelines (caused, for example, by thermal elongation) must be possible. Medium-duty Sliding Elements FASM consist of a bracket, two sliding rails and a carriage, while heavy-duty Sliding Elements FASH are equipped with two rolling elements in addition to the bracket and carriage (see Figures 1 and 2). In both cases, the carriage is equipped with one (FASM-1 or FASH-1) or two (FASM-2 or FASH-2) weld-on nuts M10/M12 or M12/M16, respectively, which allow the connection to threaded elements (e.g. threaded rods) of sizes M10 and M12 or M12 and M16. The weld-on nuts are connected to the carriage by weld seams.

The advisory opinion at hand covers fischer Sliding Elements FASM-2 and FASH-2.

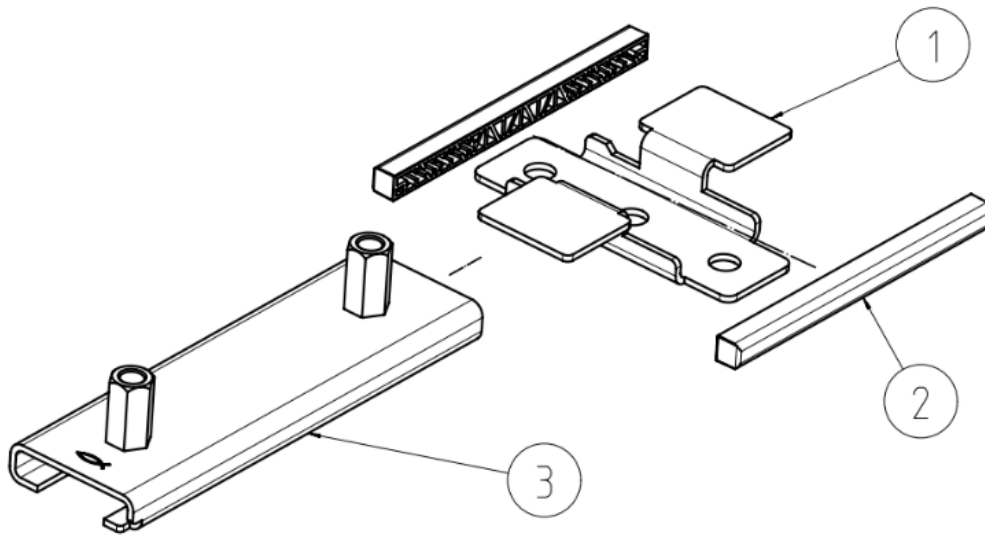

Article-No.	Article	Pos.	Designation
567952	FASM-2 M10/12	1	Bracket FASM
		2	Sliding rails
		3	Carriage FASM-2 M10/12

Figure 1: fischer medium-duty Sliding Elements FASM-2: Geometry

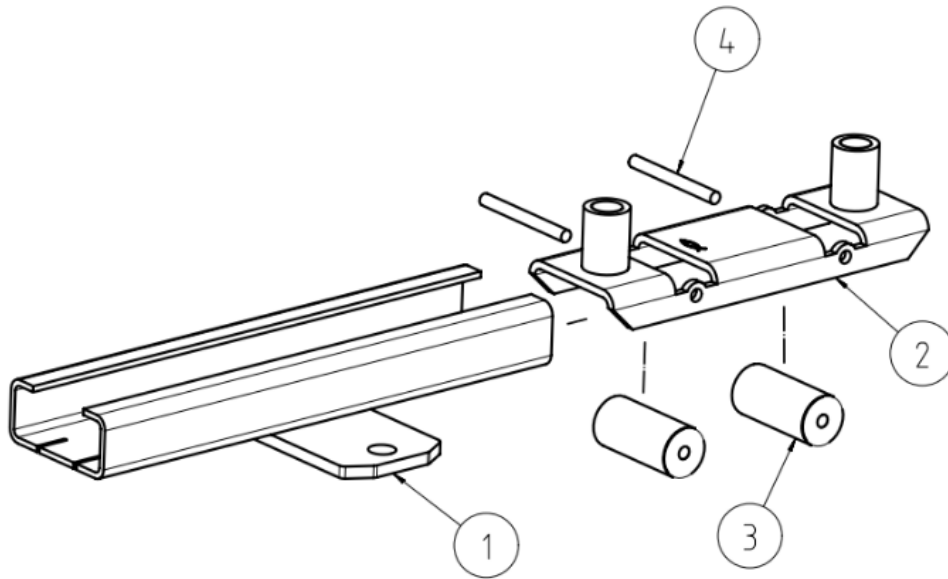

Article-No.	Article	Pos.	Designation
567954	FASH-2 M12/16	1	Bracket FASH
		2	Carriage FASH-2 M12/16
		3	Rolling element FASH
		4	Pin 6m6x60 -A1 1.4305

Figure 2: fischer heavy-duty Sliding Elements FASH-2: Geometry

3 References

3.1 Utilized guidelines, rules and standards

The analyses are based on the following guidelines, rules and standards:

- [N1] EAD 280016-00-0602: Products for installation systems for supporting technical building equipment; 06/2020
- [N2] DIN EN 1363-1:2020-05: Fire resistance tests - Part 1: General Requirements; German version EN 1363-1:2020

3.2 Assessment and test reports

- [G1] Gutachterliche Stellungnahme Nr. GS 6.1/22-066-1: Bewertung der Leistungseigenschaften im Brandfall von fischer Gleitelementen FASM-2 und FASH-2 in Anlehnung an EAD 280016-00-0602. – MFPA Leipzig GmbH; 08.05.2023

4 Evaluation of the performance characteristics

4.1 Design concept

The determination of the performance characteristics in case of fire for fischer Sliding Elements FASM-2 and FASH-2 is carried out using the procedure anchored in EAD 280016-00-0602 [N1], Annex F on the basis of experimental tests for a fire exposure of up to 120 minutes.

The corresponding results are applicable to all positions of the carriage with respect to the bracket (cf. [G1]). The attachment of the Sliding Elements to the substrate is not part of the present advisory opinion.

4.2 Load bearing capacity in case of fire

The characteristic tensile load-bearing capacities $F_{Rk,t}$ in case of fire summarized below are valid for Sliding Elements

- FASM-2 with threaded rods \geq M10 of strength class \geq 4.8,
- FASH-2 with threaded rods \geq M12 of strength class \geq 4.8,

installed according to the manufacturer's specifications.

	fire duration [<i>min</i>]			
	30	60	90	120
FASM-2	1691	853	573	433
FASH-2	2108	1213	915	766

Table 1: fischer medium-duty Sliding Elements FASM-2 and heavy-duty Sliding Elements FASH-2: $F_{Rk,t}$ [N]



5 Signatures

This document does not replace a certificate of conformity or suitability according to national and European building codes.

Leipzig, 09.05.2023

Dr.-Ing. S. Reichel
Head of Business Division